
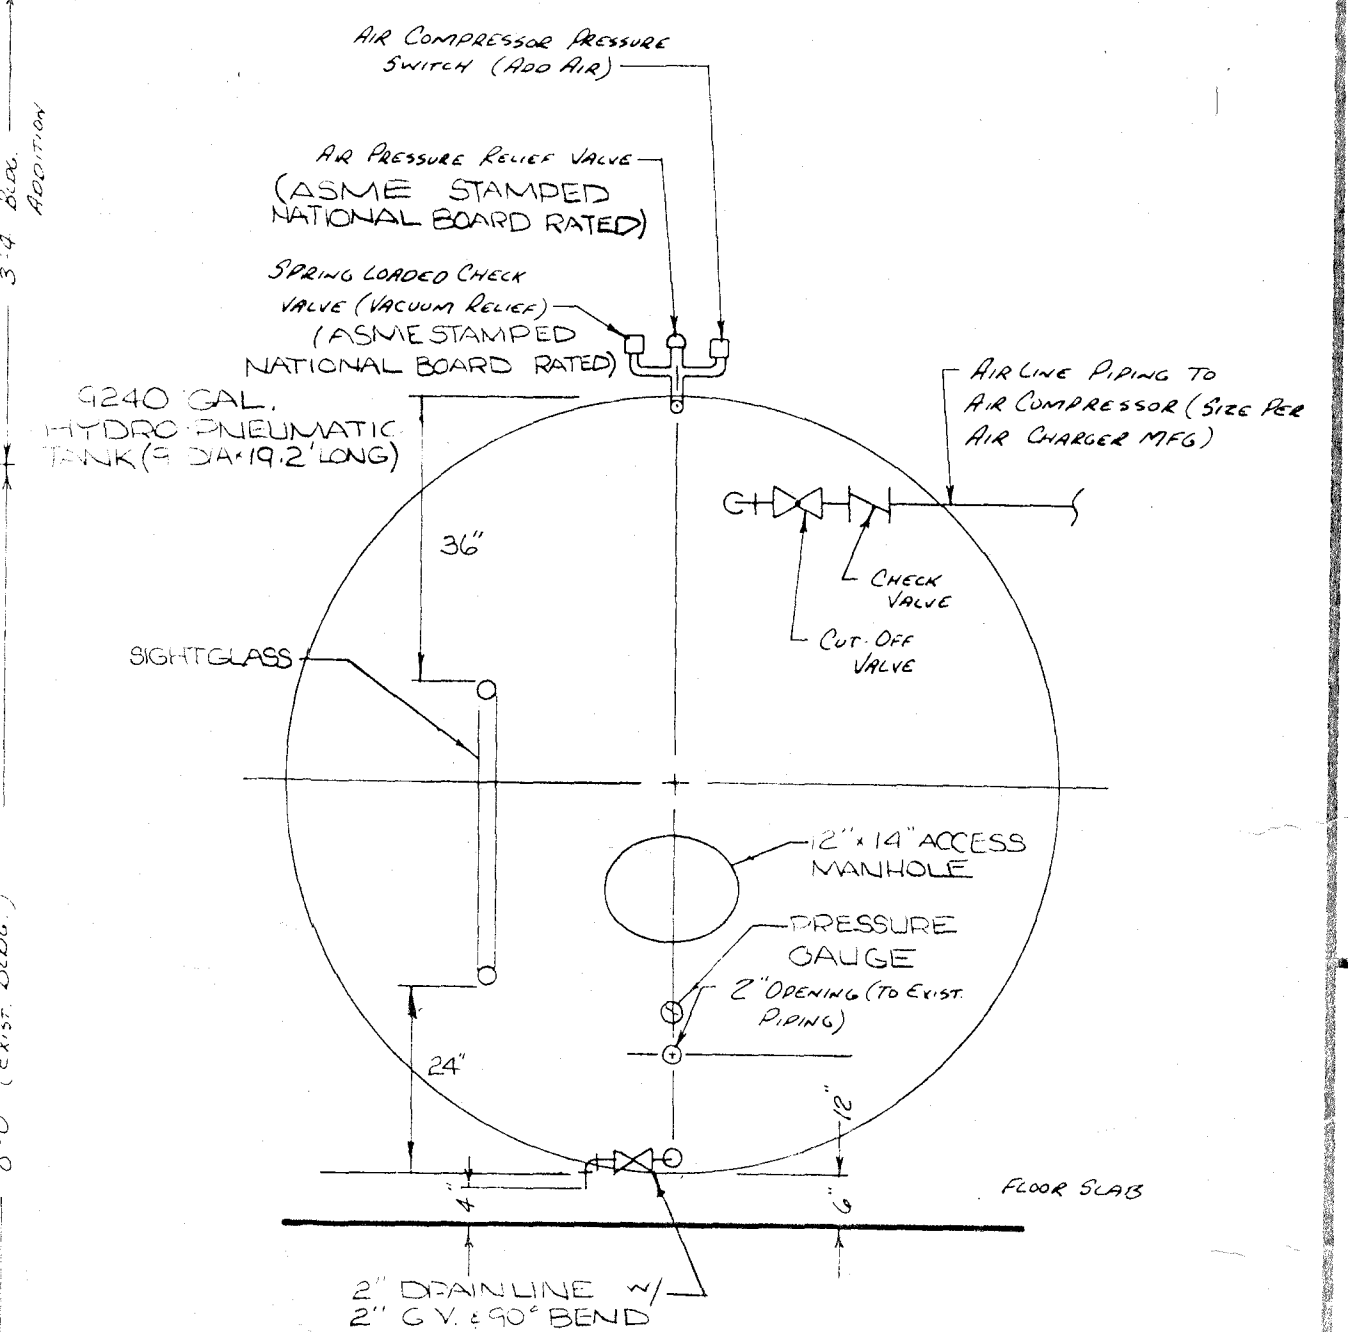


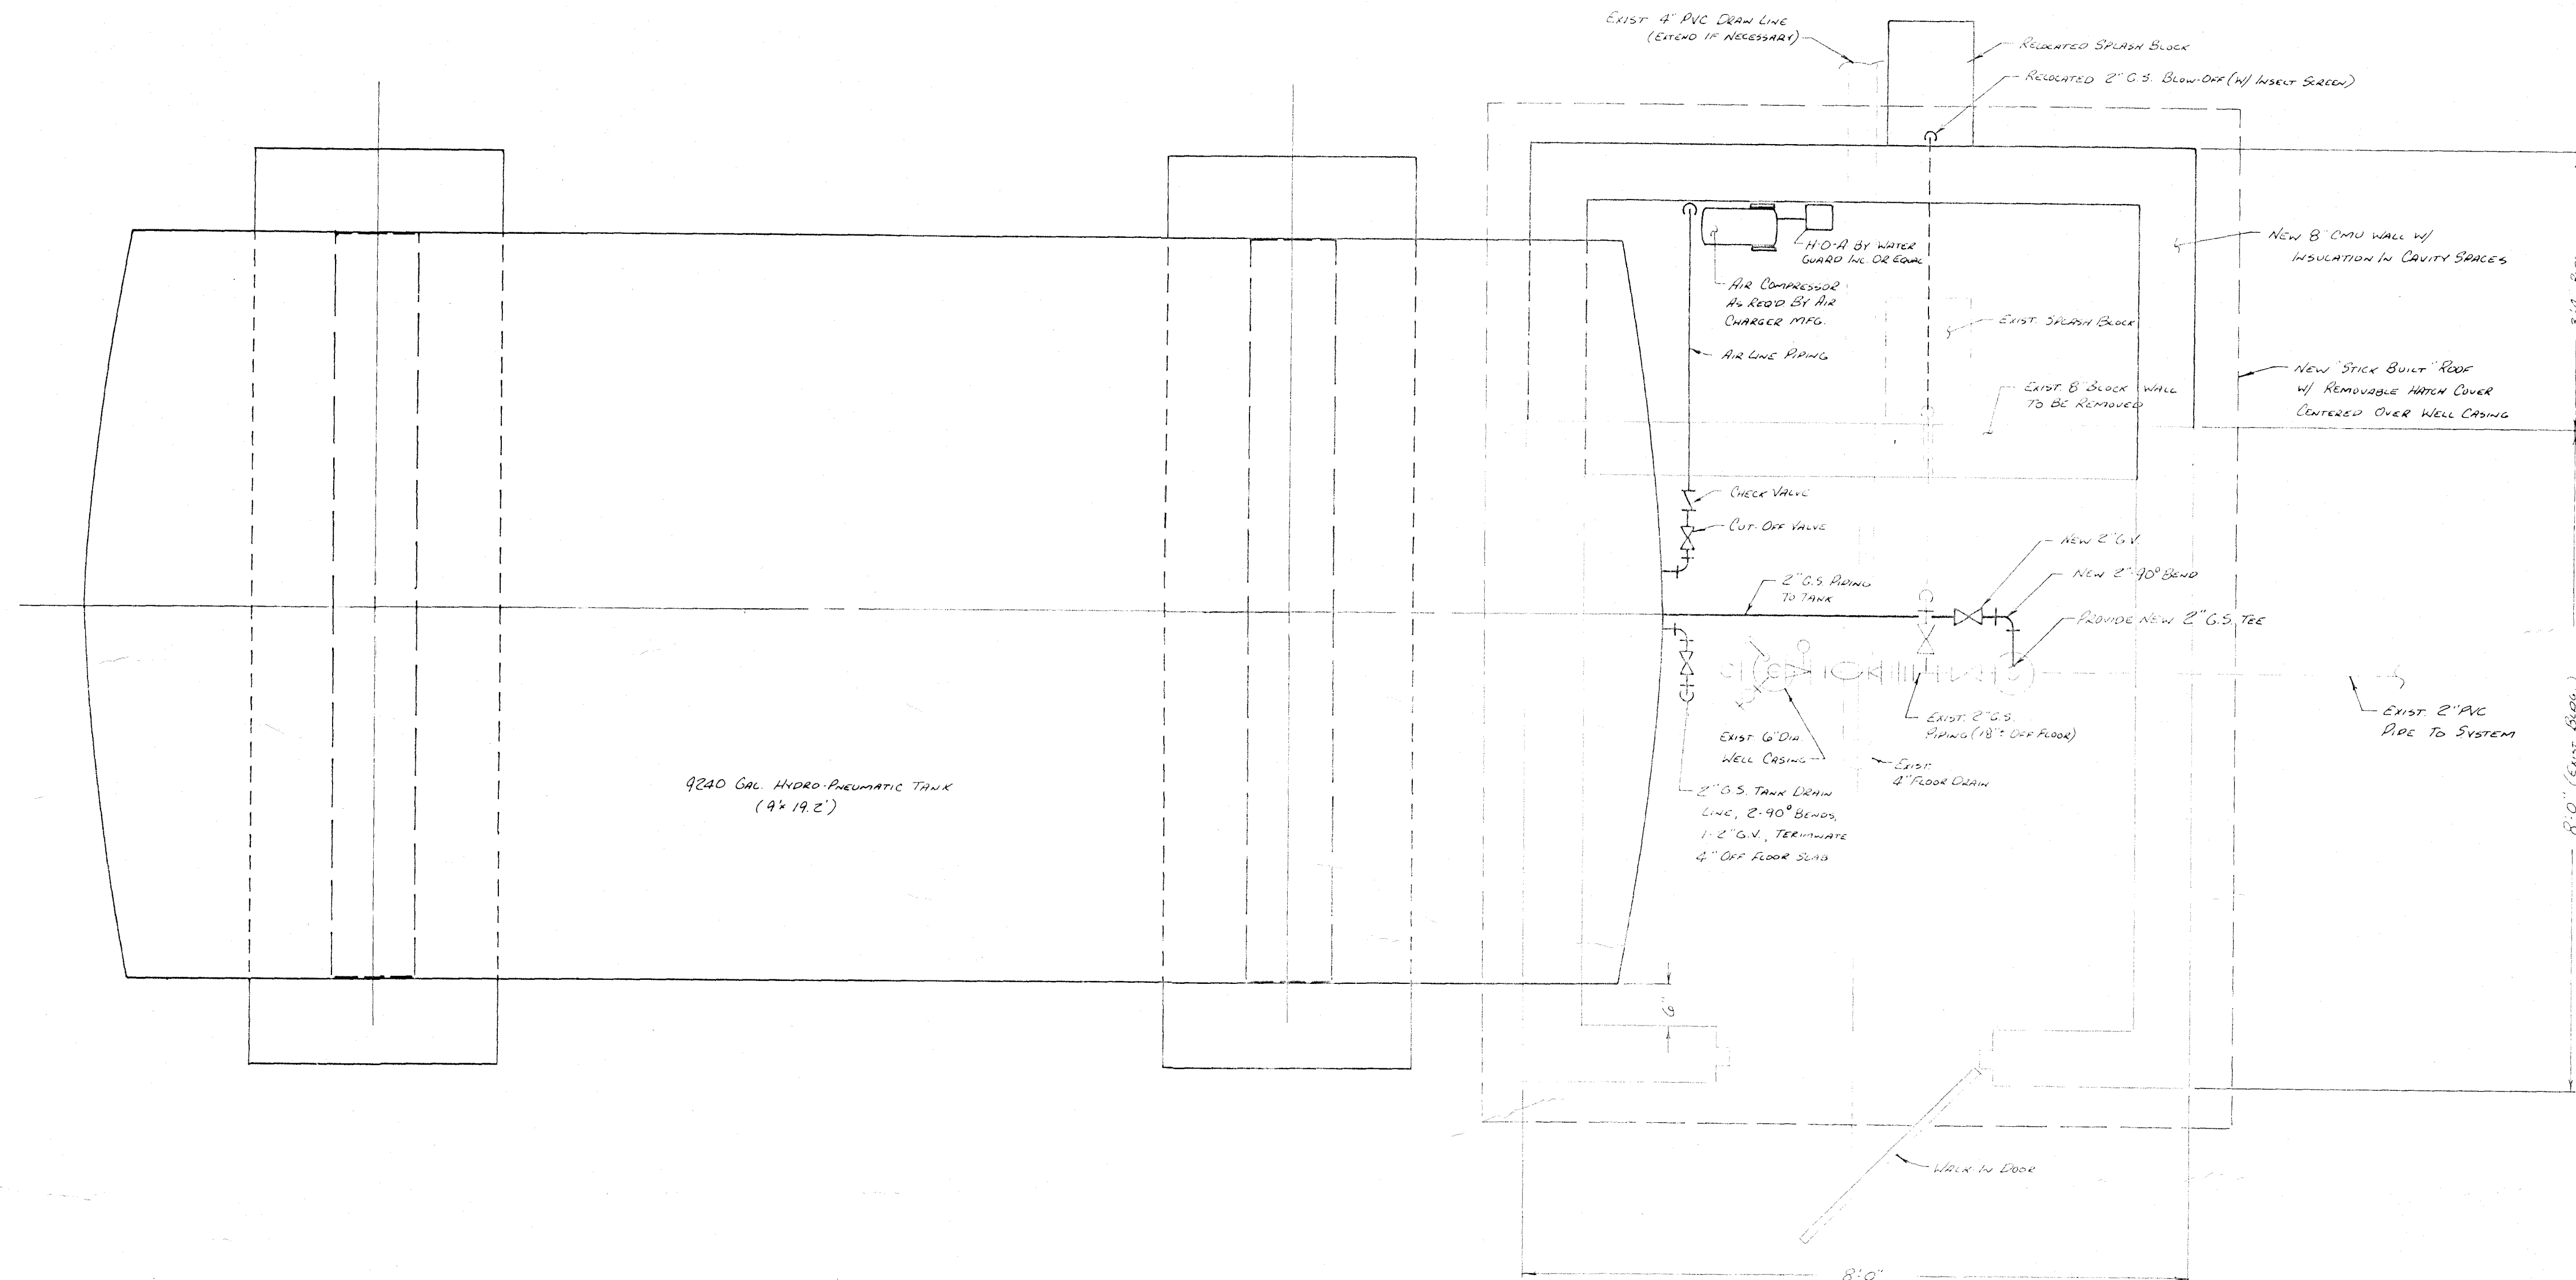


WELL NO. 3 ADDITION/HYDRO-TANK INSTALLATION - PLAN

SCALE: 3/8\"/>


GENERAL NOTES:

1. ALL VALVES SHALL BE BRONZE CONSTRUCTION: 125 PSI RATED.
2. ALL PVC PIPE AND FITTINGS SHALL BE 200 PSI, STAMPED NSF-PM APPROVED, ASTM D2641 AND PS 22-70.
3. GALVANIZED STEEL PIPE SHALL BE SCH. 40, GRADE B.
4. ALL PIPING, TANKS, ETC. INSTALLED AND/OR MODIFIED WHEN MAKING THESE IMPROVEMENTS SHALL BE DISINFECTED BY ADDING CHLORINE TO PRODUCE A RESIDUAL OF 50 PPM. CHLORINE SHALL REMAIN IN TANK FOR MINIMUM OF 24 HOURS, AFTER WHICH THE TANK SHALL BE FLUSHED. AFTER ALL CHLORINATED WATER IS EVACUATED, TWO (2) SAMPLES FOR BACTERIOLOGICAL ANALYSIS SHALL BE COLLECTED (AT 24 HOUR INTERVAL), AND SUBMITTED TO THE VIRGINIA DEPARTMENT OF HEALTH. TANK IS NOT TO BE PLACED IN SERVICE UNTIL BACTERIOLOGICAL SAMPLE RESULTS SHOW NO CONTAMINATION.
5. TANK INSIDE RECENTLY PAINTED W/COMPOUND 1 BY TEXACO.
6. THE TANK MUST MEET THE RULES AND REGULATIONS FOR BOILER & PRESSURE VESSELS. MR. LARRY LINTON OF THE BOILER & PRESSURE VESSEL DIVISION OF THE VIRGINIA DEPARTMENT OF LABOR AND INDUSTRY MUST BE CONTACTED AFTER INSTALLATION OF THE TANK FOR INSPECTION (703) 967-7178.

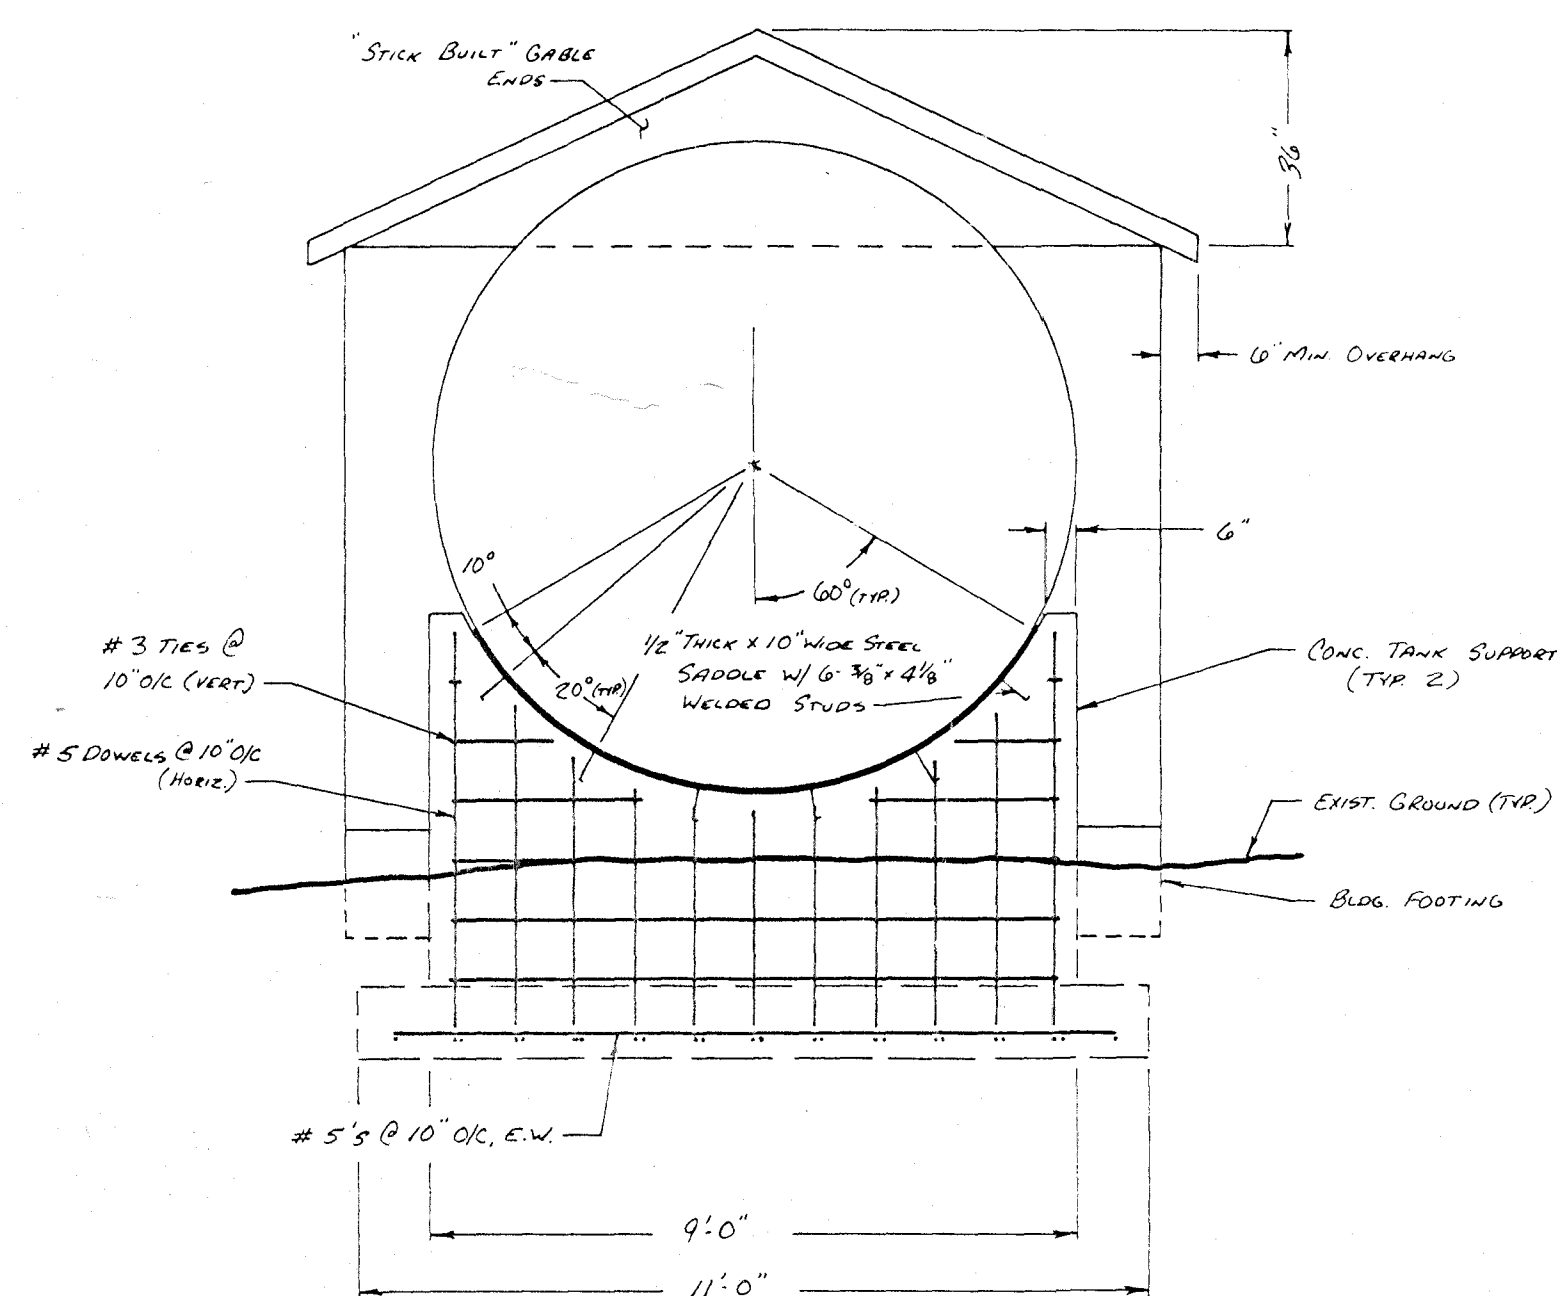

END VIEW

SCALE: 3/8\"/>

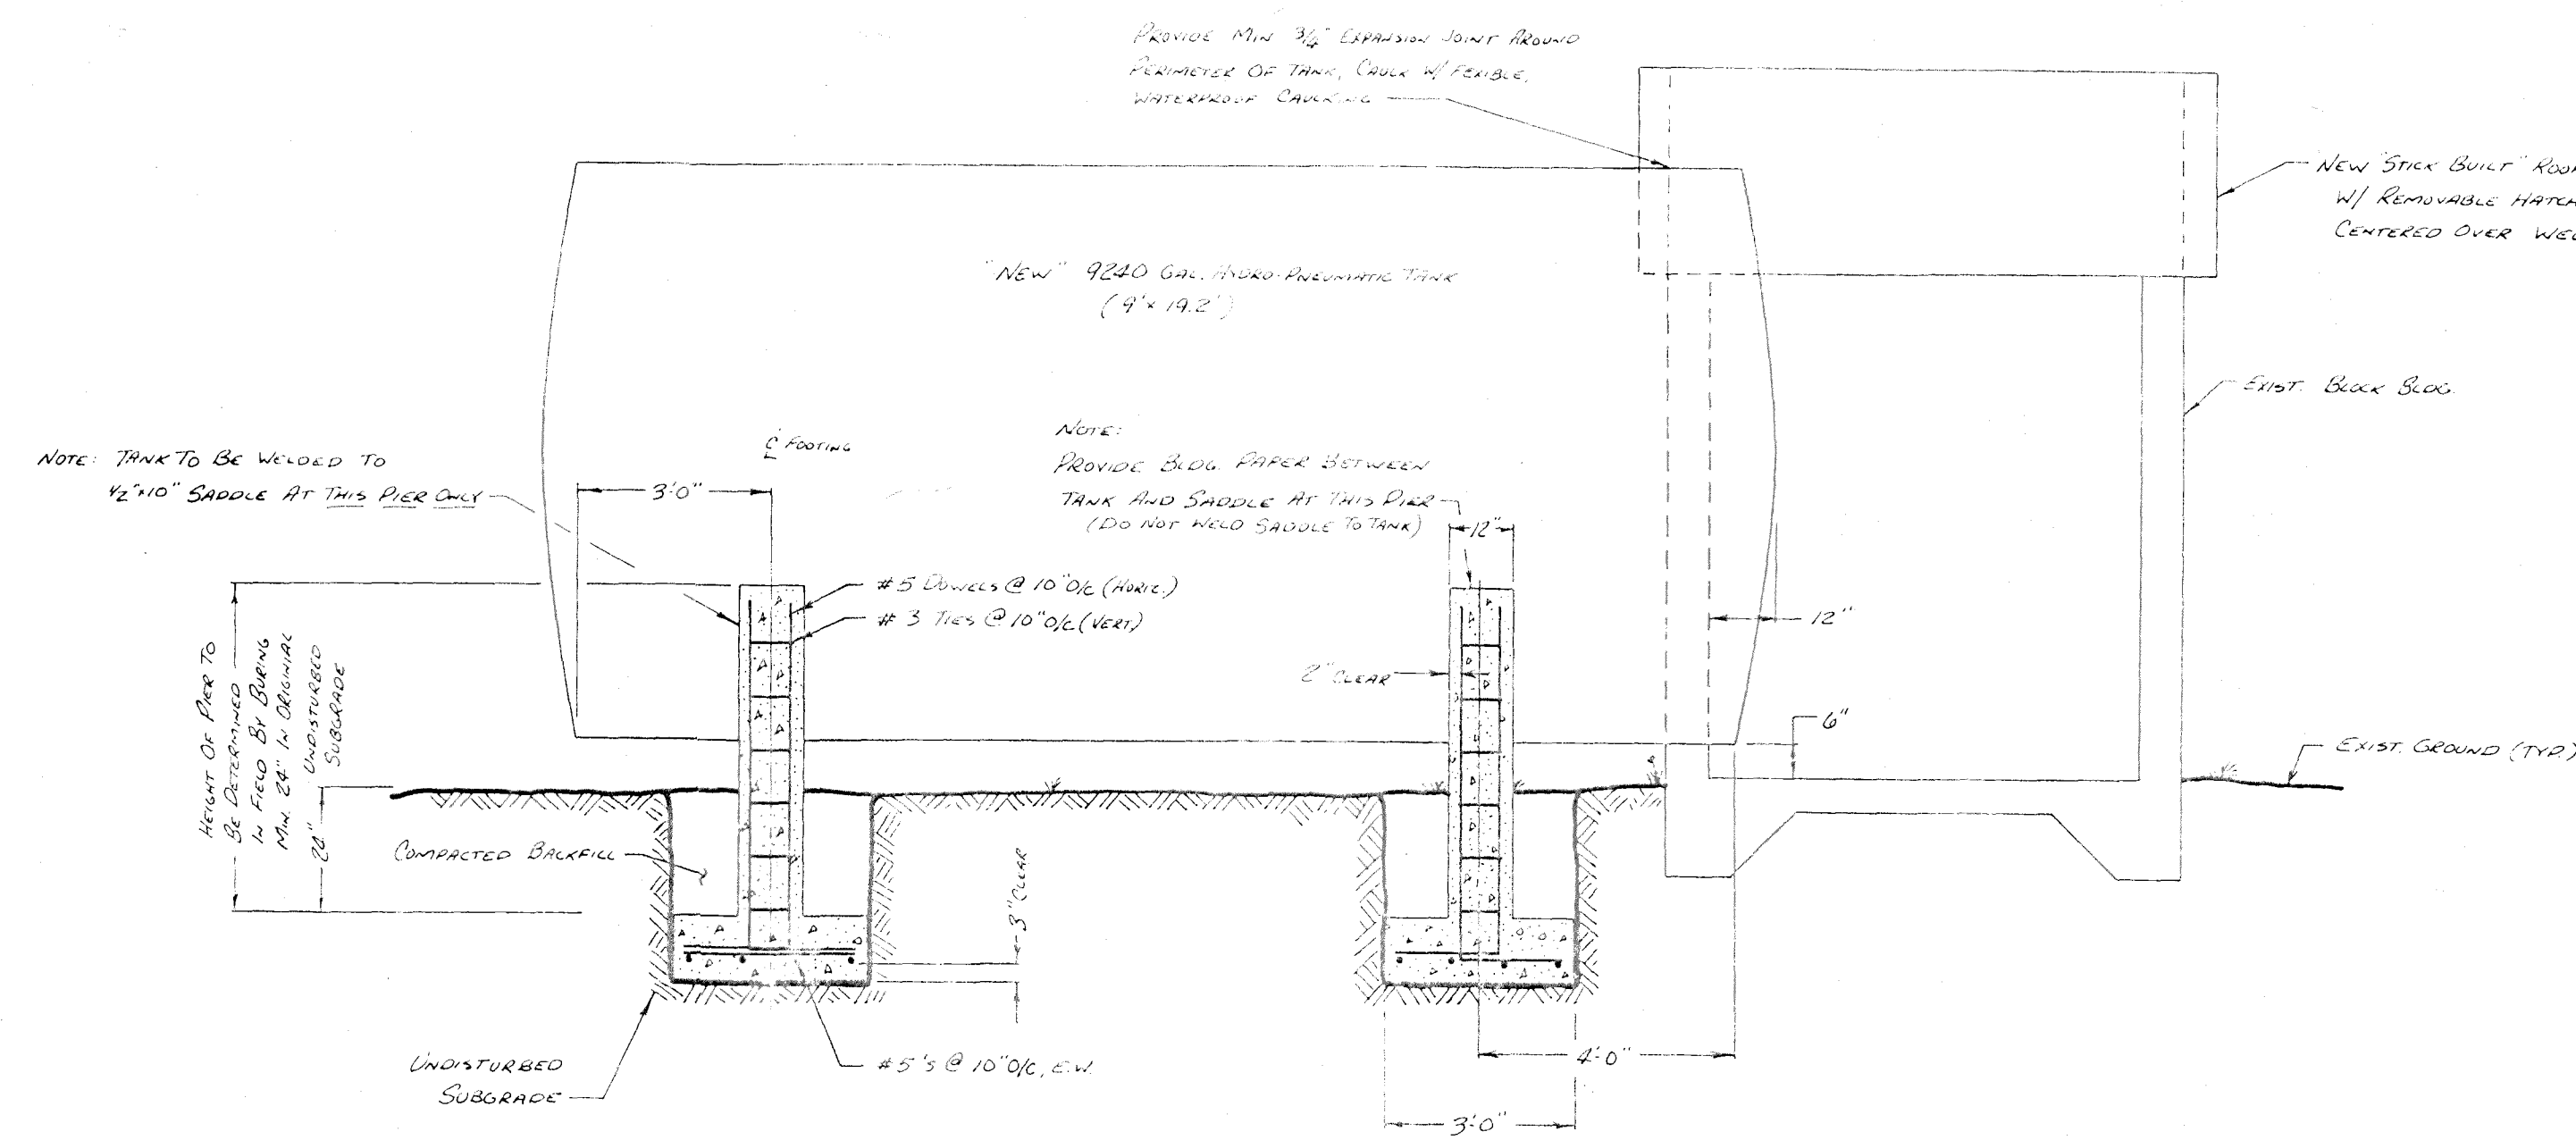

SIDE VIEW

SCALE: 3/8\"/>