


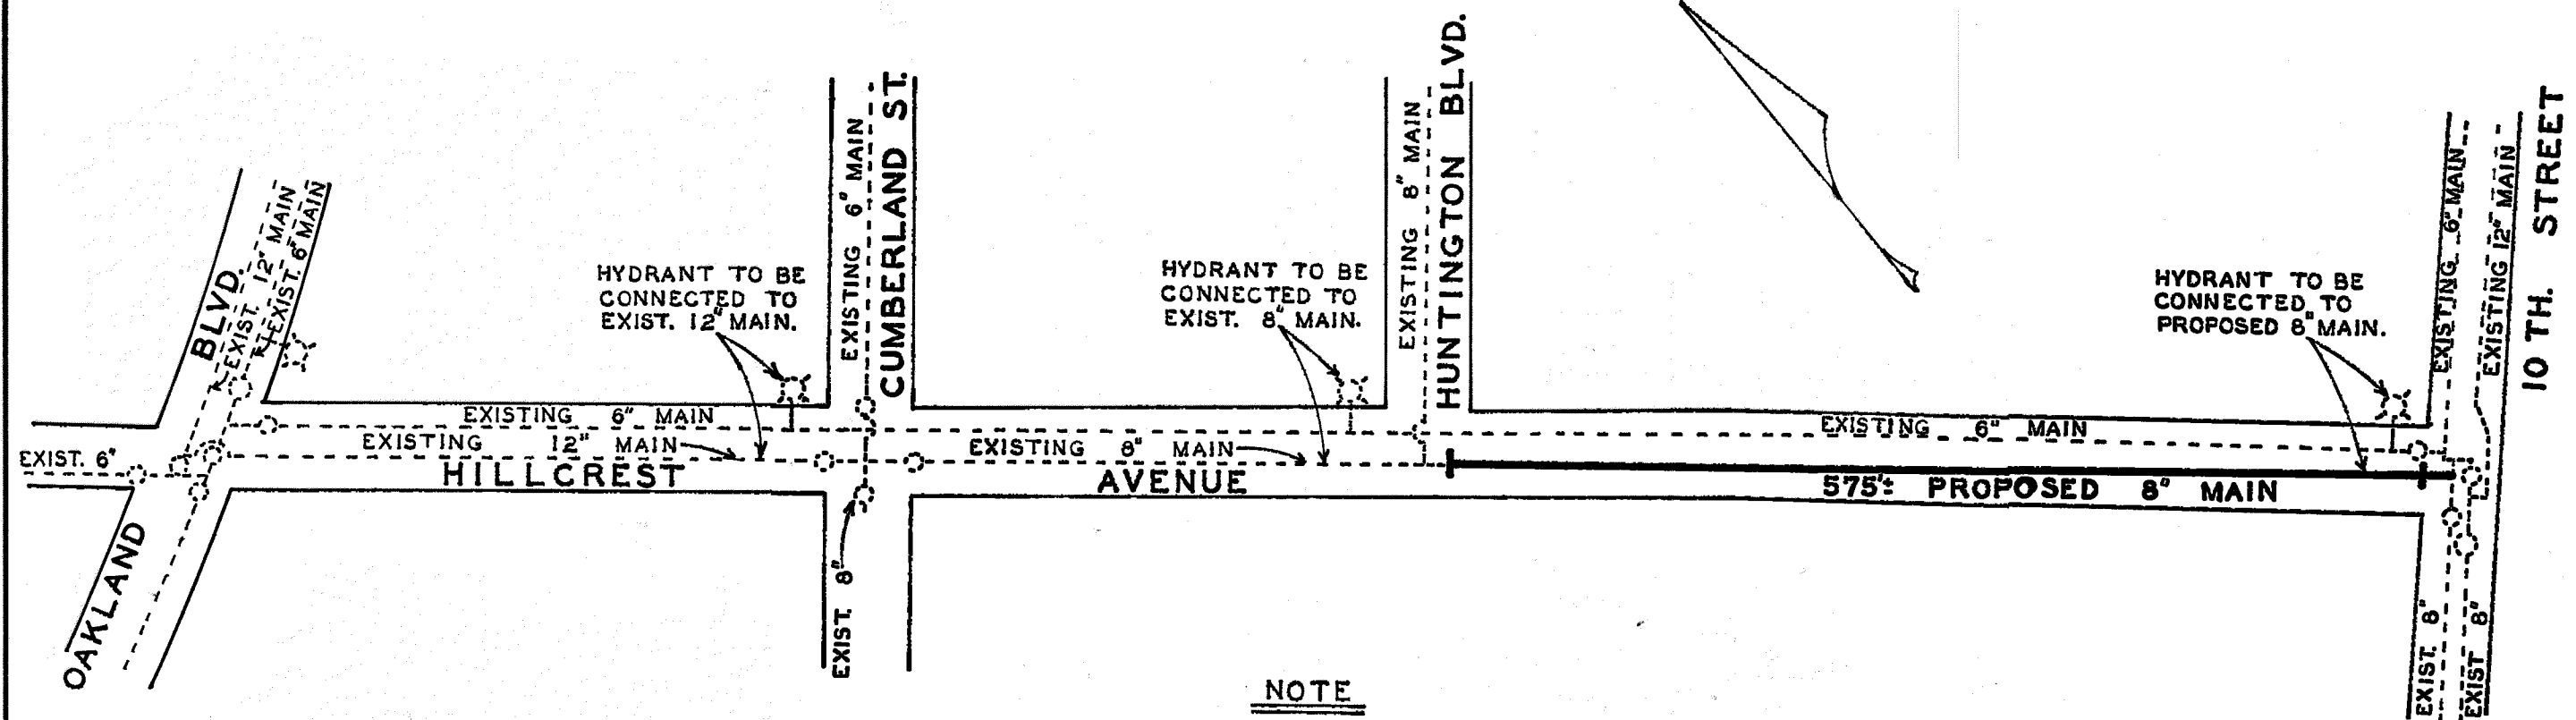

NOTE

EXISTING 6" MAIN FROM OAKLAND BLVD.
TO 10 TH. STREET N.W. IS TO BE
ABANDON.

DATE STARTED FEB 1 1967				
DATE COMP. FEB 13 1967				
FEET MAIN	SIZE	VALVE	VAULT	BOX
593'	8"	2	2	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: R. W. D.				
NO. 3/4" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. B. R. H.				

WATER DEPARTMENT
CITY OF ROANOKE, VA.
HILLCREST AVE. N.W.
SCALE 1"=100'
DRAWN BY C.G.C AUGUST 23, 1966