

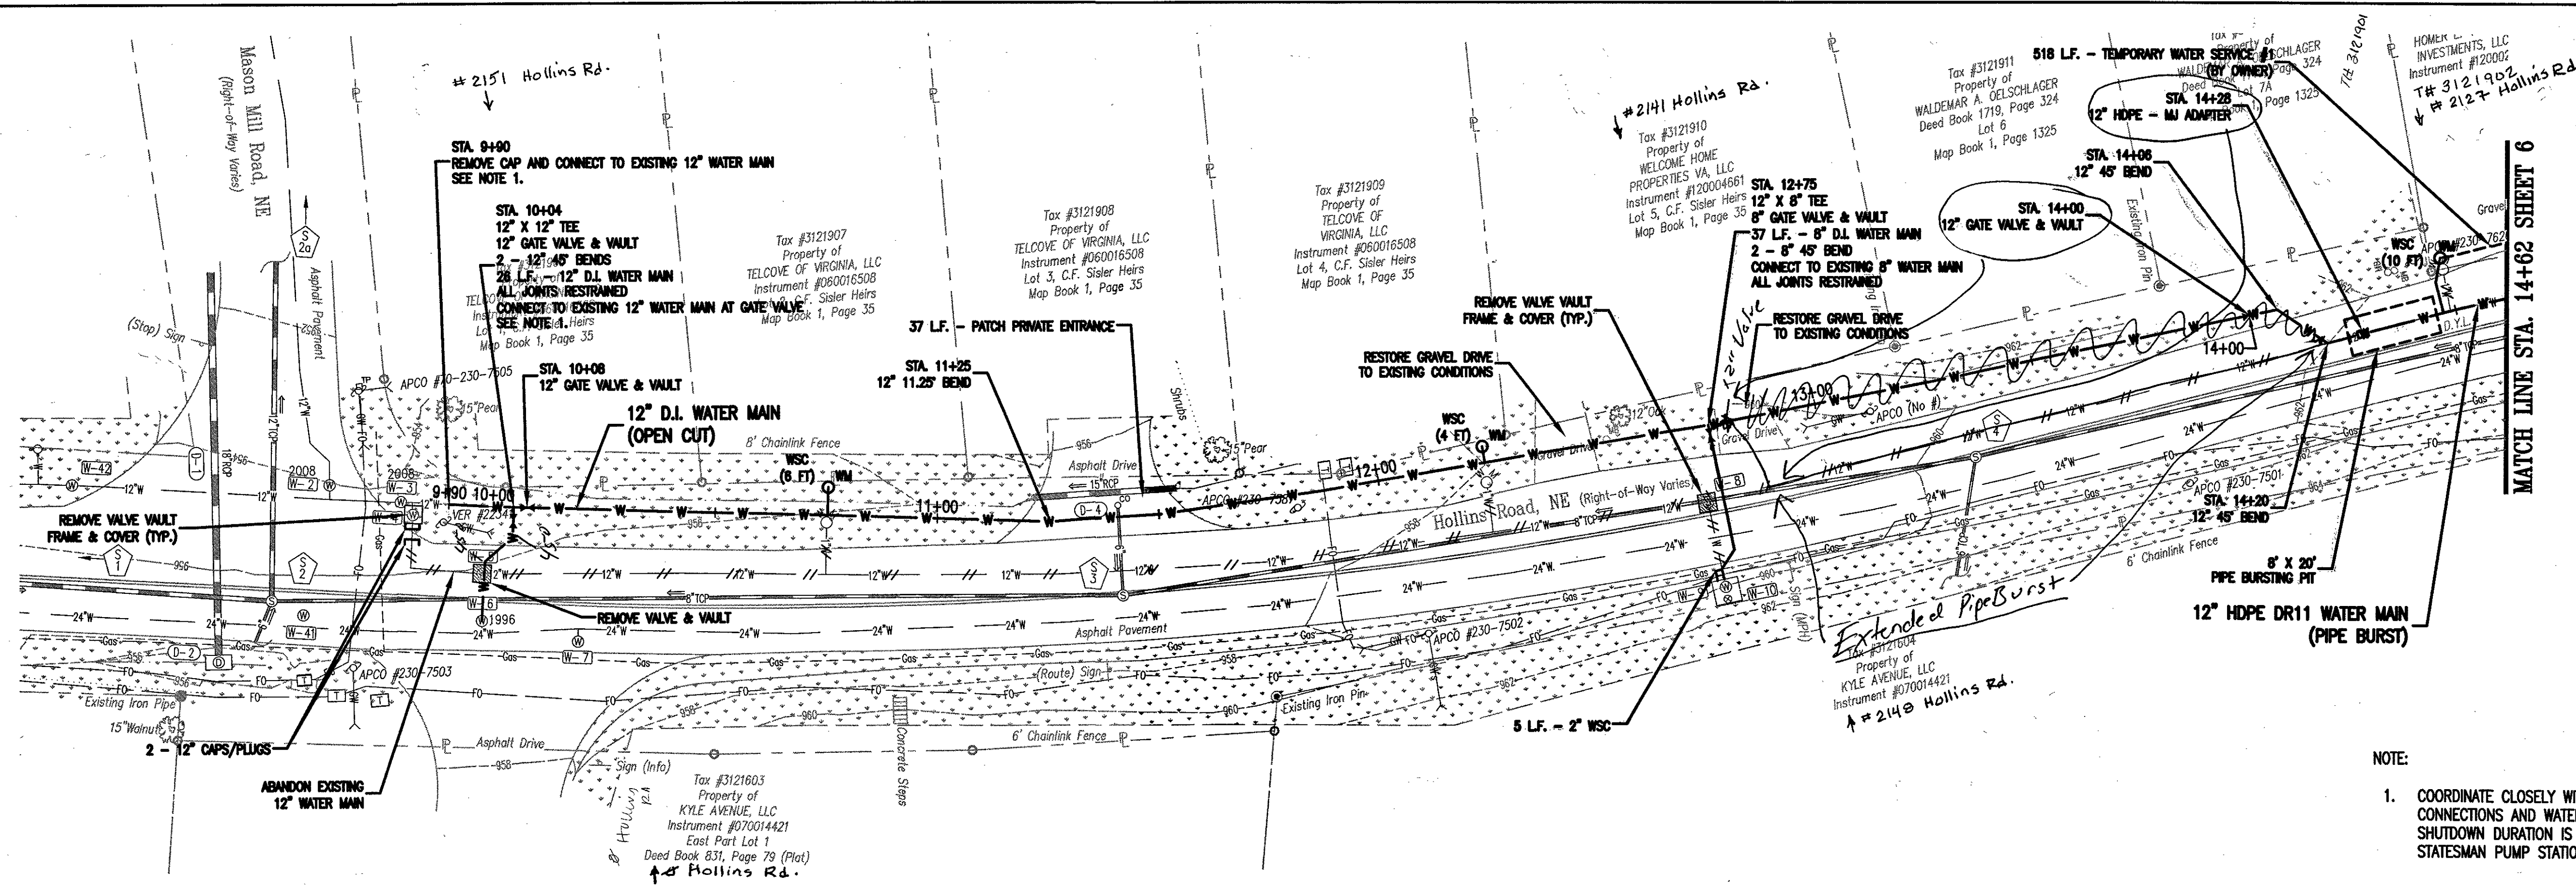


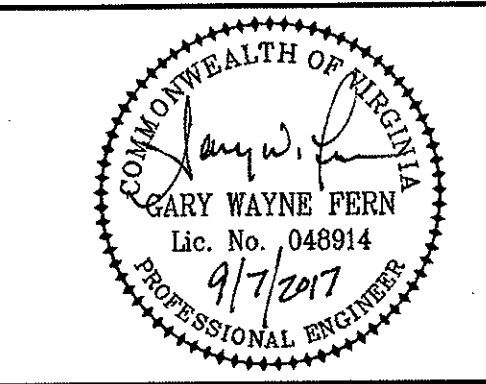

NOTE:
1. COORDINATE CLOSELY WITH WWA FOR NECESSARY CONNECTIONS AND WATER SYSTEM SHUTDOWNS. MAXIMUM SHUTDOWN DURATION IS 8 HOURS FOR MAINS SUPPLYING STATESMAN PUMP STATION.

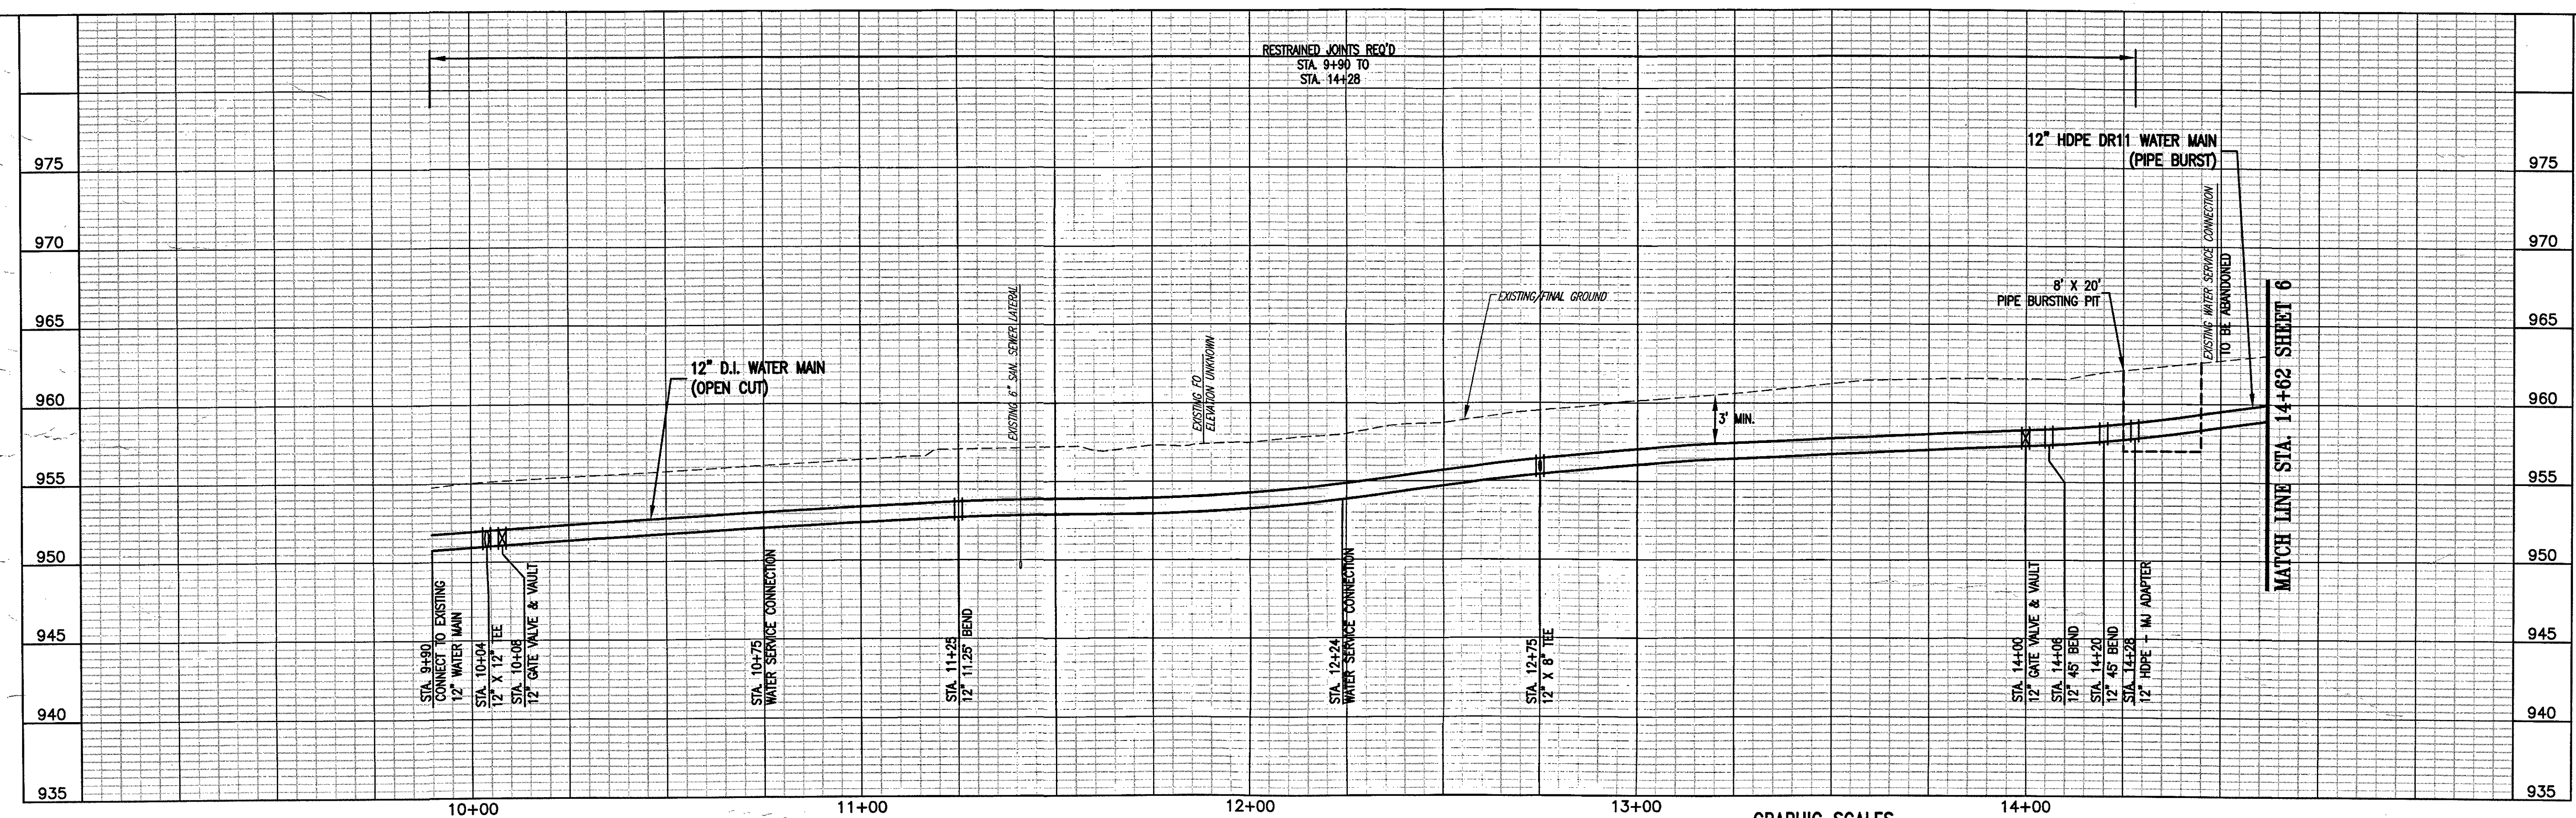

WESTERN VIRGINIA WATER AUTHORITY 601 South Jefferson Street, Suite 300 Roanoke, Virginia 24011		DES: PJM DRAWN: JES CHECK: GWF DATE: 9/07/17	SCALE: AS SHOWN HORIZ: 1" = 20' VERT: 1" = 5'	HOLLINS ROAD WATER MAIN REPLACEMENT - PHASE 2 PLAN - PROFILE STA. 9+90 TO 14+62	REV: DATE: DESCRIPTION: DRAWING: SHEET: 5
---	--	---	---	---	---