

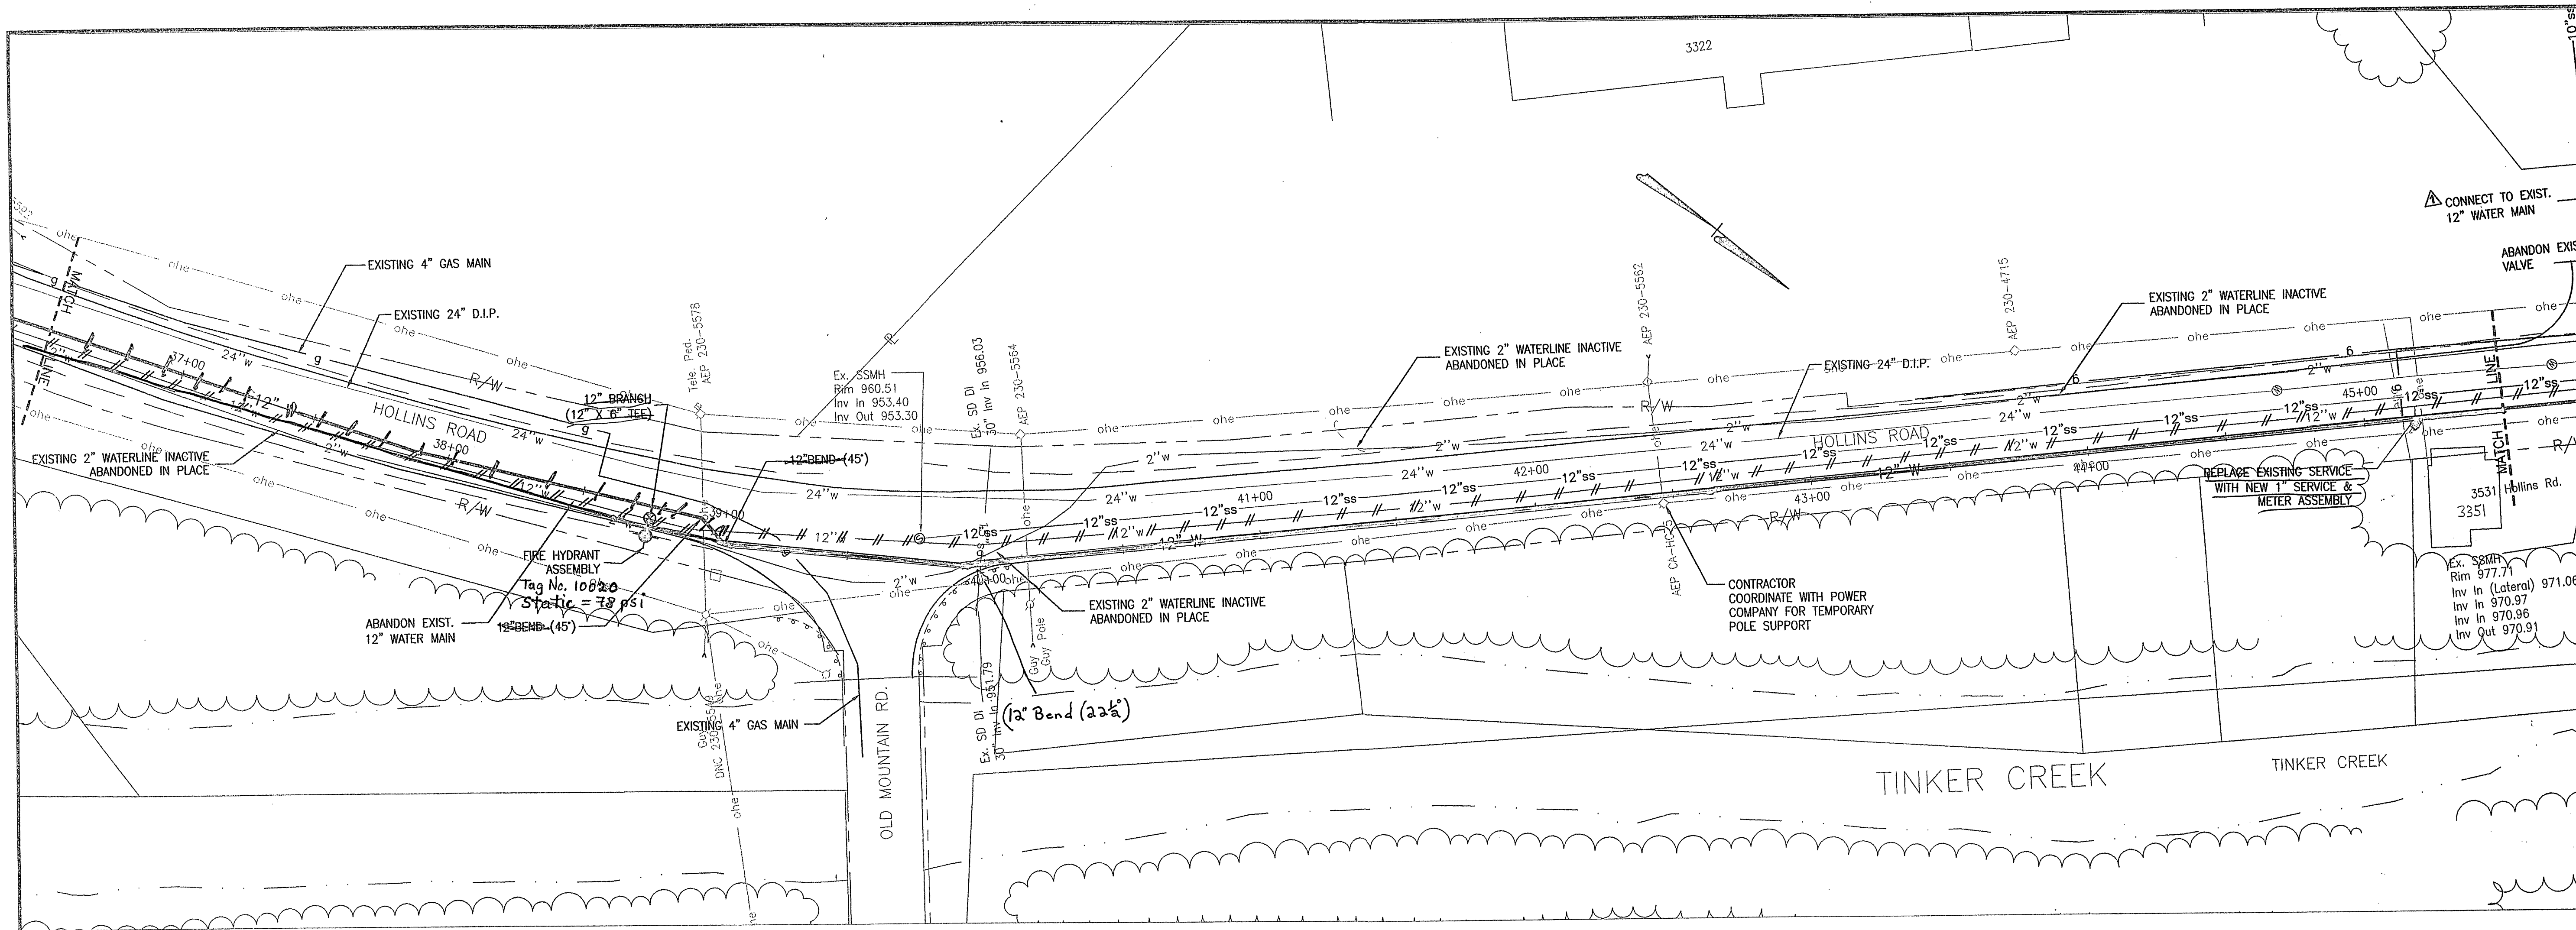


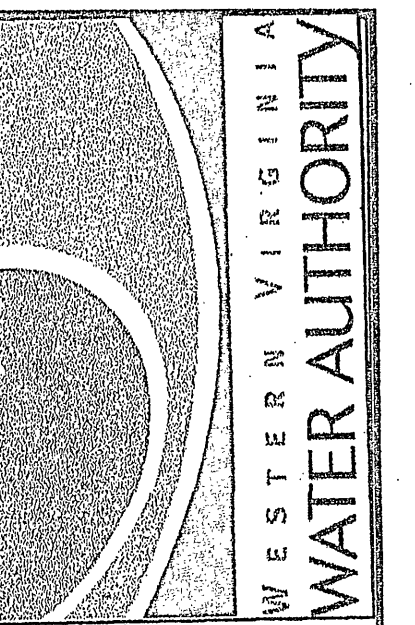


▲ Dry connection to existing water line. Coordinate all water outages with WWA construction inspector.

 ▲ All abandoned valves shall have vaults removed prior to backfill.

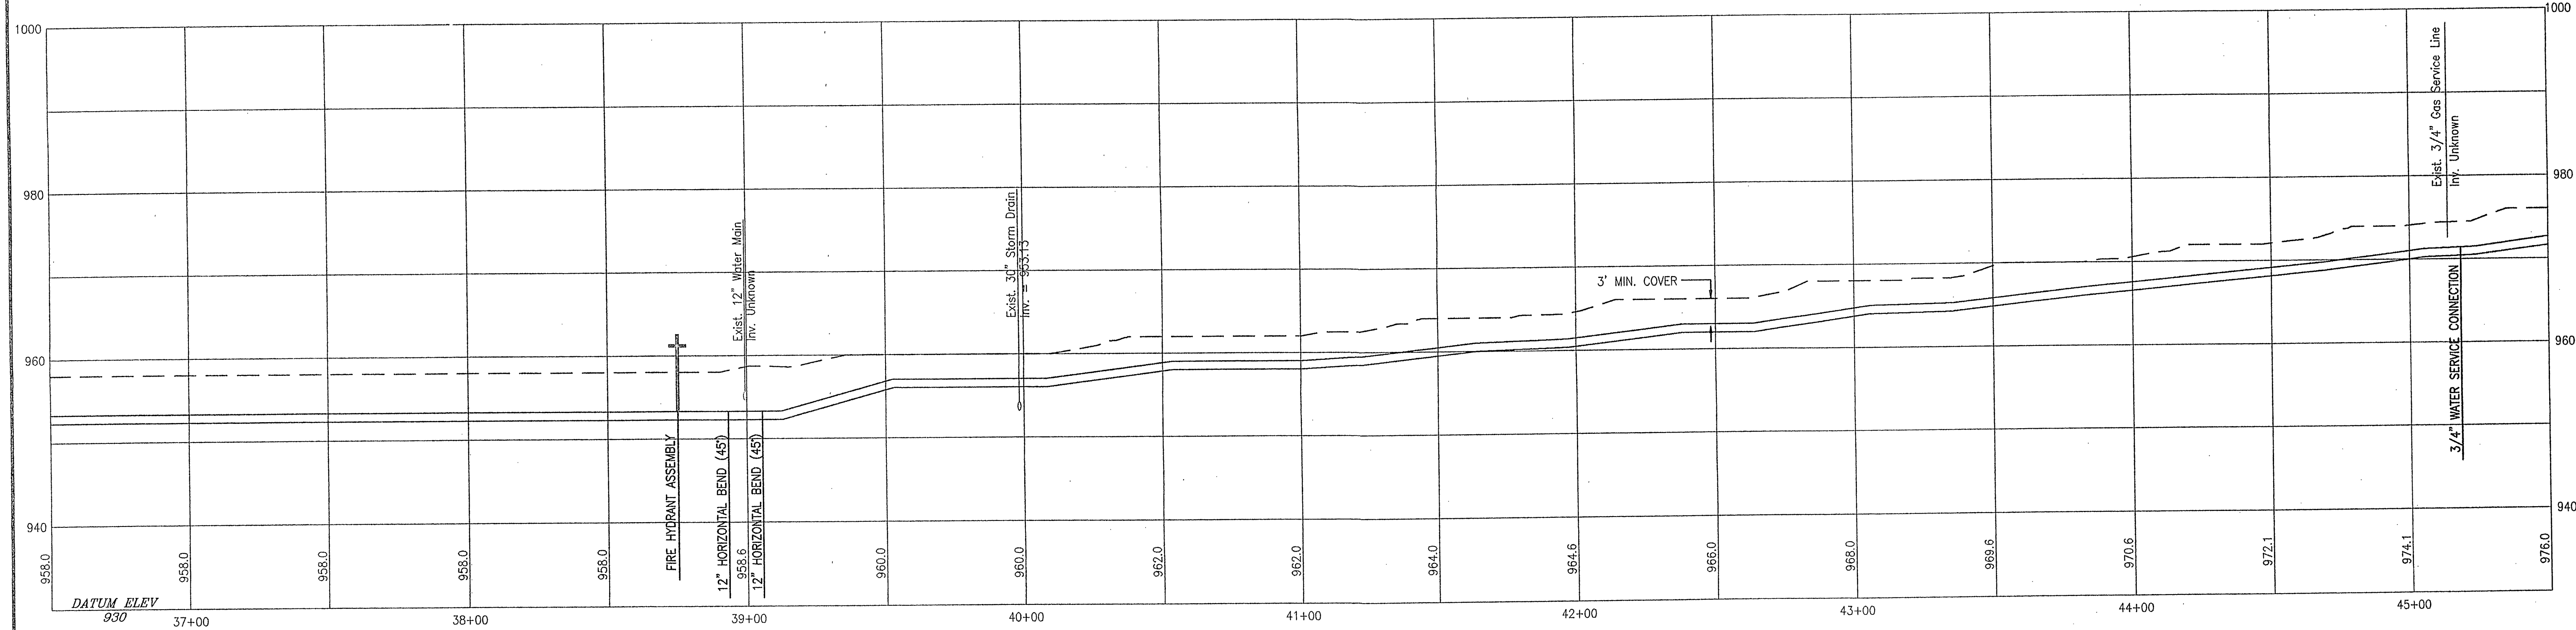

ENGINEERING SERVICES
 601 SOUTH JEFFERSON STREET
 ROANOKE, VIRGINIA 24011
 PHONE: (540) 853-5641

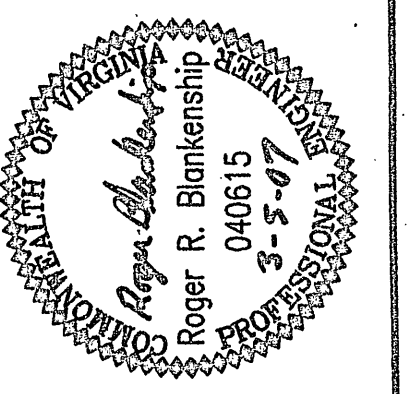

HOLLINS ROAD WATER LINE REPLACEMENT PROJECT

Designed By:	RRB
Drawn By:	RRB
Checked By:	JGR
Date:	02/13/07
Scale:	1" = 30'
Plan #:	00-00
Sheet:	6 OF 7