
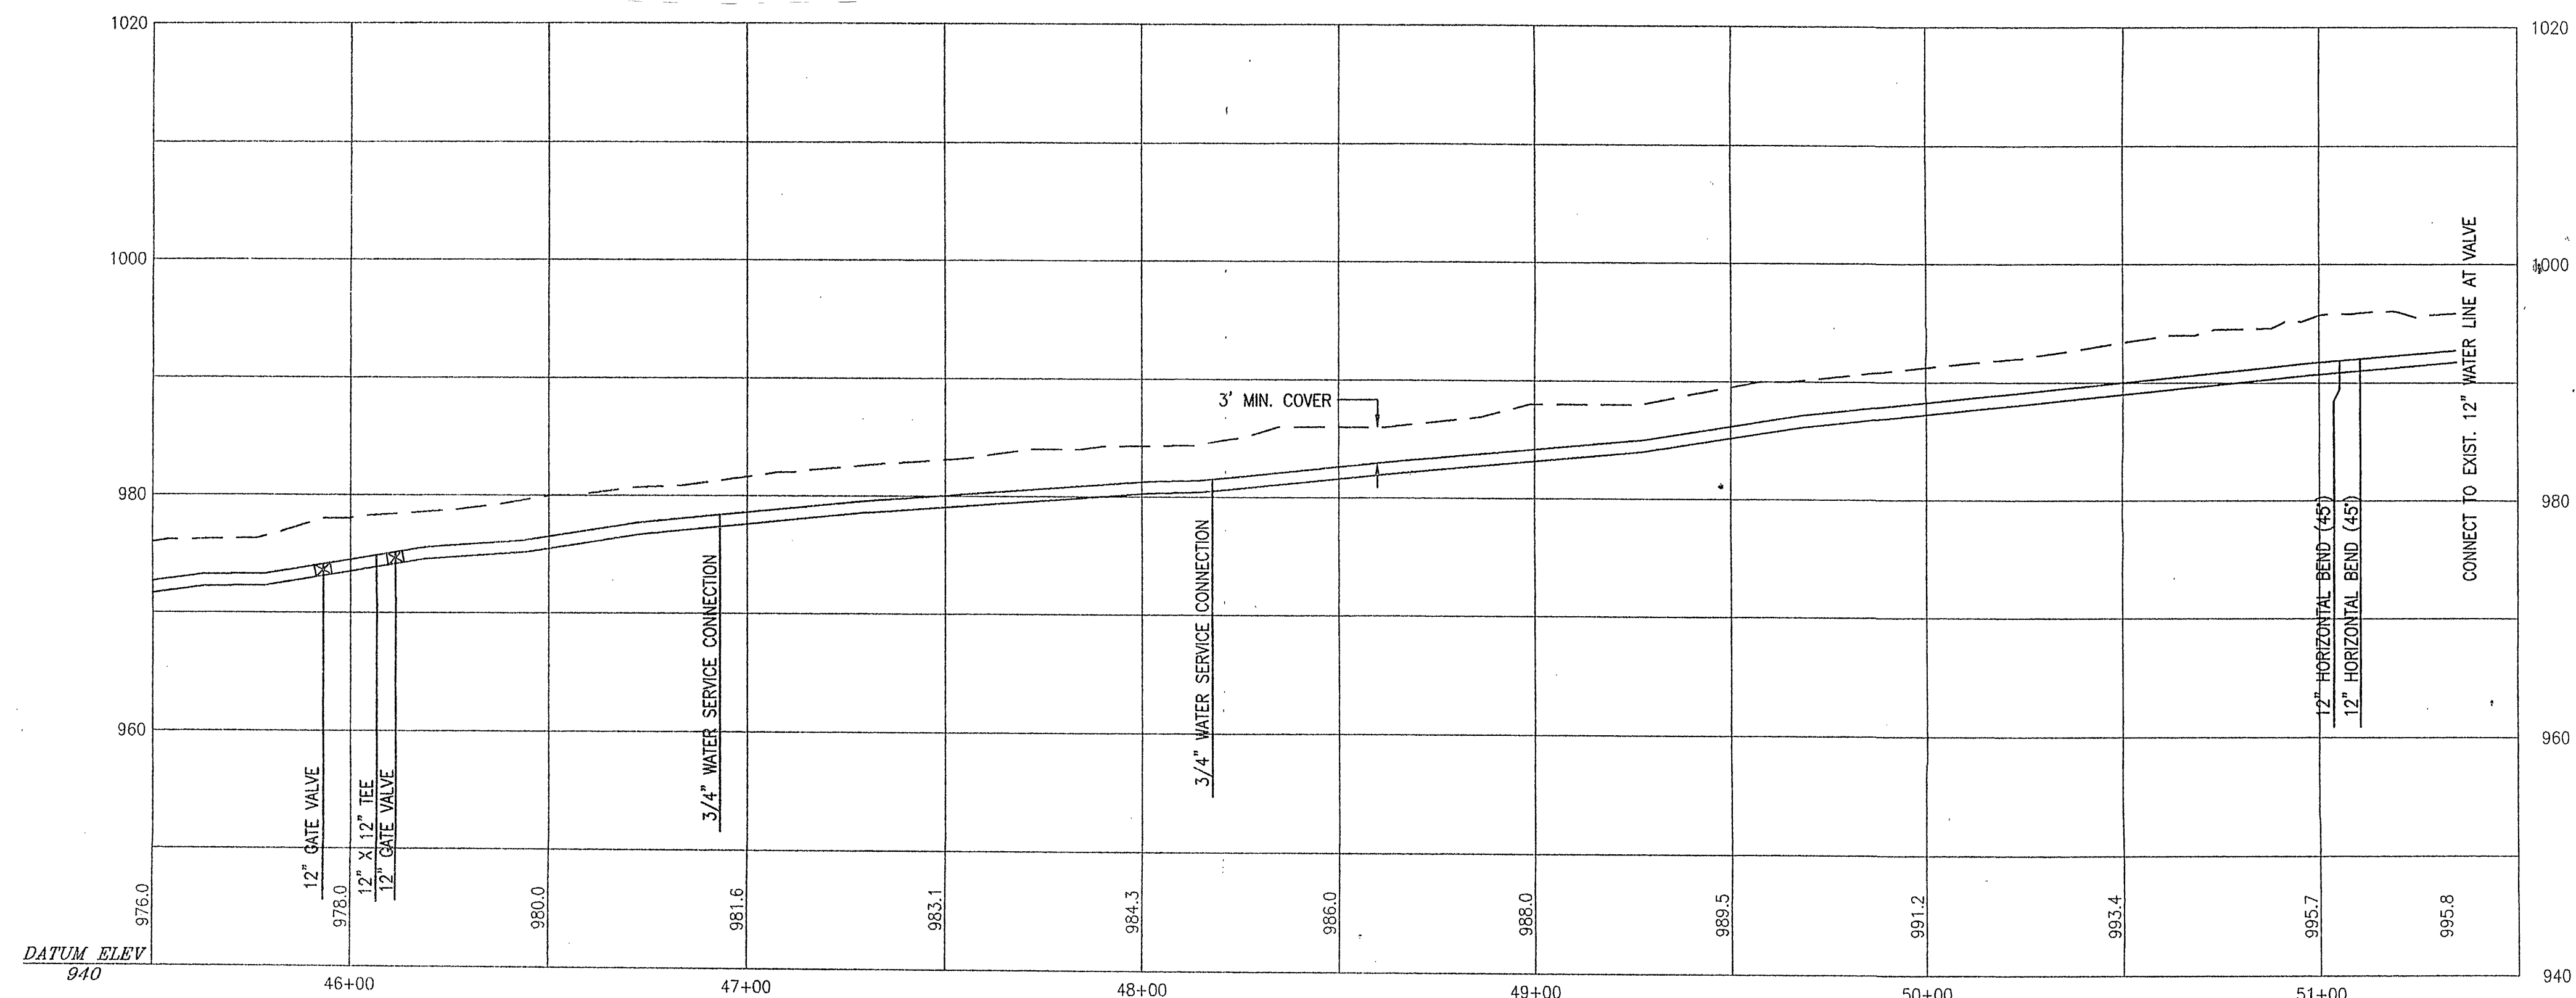


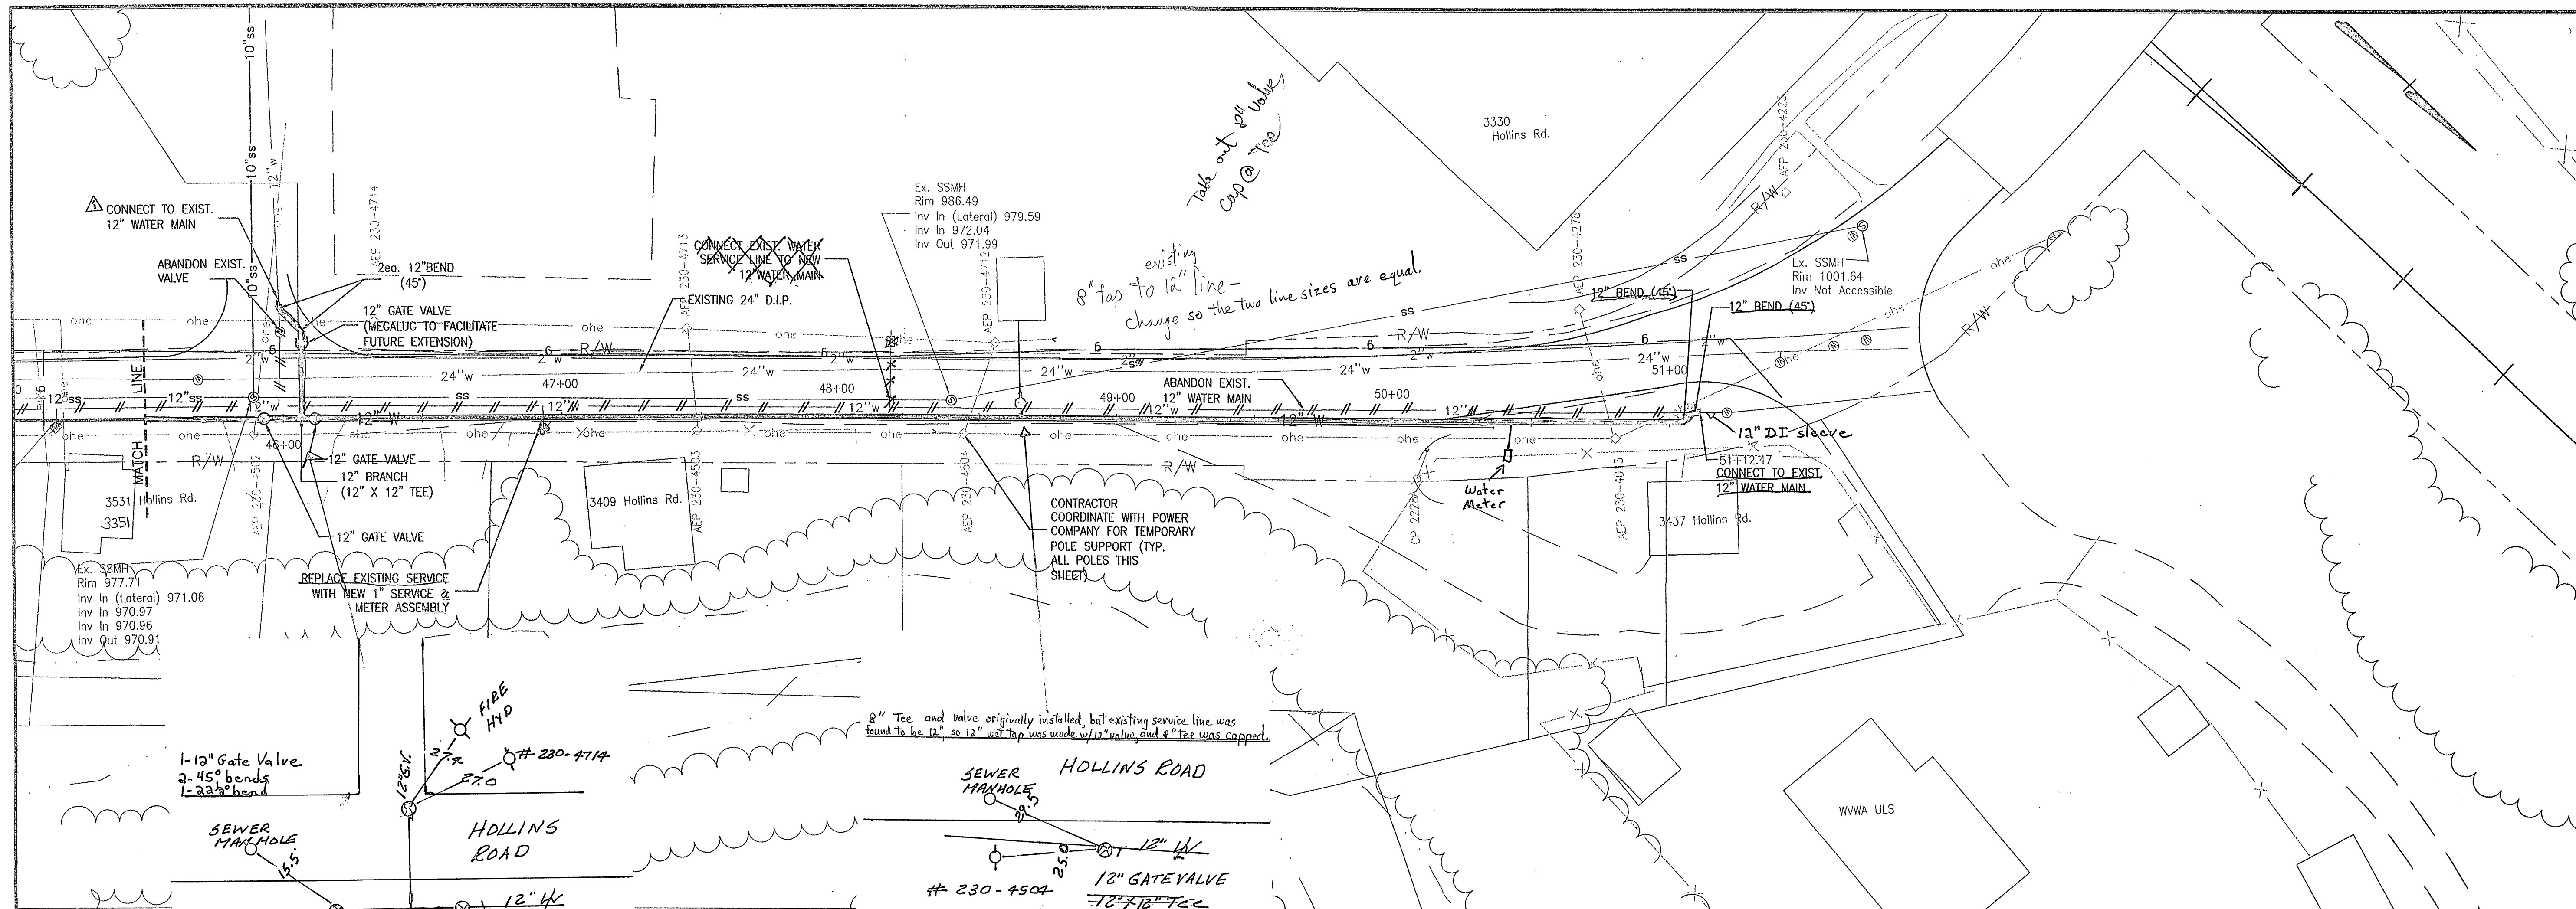


⚠ Dry connection to existing water line. Coordinate all water outages with WWA construction inspector.

⚠ All abandoned valves shall have vaults removed prior to backfill.

ENGINEERING SERVICES

601 SOUTH JEFFERSON STREET
ROANOKE, VIRGINIA 24011
PHONE: (540) 853-5641

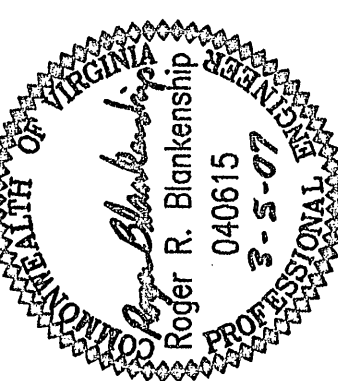

HOLLINS ROAD WATER LINE REPLACEMENT
PROJECT

Designed By:	RRB
Drawn By:	RRB
Checked By:	JCR
Date:	02/13/07
Scale:	1" = 30'
Plan #:	00-00
Sheet:	7 OF 7

Reviewed for Station
02/13/07
10:55 AM

WESTERN VIRGINIA
WATER AUTHORITY