



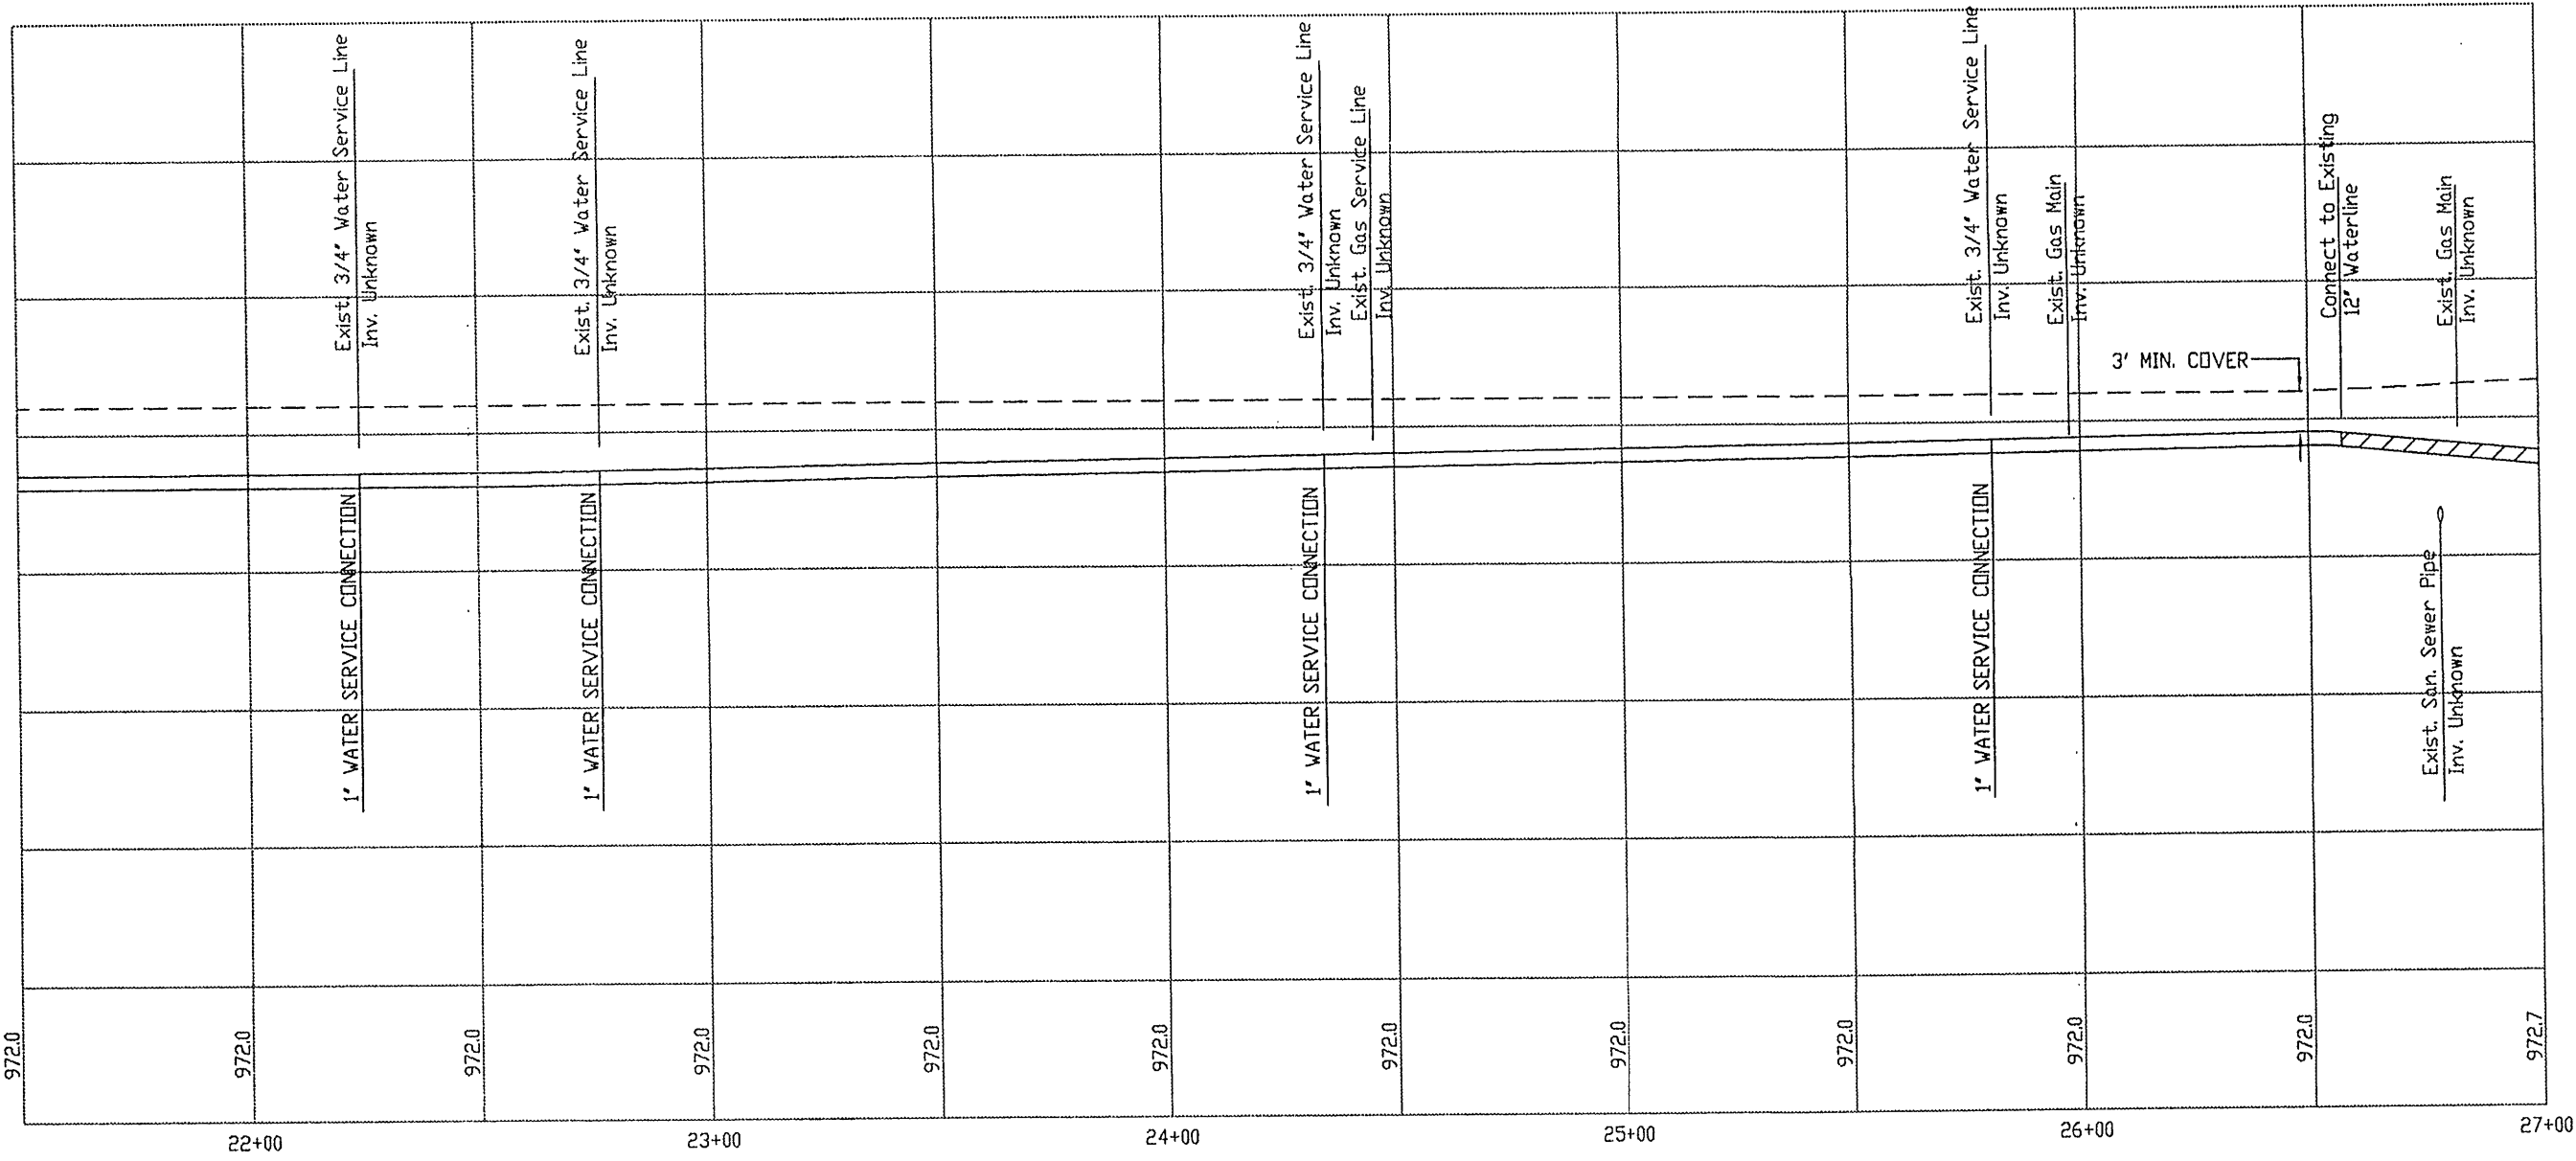


- ⚠ Dry connection to existing water line.
Coordinate all water outages with WWA construction inspector.
- ⚠ All abandoned valves shall have vaults removed prior to backfill.

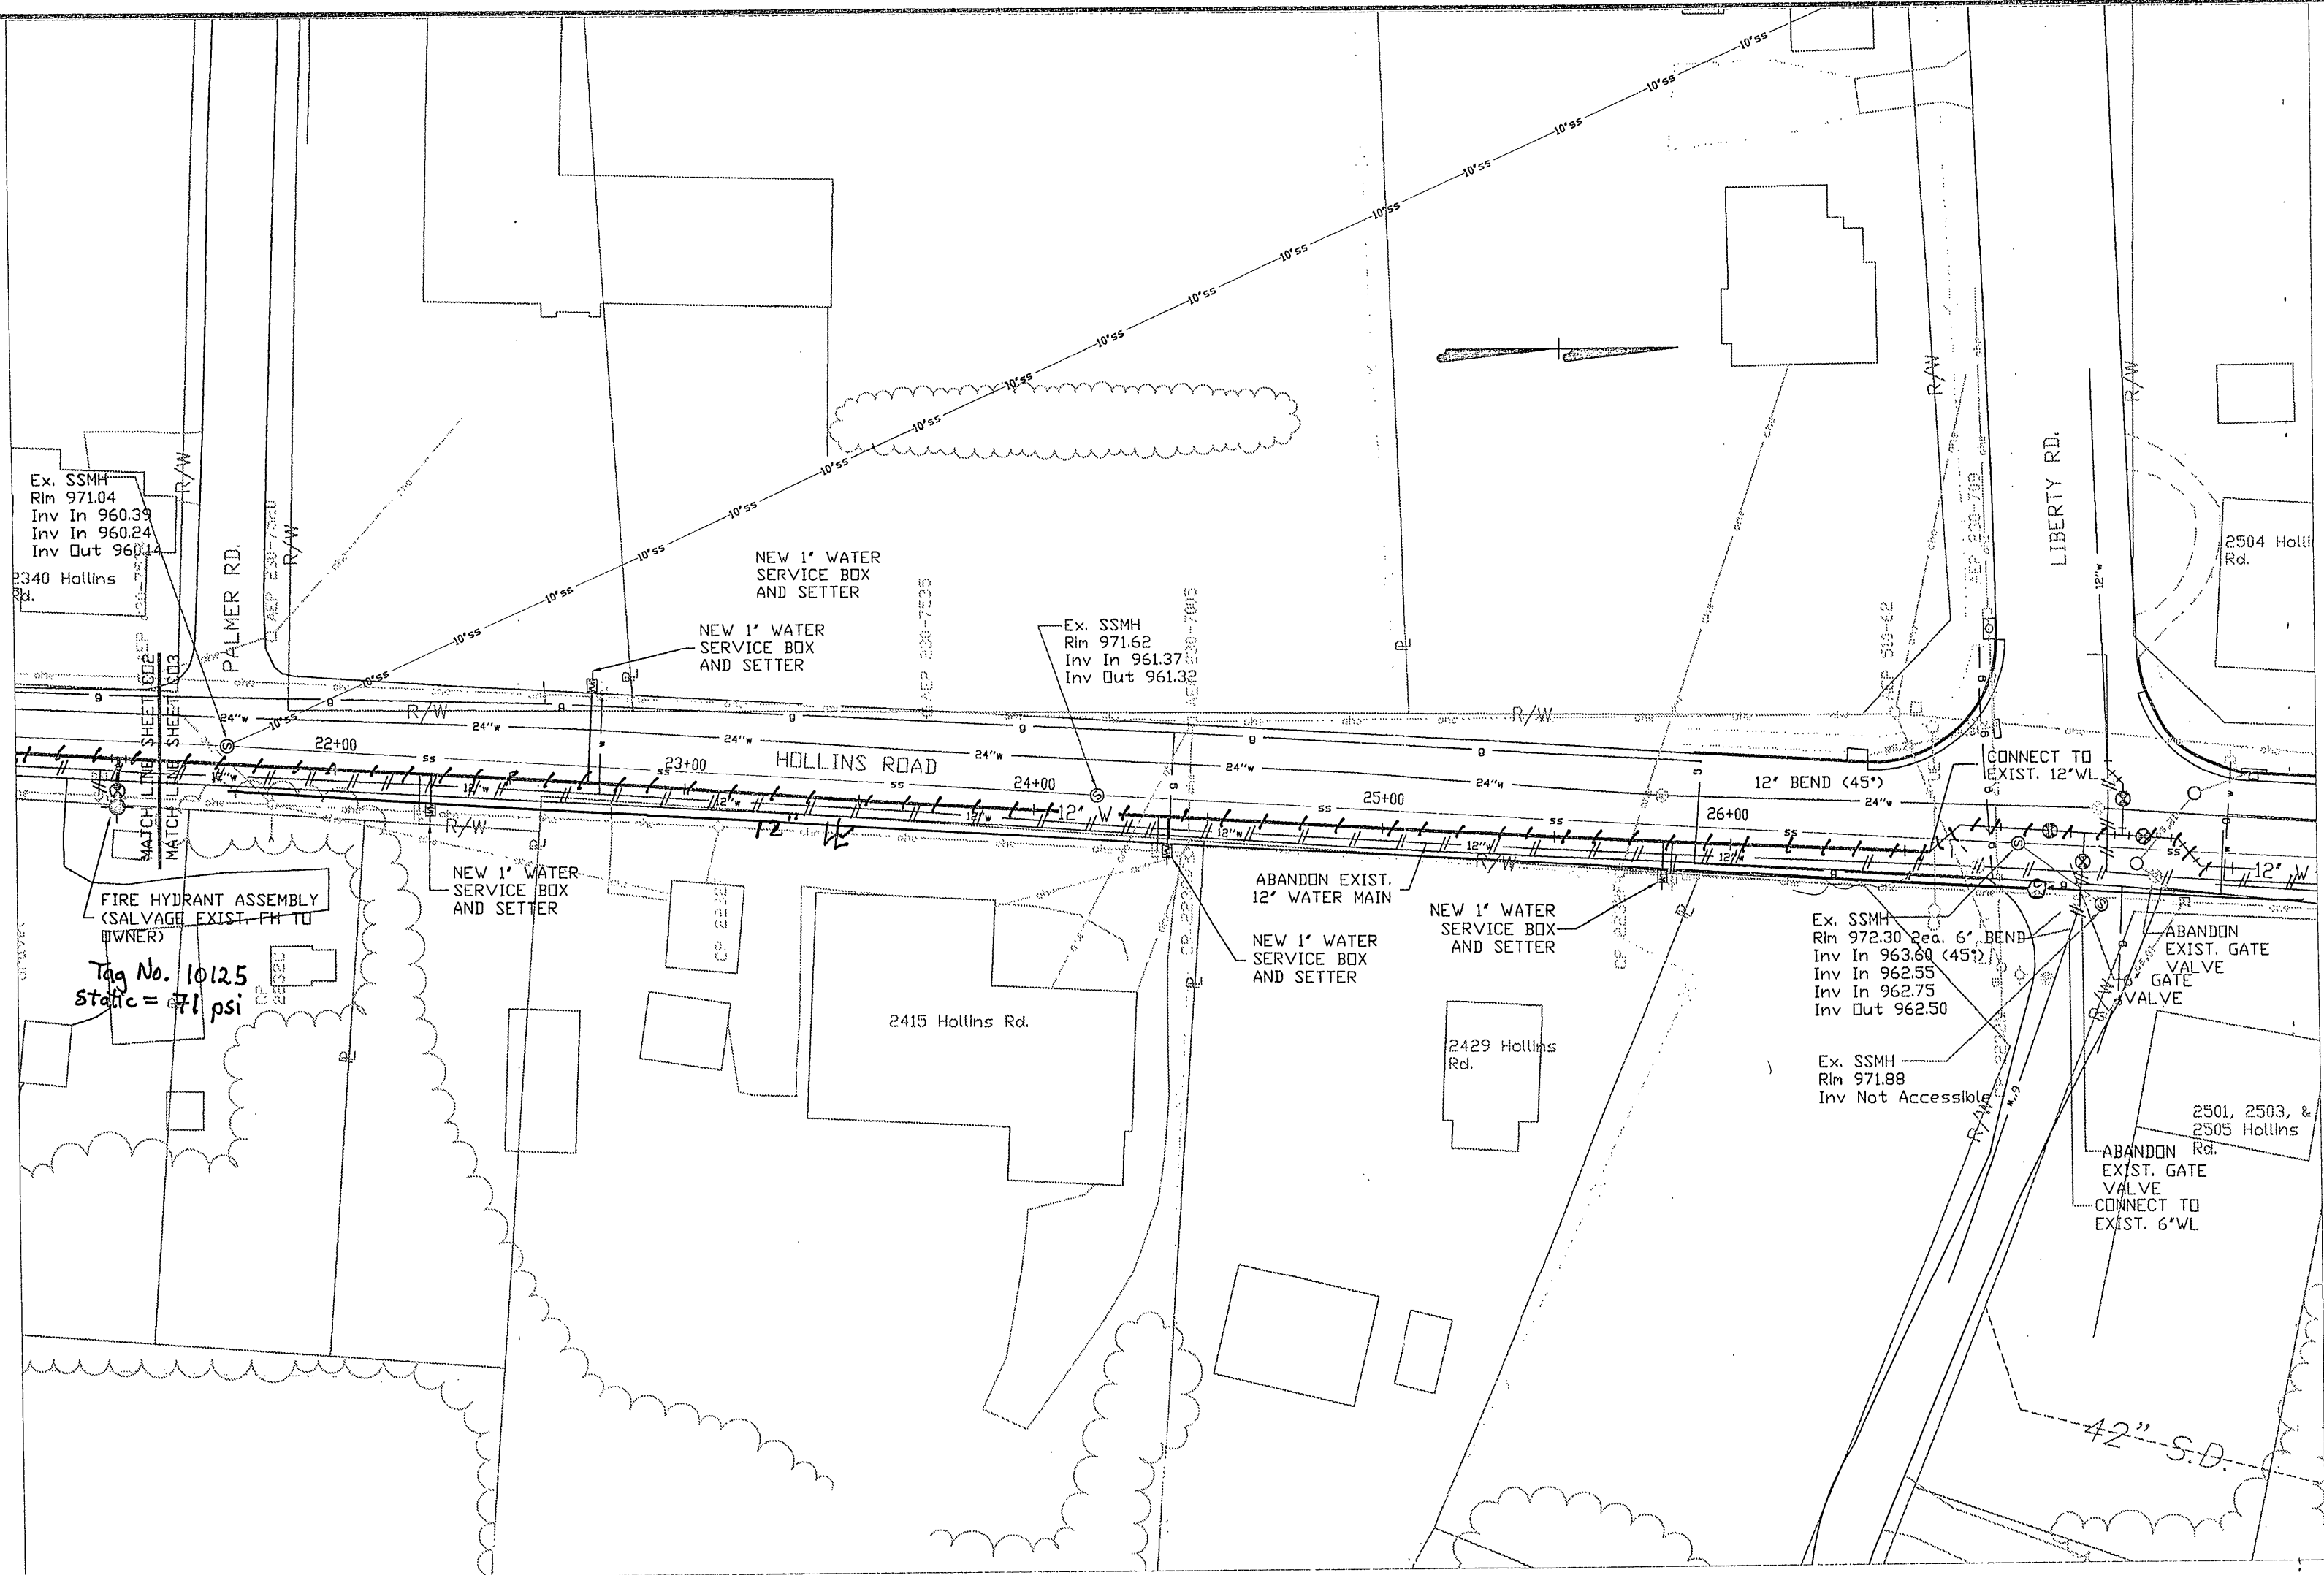

ENGINEERING SERVICES

601 SOUTH JEFFERSON STREET
ROANKE, VIRGINIA 24011
PHONE: (540) 853-5641

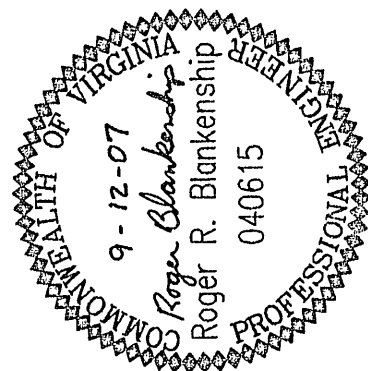

HOLLINS ROAD PHASE II
CHANGE ORDER 1 DRAWINGS

Designed By:	RRB
Drawn By:	RRB
Checked By:	JGR
Date:	08/30/07
Scale:	1" = 40'
Plan #:	00-00
Sheet:	CD 3 OF 3

