

A. L COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
1. EARRING & GRUBBING	LS		\$	\$
EXCAVATION	CY			
EMBANKMENT	CY			
FENCING	LF			
STRUCTURES				
ACCESS ROAD				
AS-BUILTS				
SUB-TOTAL				\$
10% CONTINGENCY				\$
TOTAL PROJECT COST				\$

DESIGN HIGH WATER  
12-15' STORM 10 YRS

67 C.Y./AC.  
"DRY" STORAGE

67 C.Y./AC.  
"WET" STORAGE

SEDIMENT CLEANOUT POINT  
("WET" STORAGE REDUCED  
TO 34 C.Y./ACHD)

MIN. 10'

0.5'

RISER CREST

BEHAVIORING DEVICE

CREST ELEVATION  
101.00

DESIGN ELEVATIONS WITH  
EMERGENCY SPILLWAY

DESIGN HIGH WATER (25-yr. STORM ELEV.)

MIN. 2.0'

MIN. 30°

MIN. 1.0'

67 CY./AC. "DRY" STORAGE

67 CY./AC. "WET" STORAGE

SEDIMENT CLEANOUT POINT

RISER CREST

DEWATERING DEVICE

DESIGN ELEVATIONS WITHOUT EMERGENCY SPILLWAY (BASELINE 25-yr. ELEV.)

1. DESIGN OF DETENTION BASINS SHALL CONFORM TO THE REQUIREMENTS OF THE COUNTY OF ROCKHIDE DRAINAGE STANDARDS (REF. SECTIONS 50302, 50303, AND 50502). THE DESIGN OF THE FACILITY AND PROPOSED EROSION CONTROL PLANS SHALL BE BY A CERTIFIED PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE COMMONWEALTH OF VIRGINIA.
2. ACCESS TO THE FACILITY MUST BE PROVIDED IN ACCORDANCE WITH THE COUNTY OF ROCKHIDE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
3. IF THE FACILITY IS OVER FOUR (4) FEET DEEP, EXCEEDS FOUR (2) HOURS TO BRAIN OR THE INTERIOR SLIP, TAKES 3 GPH (1 CV), PERMANENT FENCING MAY BE REQUIRED. ADDITIONALLY, IF THE FACILITY IS IN A CONGESTED AREA OR WILL IN ANY WAY POSE A HAZARD TO THE GENERAL PUBLIC, FENCING WILL BE REQUIRED. FENCING SHALL BE A MINIMUM OF SIX (6) FEET HIGH, A MINIMUM OF STANDARD NINE GAUGE LINE GAGES, AND MUST HAVE ONE OR MORE LOCKING DOUBLE GATES MINIMUM TEN FEET WIDE FOR ACCESS.
4. DETENTION PONDS SHALL BE BONDED IN ACCORDANCE WITH THE ROCKHIDE COUNTY BONDING POLICY FOR SUBDIVISION AND SITE DEVELOPMENT. A SURETY BOND FOR THE DETENTION FACILITY WILL BE REQUIRED AND ADMINISTERED APART FROM THE SUBDIVISION DEVELOPMENT BOND. REFERENCE ESTIMATE - THIS SHEET
5. REFERENCE THE COUNTY OF ROCKHIDE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION, FOR ACCEPTANCE AND MAINTENANCE OF THE FACILITY. CERTIFIED AS-BUILT'S ARE REQUIRED AND MUST INCLUDE:
  - A. DIMENSIONS OF THE FACILITY
  - B. VOLUME & MAXIMUM DEPTH
  - C. ELEVATIONS OF STRUCTURES, SPILLWAYS, AND TOP
  - D. MATERIALS VERIFICATION INCLUDING RESULTS OF DENSITY TESTS CONDUCTED BY AN INDEPENDENT SOIL TESTING LABORATORY
  - E. LOCATION AND ELEVATION OF BENCHMARK
6. ONE FOOT MINIMUM FREEBOARD REQUIRED FOR THE 100 YR WATER SURFACE ELEVATION.

1. SITE PREPARATION SHALL BE IN ACCORDANCE WITH THE COUNTY OF RANDOLPH DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION POND/LATEST EDITION.
2. SLOPES STEEPER THAN 3 TO 1 HORIZONTAL TO VERTICAL SHALL BE BENCHED OR STEPPED PRIOR TO PLACING FILL ON THEM.
3. ON-SITE FILL MATERIAL OR BORROW FILL MATERIAL MAY BE UTILIZED. FILL MATERIAL, IN GENERAL:
  - A. SHALL BE COMPACTABLE.
  - B. SHALL BE WITHIN AN ACCEPTABLE RANGE OF MOISTURE CONTENT WHICH IS READILY CONTROLLABLE.
  - C. SHALL BE HIGHLY SUSCEPTIBLE TO VOLUME CHANGE (SHRINKAGE OR SWELL) OR SETTLEMENT.
4. FILL MATERIALS CONTAINING ROCKS LARGER THAN SIX (6) INCHES (62.5 CM) SHALL NOT BE USED. THE UPPOREST TWO (2) FEET (61 CM) SHALL NOT HAVE ANY ROCK LARGER THAN TWO (2) INCHES (51 CM) IN DIAMETER.
5. THE APPROVED FILL SHALL BE PLACED IN EIGHT (8) INCH (20 CM) LIFTS/ LIFTS. EACH LIFT SHALL BE SPREAD IN UNIFORM LAYERS. FILL SOIL SHALL BE UTILIZED ONLY WITHIN A MOISTURE RANGE OF +/- 5% OF THE OPTIMUM MOISTURE CONTENT. COMPACTION OF THE FILL SHALL BE PERFORMED WITH APPROVED EQUIPMENT. COMPACTION OF THE LAYERS SHALL BE CONTINUOUS AND UNIFORM.
6. ENHANCEMENT MATERIAL, IN FILL AREAS SHALL BE PLACED IN LIFTS NOT EXCEEDING EIGHT (8) INCHES AND SHALL BE COMPACTED TO A MINIMUM 90% DENSITY IN ACCORDANCE WITH SECTION 503 OF THE VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
7. FIELD DENSITY TESTS ARE TO BE CONDUCTED BY AN INDEPENDENT SOILS TESTING LABORATORY UNDER THE DIRECTION OF A QUALIFIED PROFESSIONAL ENGINEER. THE RESULTS OF THESE TESTS SHALL BE SUBMITTED TO THE COUNTY OF RANDOLPH WITH AS-BUILT PLANS AS A CONDITION OF THE ACCEPTANCE OF THE FACILITY BY THE COUNTY. FIELD DENSITY TESTS, AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED PERIODICALLY TO DETERMINE THE REQUIRED DEGREE OF COMPACTION. FAILURE TO MEET THE DENSITY REQUIREMENTS SHALL BE REVOKED AND/OR RECOMPACTED UNTIL THE REQUIRED DEGREE OF COMPACTION IS ACHIEVED.
8. ANTI-SEEP COLLARS SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
9. ALL DISTURBED AREAS SHALL BE COVERED WITH FOUR (4) INCHES (10 CM) TOPSOIL AND SEEDS.
10. THE MINIMUM SLOPE OF THE BRUSH "FLOOR" SHALL BE ONE (1) PERCENT.

This method of inlet protection is applicable where heavy flows are expected and where an overflow capability and ease of maintenance are desirable.

1	ENGR. & INSPEC.	04-10-93
2	ENGR. & INSPEC.	08-05-93
3	ENGR. & INSPEC.	10-27-93
4		
5		
6		
NO.	REVISIONS	DATE

2 ACRES OR LESS OF DRAINAGE AREA

2-10 ACRES OF DRAINAGE AREA

FILTER CLOTH (OPTIONAL)

COODSTREAM VIEW

VOID #1

COARSE AGGREGATE

FLOW

CLASS 1 R2090A

(CD) ROCK CHECK DAM

[illegible]

The diagram illustrates the internal structure and operation of a settling tank. Key components and labels include:

- SEDIMENT-LADEN RUNOFF**: Indicated by arrows at the top left, showing the input of water containing sediment.
- REQUIRED**: A label pointing to the water surface area.
- DEPTH BELOW TOP OF INLET**: A label pointing to the vertical distance from the water surface to the top of the inlet structure.
- MAX 1'-MAX 2'**: A label indicating the maximum depth of the water column above the inlet.
- MAX. SLOPE 0:1**: A label pointing to the sloped side of the tank's internal structure.
- WEEP HOLE**: A label pointing to a small opening in the side of the tank.
- THE**: A label pointing to the central settling area.
- SKIMMING**: A label pointing to the top surface of the tank where floating materials are collected.
- LARGER PARTICLES WILL SETTLE**: A label pointing to the bottom of the tank where heavier solids accumulate.
- STORM WATER WITH LARGER PARTICLES REMOVED**: A label pointing to the outlet at the bottom left, showing the removal of settled solids.
- DRAIN INLET**: A label pointing to the bottom left corner where water and sediment exit.

12"

WIRE MESH  
FILTERED WATER

CURB INLET

TEMPORARY RIGHT-OF-WAY DIVERSION

DIVERSION

Filter Fabric

Wire

Post

Extend Fabric and Wire Into Trench

Diagram illustrating the construction of a silt flow wall. The wall is shown in cross-section, with a silt flow area indicated by a hatched pattern. The wall is labeled "CONSTRUCTION OF A SILT FLOW" and has dimensions 12' 0" and 6' 0". The silt flow area is labeled "FLOW" and has a dimension of 4".

FLARE OF DRAIN

360°

Plan

Section A-A

Section B-B

Pipe Outlet To Flat Area With No Defined Channel

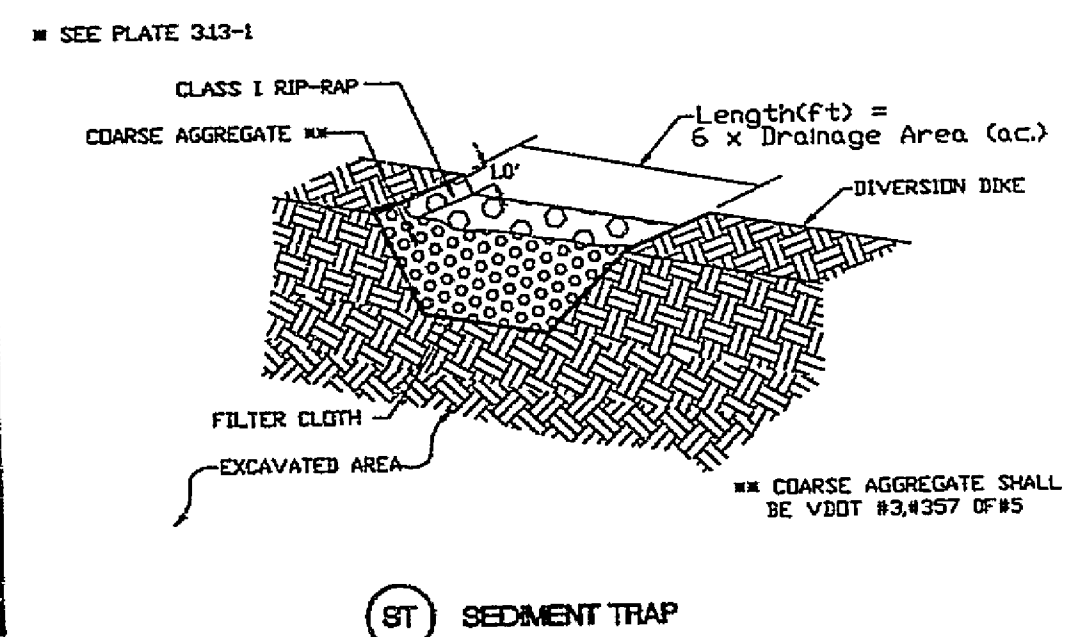
Pipe Outlet With Defined Channel

LARGER PARTICLES WILL SETTLE

OUTLET PROTECTION

NOTES

1. Apron length may be the radius of the grouted apron or
2.  $L_a$  is the length of
  - a. pipe apron as circular plates, 135d and 136d

[illegible]

ALL COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CONSTRUCTION ENTRANCE	EA	1	\$ 500	\$ 500
SILT FENCE	LF	1000	1.50	1500
INLET PROTECTION	EA	1	100	100
TEMPORARY DIVERSION DIKE	LF			
TEMPORARY FILL DIVERSION	LF			
SEDIMENT TRAP	EA			
CHECK DAM	EA			
PERMANENT SEEDING	1000 SF	4	75	300
OUTLET PROTECTION	EA	1	100	100
SEDIMENT BASIN	EA			
SUB-TOTAL				\$ 2500
10% CONTINGENCY				\$ 250
TOTAL PROJECT COST				\$ 2750

1. ALL SOIL EROSION & SEDIMENT CONTROL MEASURES SHALL BE ACCOMPLISHED IN STRICT ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
2. THE APPROVING AUTHORITY MAY ADD TO, DELETE, RELOCATE, CHANGE OR, OTHERWISE MODIFY CERTAIN EROSION AND SEDIMENT CONTROL MEASURES WHERE FIELD CONDITIONS ARE SUCH THAT THEY ARE NECESSARY FOR PROTECTION WHERE FIELD CONDITIONS ARE SUCH THAT THEY ARE NECESSARY FOR PROTECTION.
3. ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLAN SHALL BE PLACED IN ADVANCE OF THE WORK BEING PERFORMED, AS FAR AS PRACTICAL.
4. IN NO CASE DURING CONSTRUCTION SHALL WATER RUNOFF BE DIVERTED OR ALLOWED TO FLOW TO LOCATIONS WHERE ADEQUATE PROTECTION HAS NOT BEEN PROVIDED.
5. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LEAVE THE SITE ADEQUATELY PROTECTED AGAINST EROSION, SEDIMENTATION, OR ANY DAMAGE TO (Y) ADJACENT PROPERTY AT THE END OF EACH DAY'S WORK.
6. FOR THE EROSION CONTROL KEY SCHEDULE SHOWN ON THE PLANS, REFER TO THE "UNIFORM EROSION CONTROL SYSTEM FOR EROSION AND SEDIMENT CONTROL PRACTICES" CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. THESE SYMBOLS AND SCHEDULES ARE TO BE UTILIZED ON ALL EROSION CONTROL MEASURES LIMITED TO ROCKY MOUNTAIN COUNTY.

TYPE A	TYPE B (CLOPDS 3d OR STEEP)
IS OCTOBER TO 1 FEBRUARY K-31 FESCUE @ 5 LB / 1000 SF BURY WINTER RYE 1/2 LB / 1000 SF	15 MARCH TO 1 MAY CROWN VETCH @ 1/2 LB / 1000 SF PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF RED TOP @ 1/4 LB / 1000 SF
1 FEBRUARY TO 1 JUNE K-31 FESCUE @ 5 LB / 1000 SF ANNUAL RYE 1/2 LB / 1000 SF	15 AUGUST TO 1 OCTOBER CROWN VETCH @ 1/2 LB / 1000 SF PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF RED TOP @ 1/4 LB / 1000 SF
1 JUNE TO 1 SEPTEMBER K-31 FESCUE @ 5 LB / 1000 SF GERMAN HILLET @ 1/2 LB / 1000 SF	
1 SEPTEMBER TO 15 OCTOBER K-31 FESCUE @ 5 LB / 1000 SF ANNUAL RYE 1/2 LB / 1000 SF	
LIME: 50-80-0 @ 25 LB / 1000 SF FERTILIZER: 38-0-0 @ 7 LB / 1000 SF	15% VERIFIED AGRICULTURAL LIMESTONE
MULCH: IF REQUIRED, SHALL BE USED OVER ALL SEEDED AREAS AND SHALL BE APPLIED IN ACCORDANCE WITH SECTION 1.75 OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK LATEST EDITION.	
SOIL CONDITIONING: INCORPORATION OF LIME AND FERTILIZER, SELECTION OF CERTIFIED SEED, MULCHING, MAINTENANCE OF NEW SEEDLINGS AND RESEEDING SHALL BE IN ACCORDANCE WITH SPECIFICATIONS CONTAINED WITHIN THE VIRGINIA SOIL EROSION AND SEDIMENT CONTROL HANDBOOK LATEST EDITION. ANNUAL SEEDING TO BE PERFORMED AS REQUIRED BY THE INSPECTOR.	
SEED APPLICATION: APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, COUNTERPAK SEEDER, OR HYDROSEEDER IN A FIRM, FRABLE, SEEDBED. MAXIMUM SEEDING DEPTH SHALL BE 1/4 INCH.	
TOTAL DISTURBED AREA =	AC. = SQ. FT.

RC-6169

COUNTY OF ROANOKE

EROSION & SEDIMENT CONTROL  
STORMWATER MANAGEMENT DETAILS