
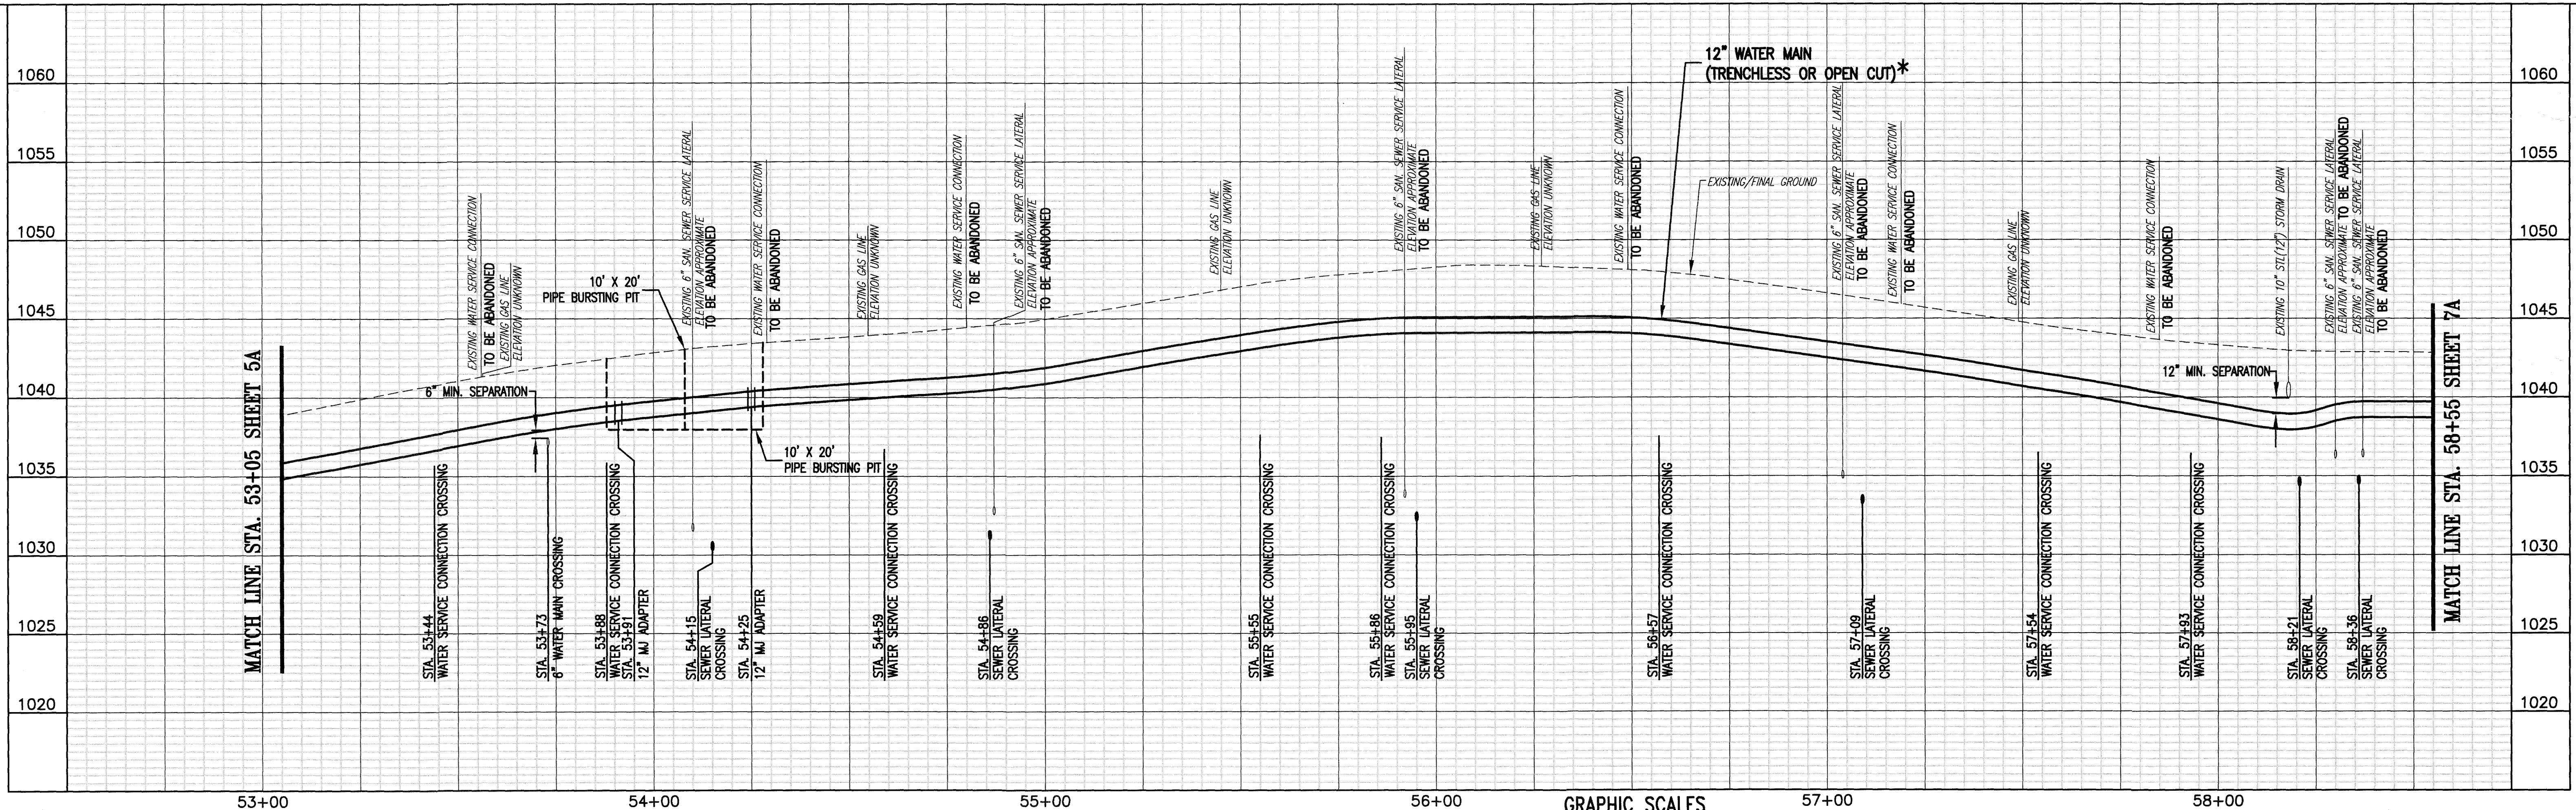


***12" WATER MAIN REPLACEMENT NOTES:**

1. AT THE CONTRACTOR'S OPTION, THE 12-INCH WATER MAIN MAY BE REPLACED BY TRENCHLESS OR OPEN CUT INSTALLATION METHODS.
2. IF PIPE BURSTING INSTALLATION IS USED, PIPE MATERIAL AND SIZE SHALL BE:
A. AWWA C906 14-INCH HDPE DR 11 INCLUDING ALL NECESSARY REDUCERS FOR CONNECTION TO EXISTING SYSTEM.
OR
B. AWWA C900 12-INCH FUSIBLE PVC DR 18.
3. IF OPEN CUT INSTALLATION IS USED, PIPE MATERIAL SHALL BE AS SPECIFIED IN THE WESTERN VIRGINIA REGIONAL DESIGN & CONSTRUCTION STANDARDS.

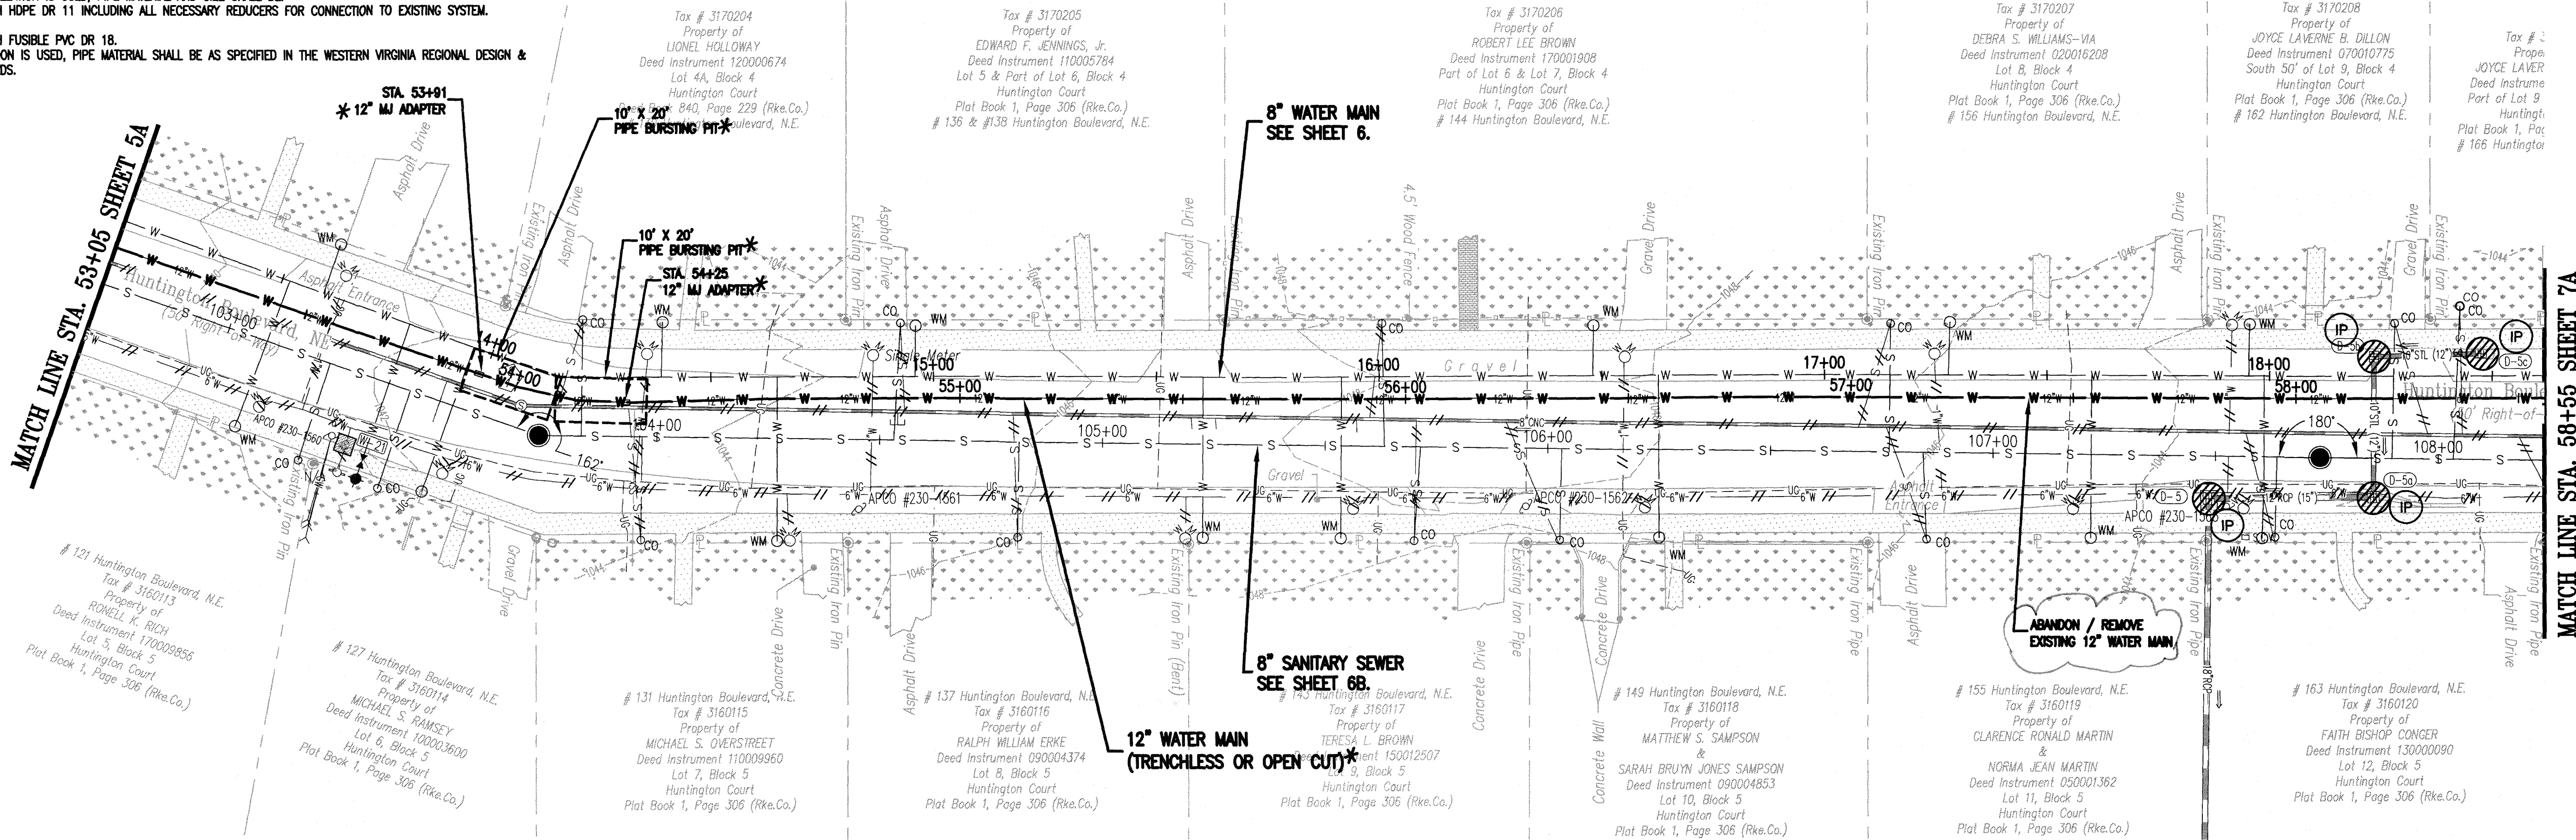

WESTERN VIRGINIA WATER AUTHORITY
601 South Jefferson Street, Suite 300
Roanoke, Virginia 24011

WRA
Whitman, Requardt & Associates, LLP
1700 Kraft Dr, Suite 1200, Blacksburg, VA 24060

DES: **PJM**
DRAWN: **JES**
CHECK: **GWP**
DATE: **6/6/18**

SCALE: **AS SHOWN**
HORIZ: **1" = 20'**
VERT: **1" = 5'**

HUNTINGTON BLVD
WATER & SEWER MAIN REPLACEMENT

12" WATER MAIN PLAN - PROFILE
STA. 53+05 TO STA. 58+55

REV	DATE	DESCRIPTION

DRAWING: **-**
SHEET: **6A**