




*12" WATER MAIN REPLACEMENT NOTES:

- AT THE CONTRACTOR'S OPTION, THE 12-INCH WATER MAIN MAY BE REPLACED BY TRENCHLESS OR OPEN CUT INSTALLATION METHODS.
- IF PIPE BURSTING INSTALLATION IS USED, PIPE MATERIAL AND SIZE SHALL BE:
A. AWWA C900 14-INCH HDPE DR 11 INCLUDING ALL NECESSARY REDUCERS FOR CONNECTION TO EXISTING SYSTEM.
OR
B. AWWA C900 12-INCH FUSIBLE PVC DR 18.
- IF OPEN CUT INSTALLATION IS USED, PIPE MATERIAL SHALL BE AS SPECIFIED IN THE WESTERN VIRGINIA REGIONAL DESIGN & CONSTRUCTION STANDARDS.

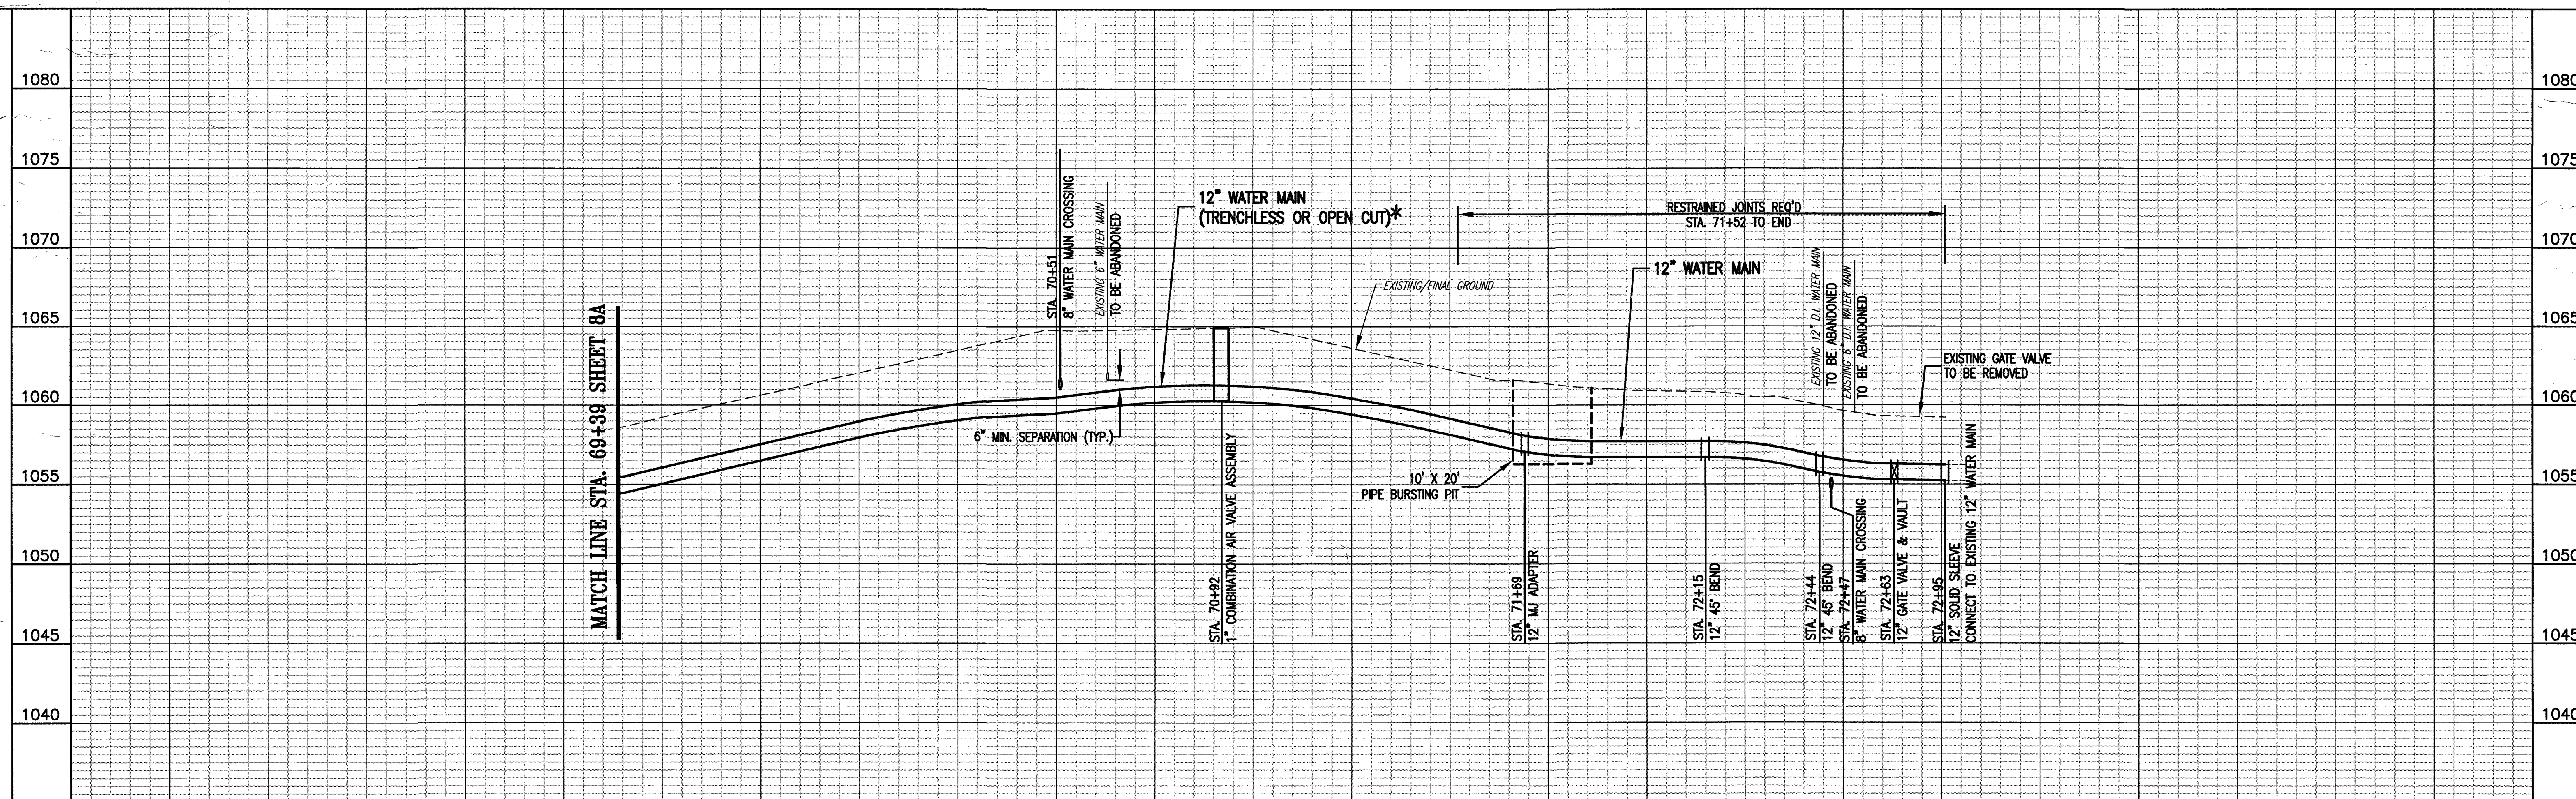

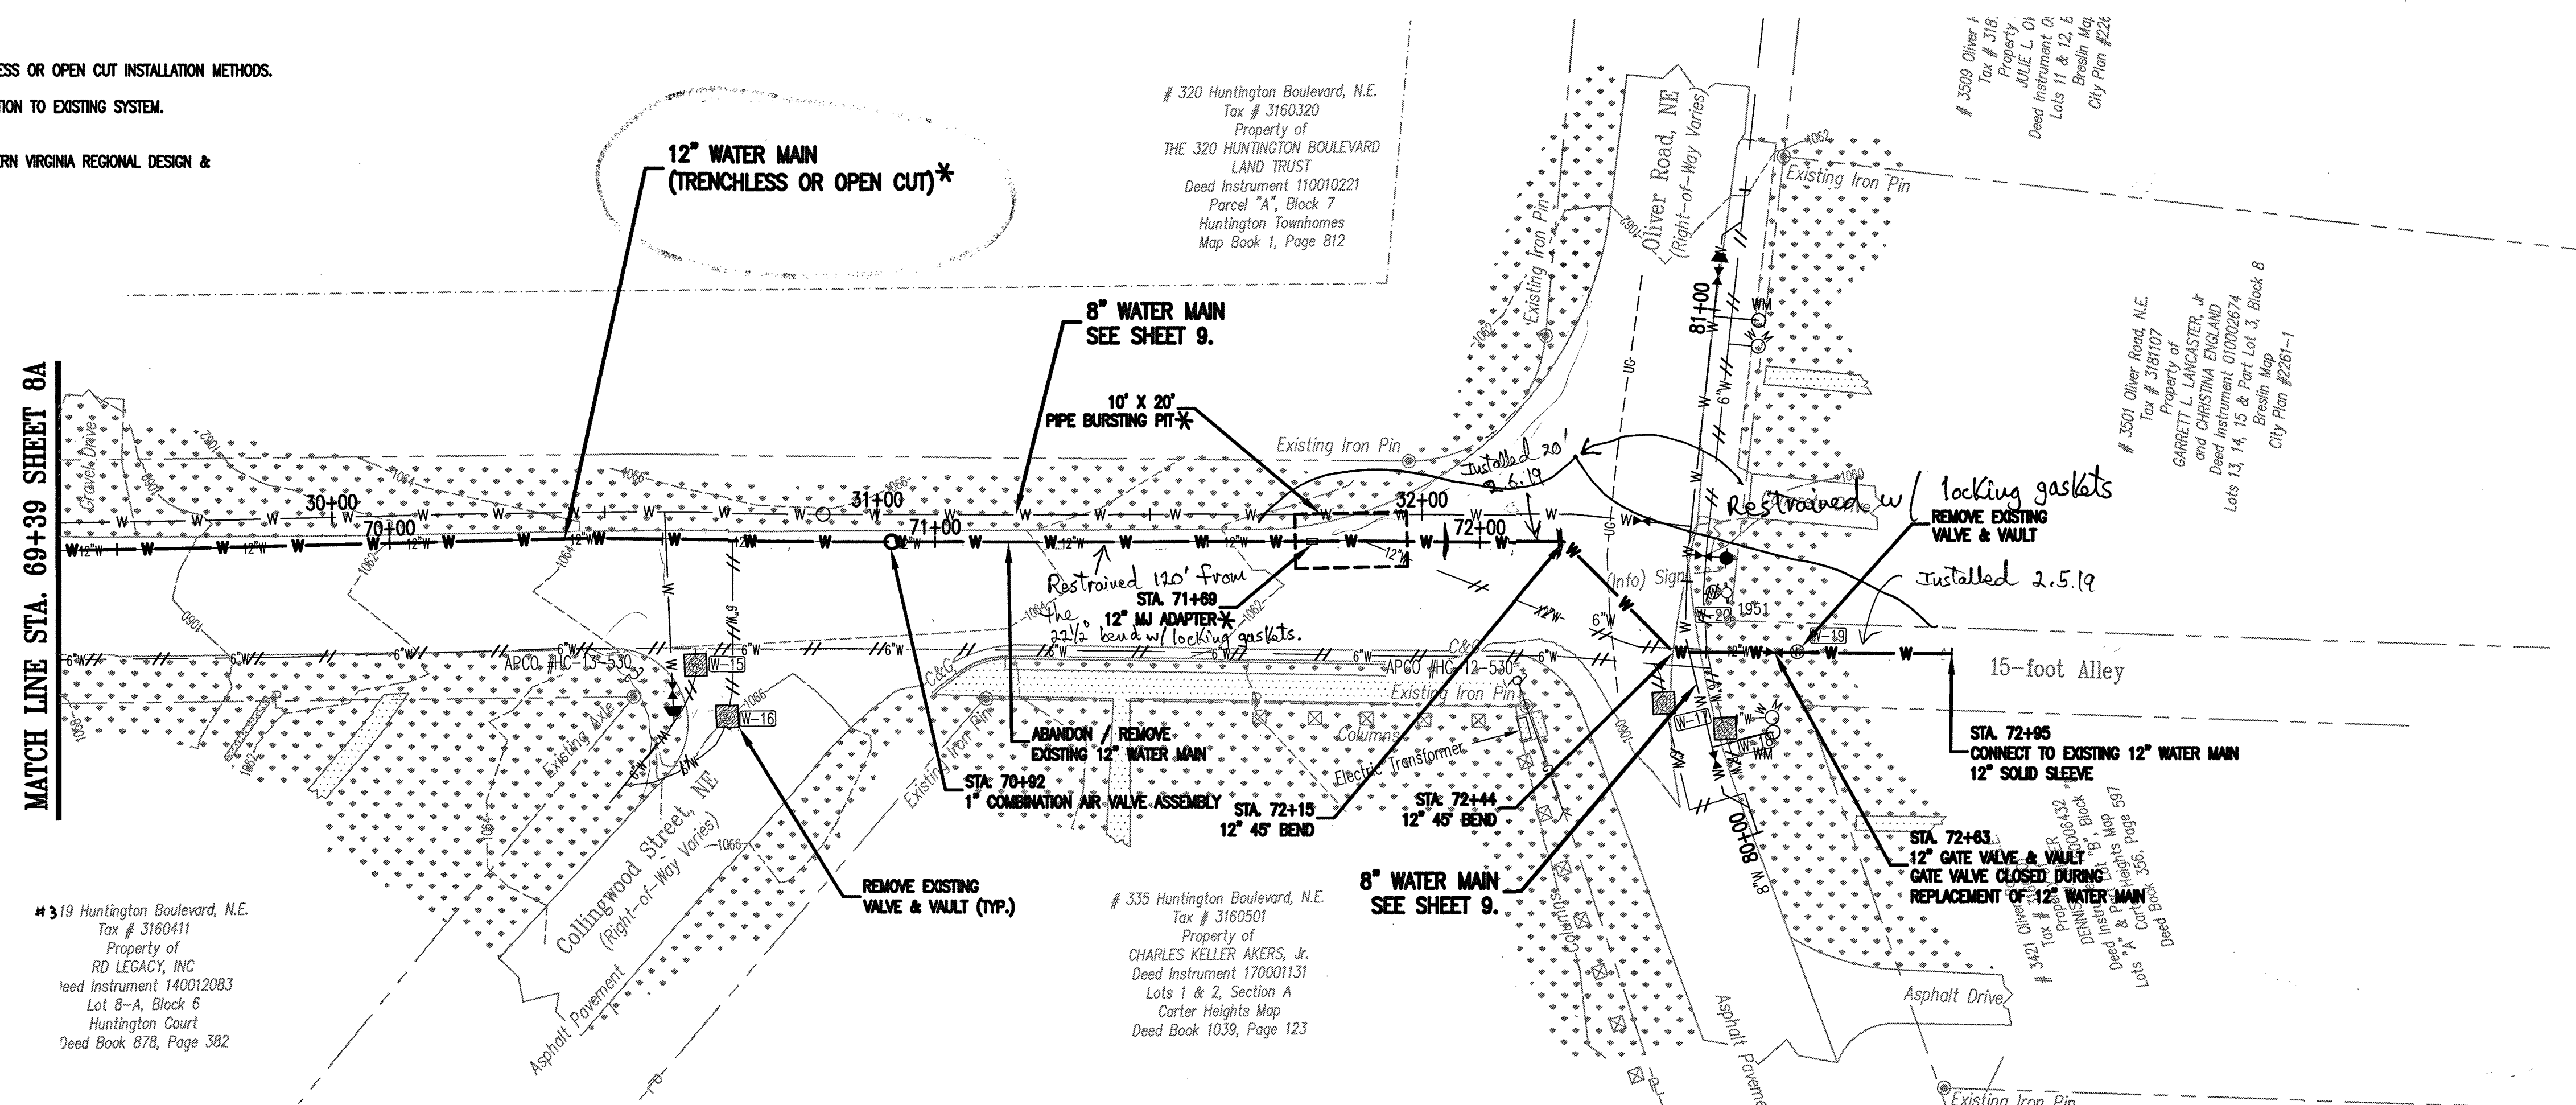

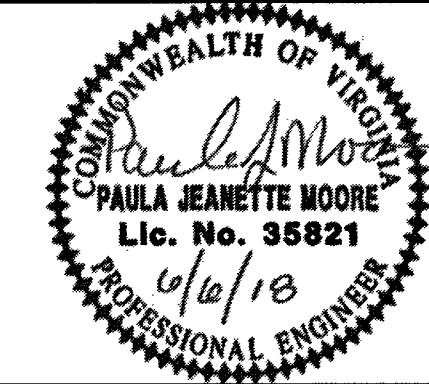

Whitman, Reardon & Associates, LLP
1700 Kraft Dr, Suite 1200, Blacksburg, VA 24060

WESTERN VIRGINIA WATER AUTHORITY
601 South Jefferson Street, Suite 300
Roanoke, Virginia 24011

DES: PJM
DRAWN: JES
CHECK: GWF
DATE: 6/6/18

SCALE: AS SHOWN
HORIZ: 1" = 20'
VERT: 1" = 5'

**HUNTINGTON BLVD
WATER & SEWER MAIN REPLACEMENT**

**12 WATER MAIN PLAN - PROFILE
STA. 69+39 TO STA. 72+95**

REV	DATE	DESCRIPTION

GRAPHIC SCALES

(IN FEET)
HORIZ. 1 inch = 20 feet

(IN FEET)
VERT. 1 inch = 5 feet

9A