


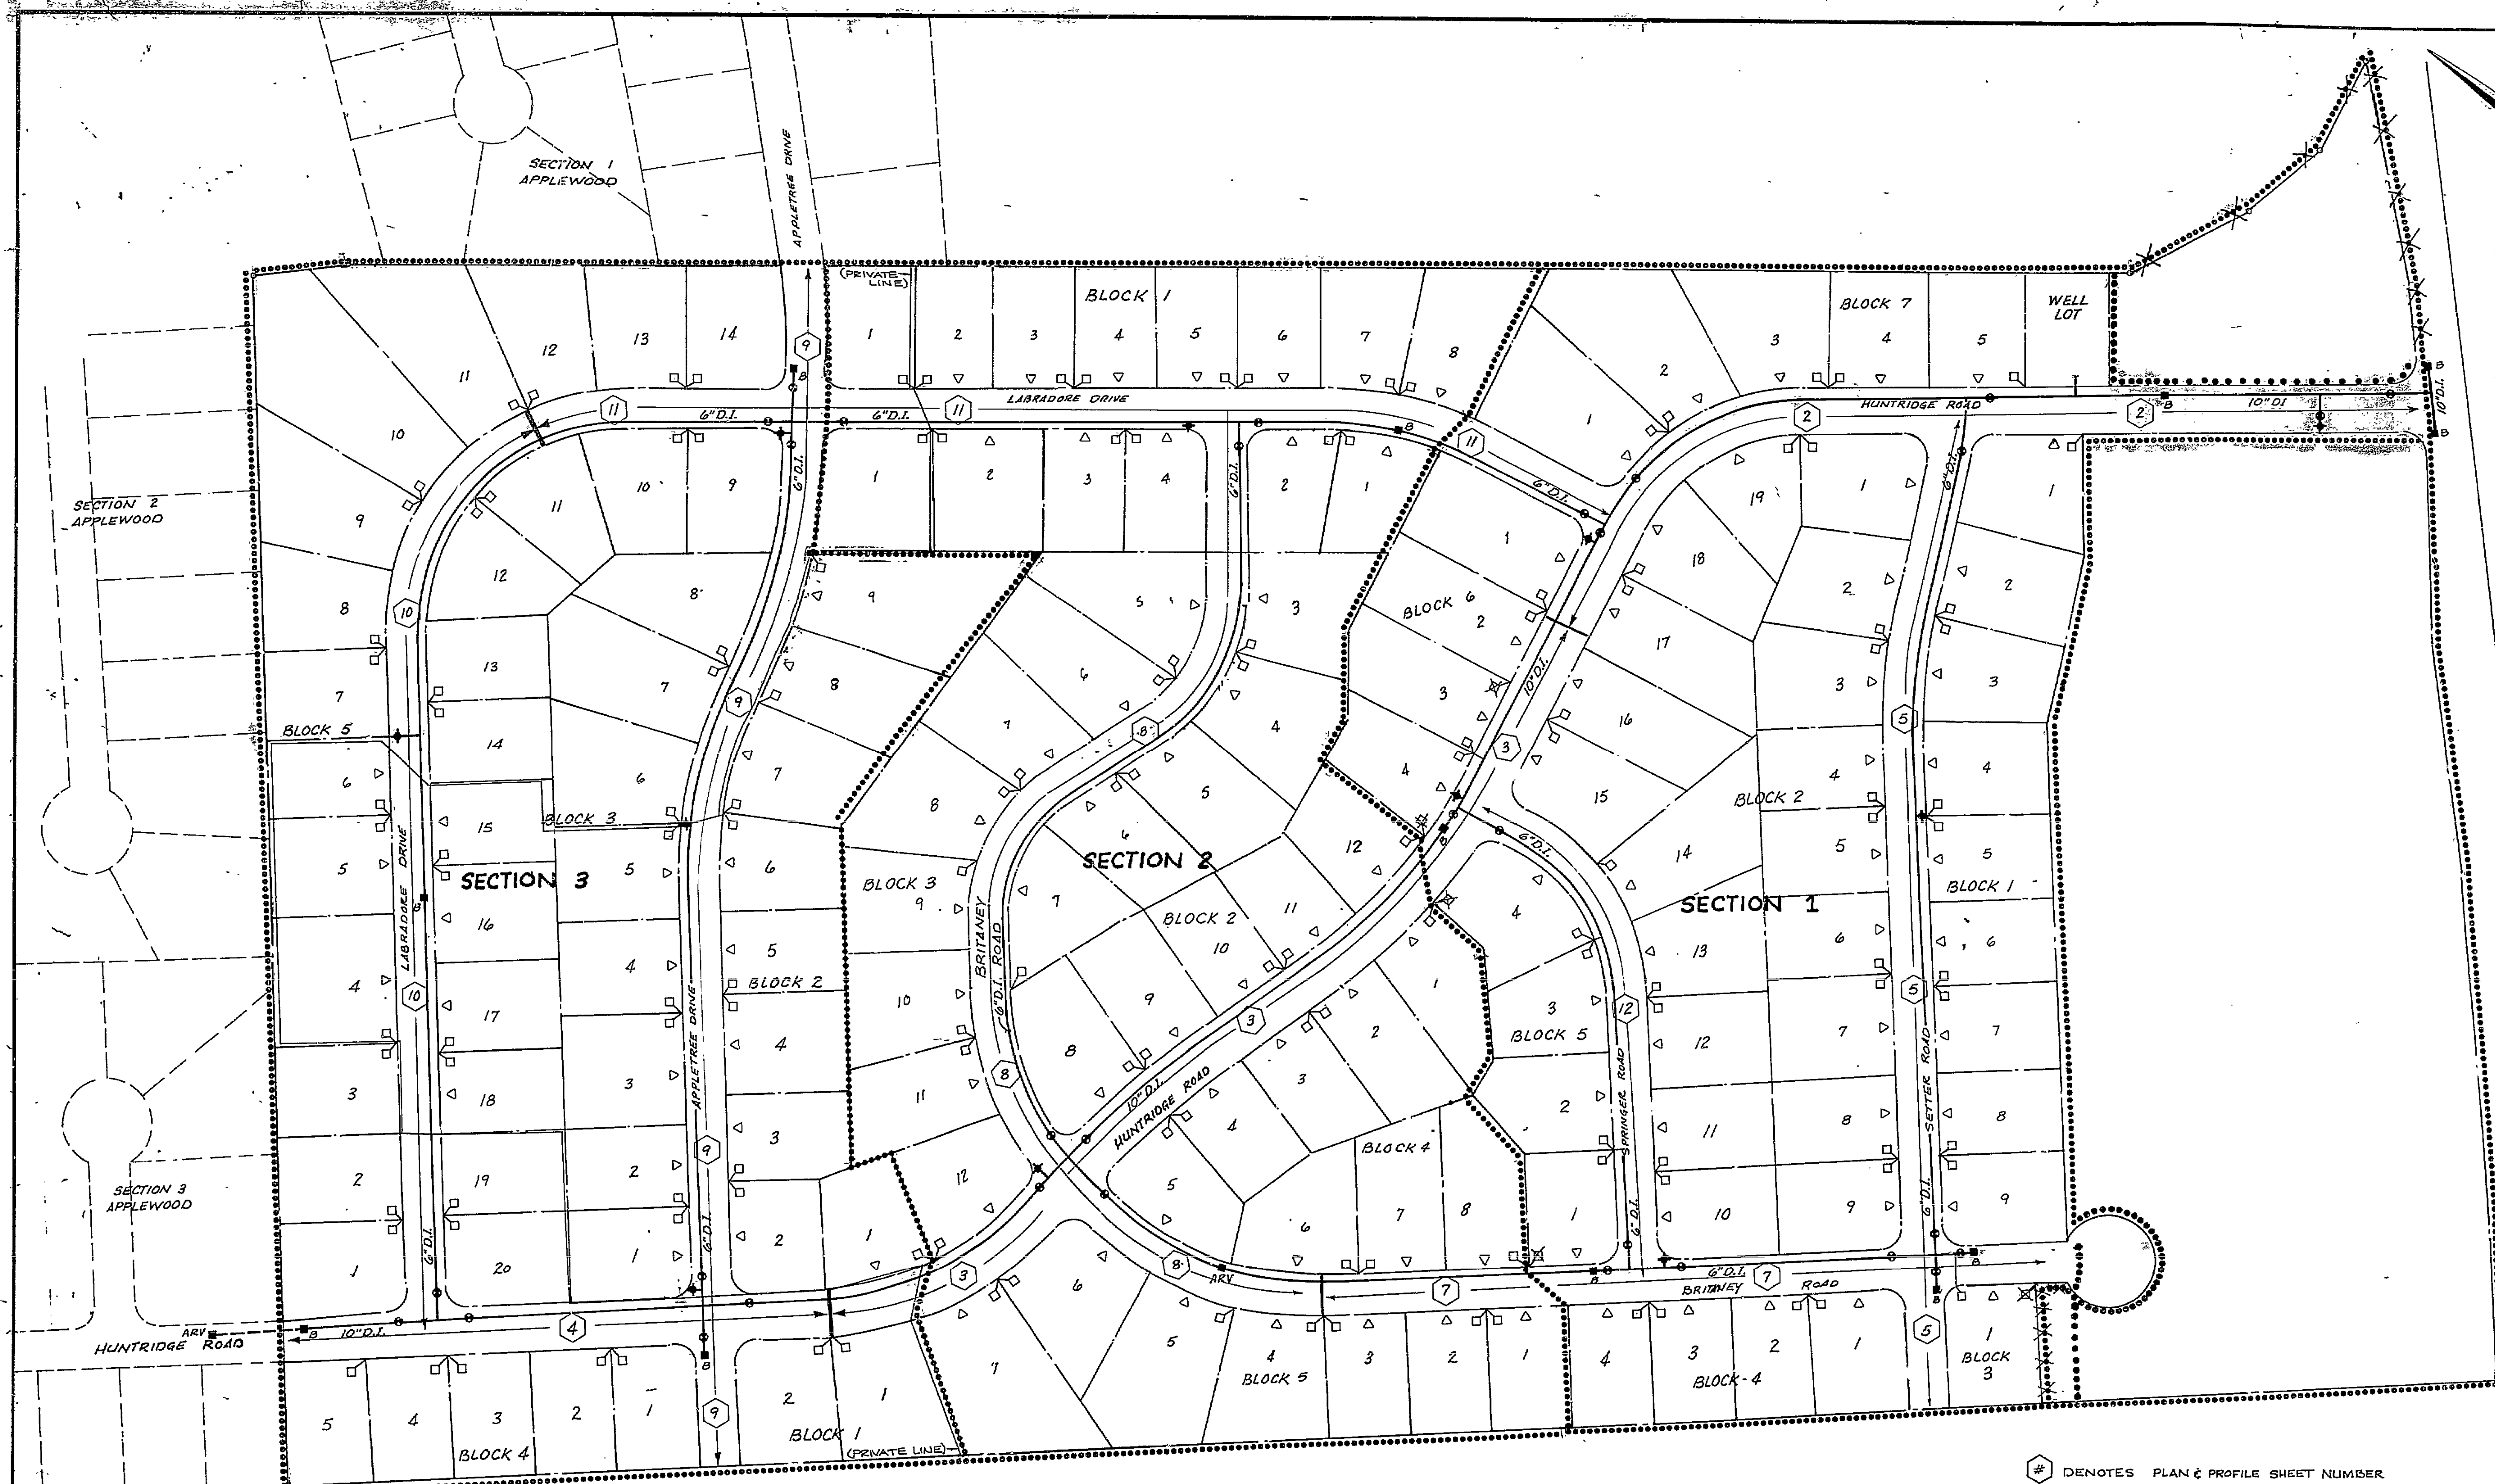


DENOTES PLAN & PROFILE SHEET NUMBER

- LEGEND**
- GATE VALVE & VALVE BOX
 - B— BLOW-OFF
 - ARV— AIR RELEASE VALVE
 - F— FIRE HYDRANT ASSEMBLY
 - DOUBLE METER CONNECTION
 - SINGLE METER CONNECTION
 - △ PRESSURE REDUCING VALVE

SCALE: 1"=100'

NOTE: IF WATER IS OBTAINED FROM APPLEWOOD SUBDIVISION STORAGE FACILITY IN LIEU OF FROM ON-SITE WELLS WITHIN HUNTRIDGE, PRESSURE REDUCING VALVES ARE REQUIRED FOR ALL LOTS WITHIN HUNTRIDGE.

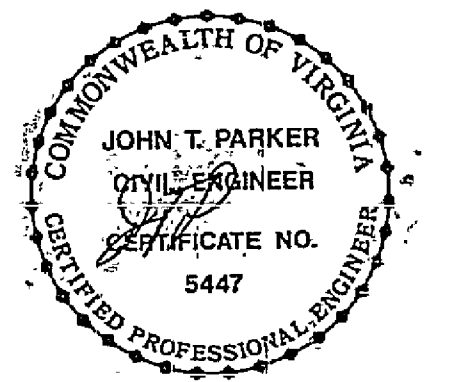

REVISIONS			
DRAWN BY:	DATE	REMARKS	BY
C.T.D. BY:	4-2-90	ROANOKE COUNTY ()	DHB
APPROVED:			
DATE:			

T. P. PARKER & SON
engineers & surveyors
TELEPHONE (703) 387-1153
P.O. BOX 367 SALEM, VIRGINIA 24153

WATER DISTRIBUTION SYSTEM
HUNTRIDGE OVER-ALL LAYOUT
ROANOKE COUNTY

SHEET 1
OF 17

RC-1862

