


PLAN

P.R.V. Δ - DENOTES PRESSURE REDUCING VALVE REQ'D. TO BE INSTALLED BY DEVELOPER.

NOTE: LIMITS OF (PG-24) PAVED GUTTER TO BE DETERMINED DURING CONSTRUCTION.

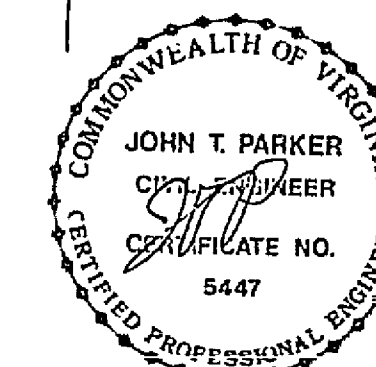

PLAN SCALE 1"=50'

PROFILE OF LABRADORE DRIVE
SCALE HORIZONTAL 1"=50'
VERTICAL 1"=10'

PLAN & PROFILE
OF
HUNTRIDGE
ROUNDORE COUNTY
VIRGINIA

FUTURE CONSTRUCTION
SECTION 3

NOTE: W.L. MUST BE SPREAD OUT
PARALLEL TO CURB

MAINTAIN 3 FT. CLEARANCE
OVER 24" DIA. ALL RECONSTRUCTED
ALONG ENDWALL

FIRE HYDRANT CONNECTION

BLOW OFF, TYPE I

MAINTAIN MIN. 18" CLEARANCE
BETWEEN W.L. AND
STORM SEWER

185'-8" @ 7.84%

225'-8" @ 12.44%

400'-8" @ 5.85%

K&E PLAT 1 PLAN/PROFILE
KENNELL & SPOFFORD CO.
487008 MADE IN U.S.A.

RC-1874

