


SUBSURFACE DETENTION PLAN
N.T.S.

**CONTRACTOR SHALL ENSURE THAT ALL
MANHOLE COVERS IN DETENTION SYSTEM
ARE INSTALLED FLUSH WITH GRADE**

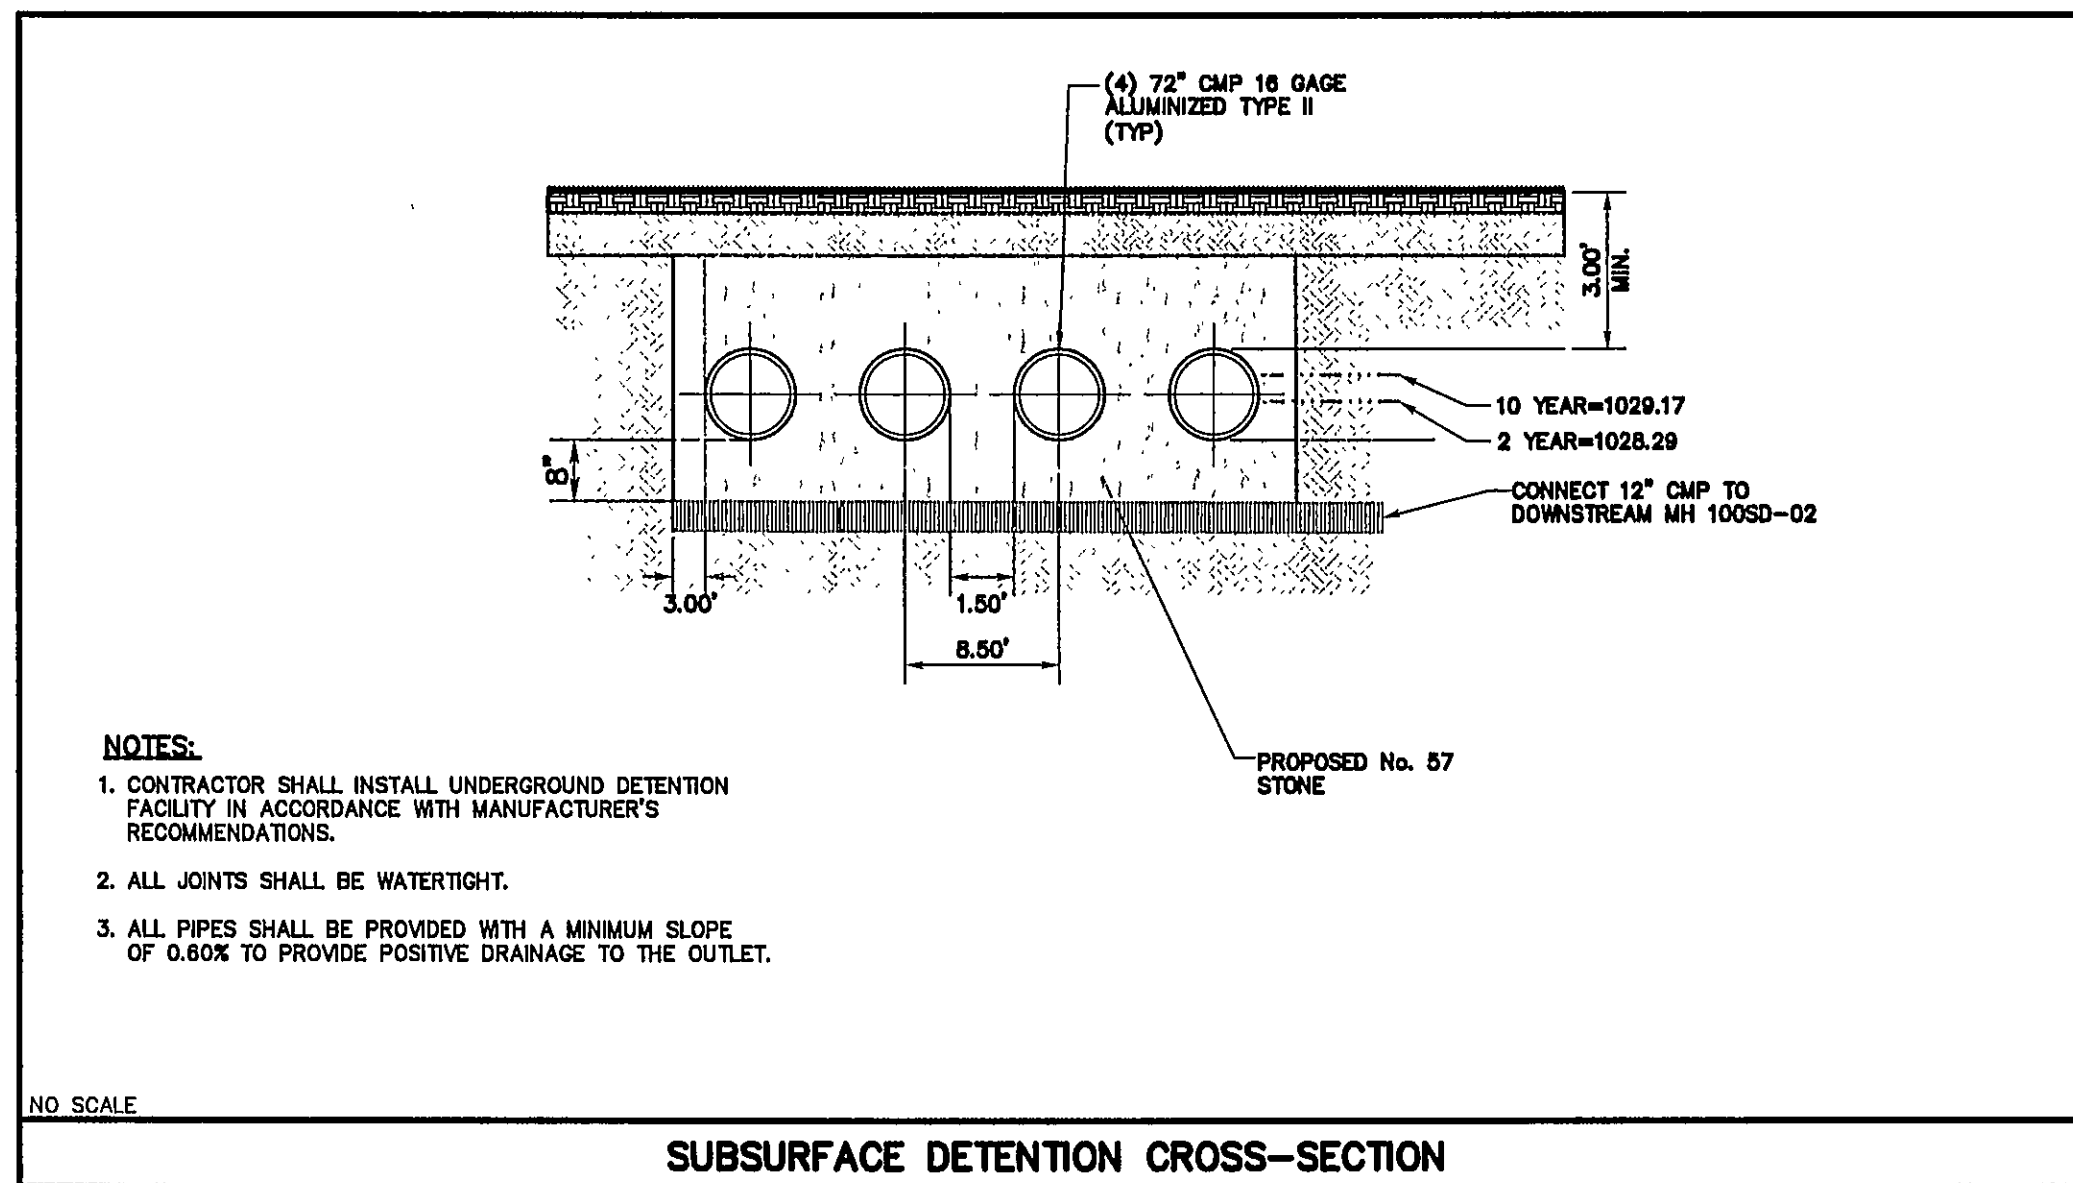

- NOTES:**
1. CONTRACTOR SHALL INSTALL UNDERGROUND DETENTION FACILITY IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
 2. ALL JOINTS SHALL BE WATERTIGHT.
 3. ALL PIPES SHALL BE PROVIDED WITH A MINIMUM SLOPE OF 0.60% TO PROVIDE POSITIVE DRAINAGE TO THE OUTLET.

NO SCALE