

-AMERICAN FLOW CONTROL

CONSTRUCTION STANDARDS WACH 2005

VALVE BOX INSTALLATION
TRENCH ADAPTER


DATE:


DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE:
DATE


TO BE LAID WITH ALL COOP PVC PIPE AND SHALL BE IN METALLIC CONTACT W ALL FITTINGS & VALVI


AMERICAN FLOW CONTROL


BOTETOURT COUNTY

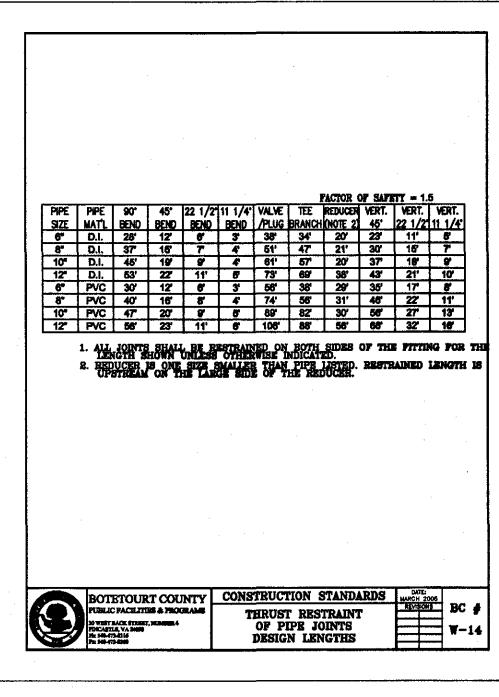

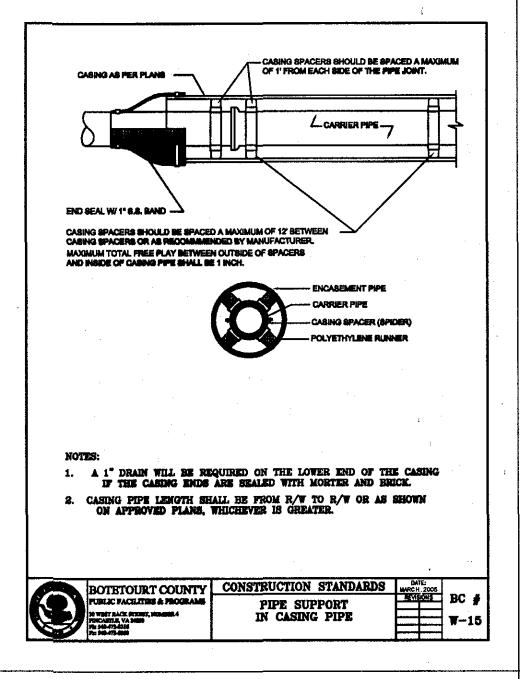

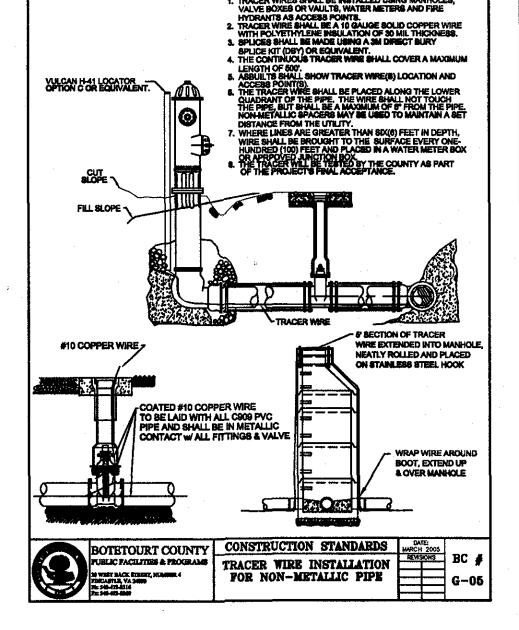

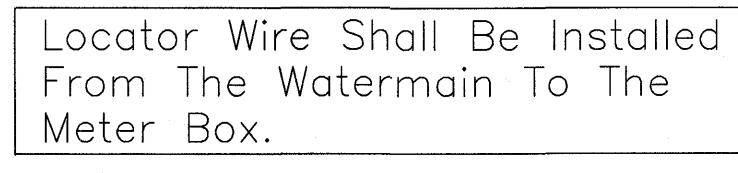



PIERSON ENGINEERING & SURVEYING

P.O. BOX 311 44 CATAWBA ROAD DALEVILLE, VA 24083

(540) 966-3027 TEL (540) 966-5906 FAX e-mall rpierson@rbnet.com

SEAD MOUNTAIN ROAD
UTILITY CONNECTION

