


NOTE: - ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

- 2" WATER MAIN ~~TO BE~~ ABANDONED. 10/18/93

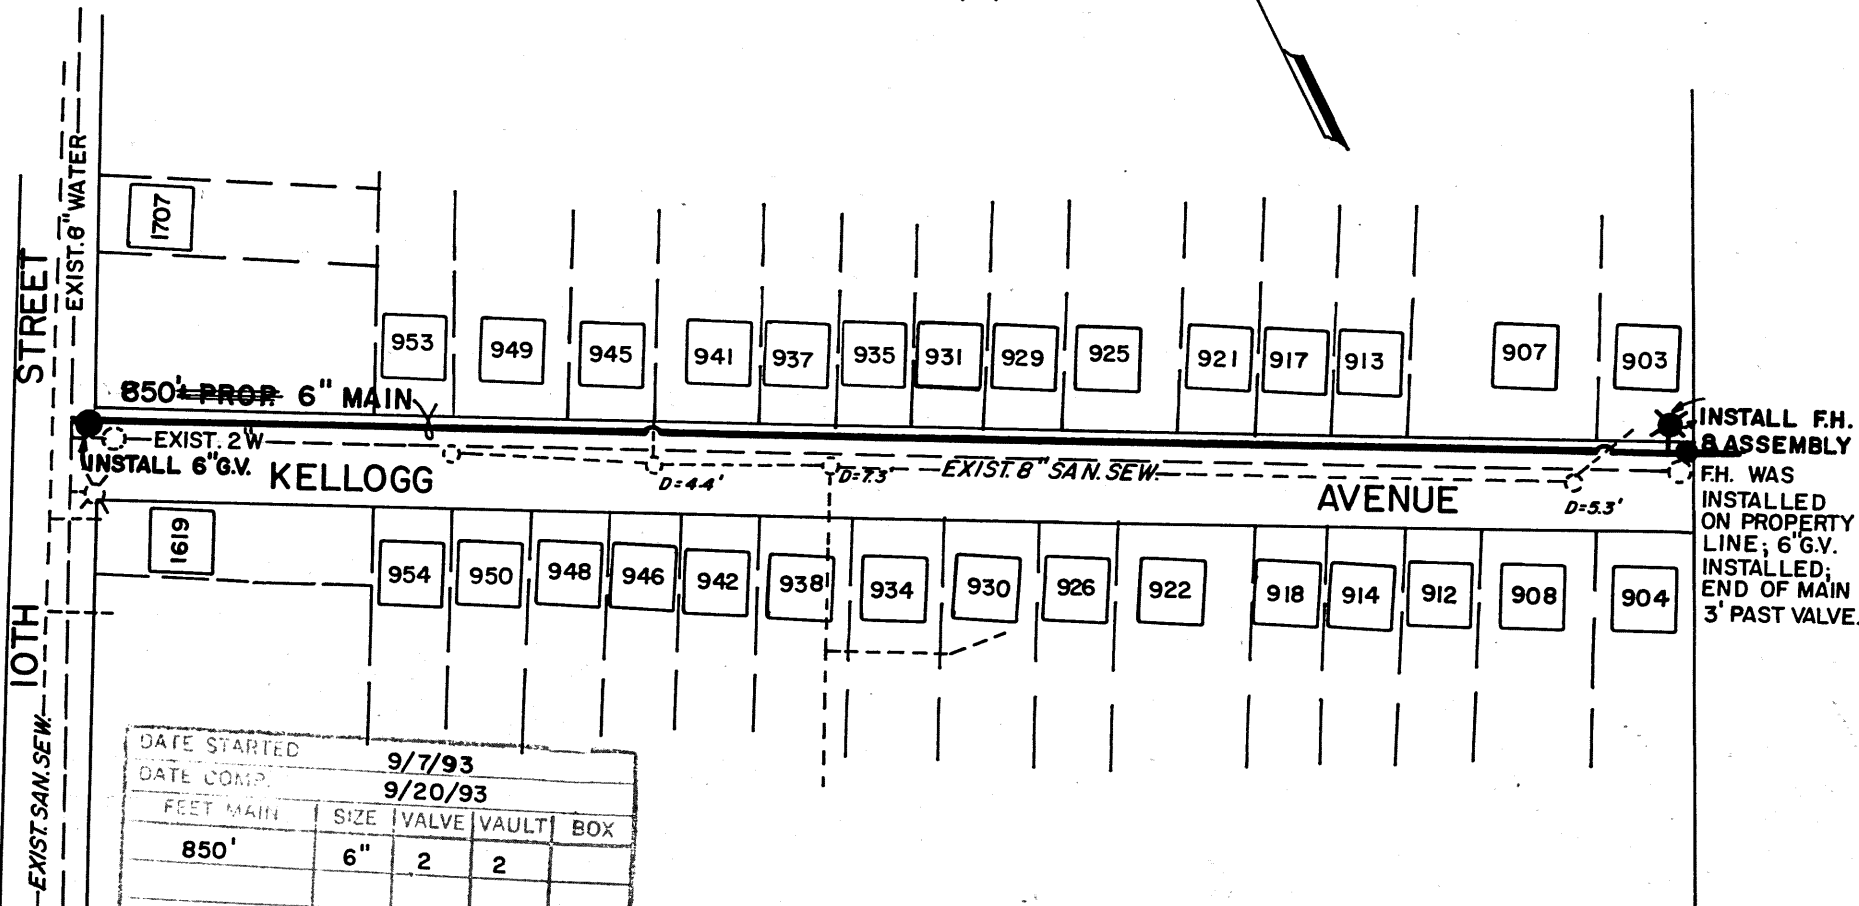

DATE STARTED					9/7/93
DATE COMP.					9/20/93
FEET MAIN	SIZE	VALVE	VAULT	BOX	
850'	6"	2	2		
F. H. COMP. ☒					
F. H. STUB ONLY ☒					
SERV. INS. BY:					
MAIN INS. BY: C.O. DAME - U.L.S.					
NO. 34" SERV. INS.					
CITY OR CO. CITY					
DEPT. INSP. U.L.S.					

WATER DEPARTMENT	
ROANOKE	VIRGINIA
KELLOGG AVENUE, &	
10TH STREET, N.W.	
SCALE: 1"=100'	8/20/97
DATE: 8/17/93	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 205	8/20/93
PLAN NO.: 93-14	DIRECTOR OF PUBLIC WORKS DATE

[Signature]
MANAGER UTILITY LINE SERVICES