



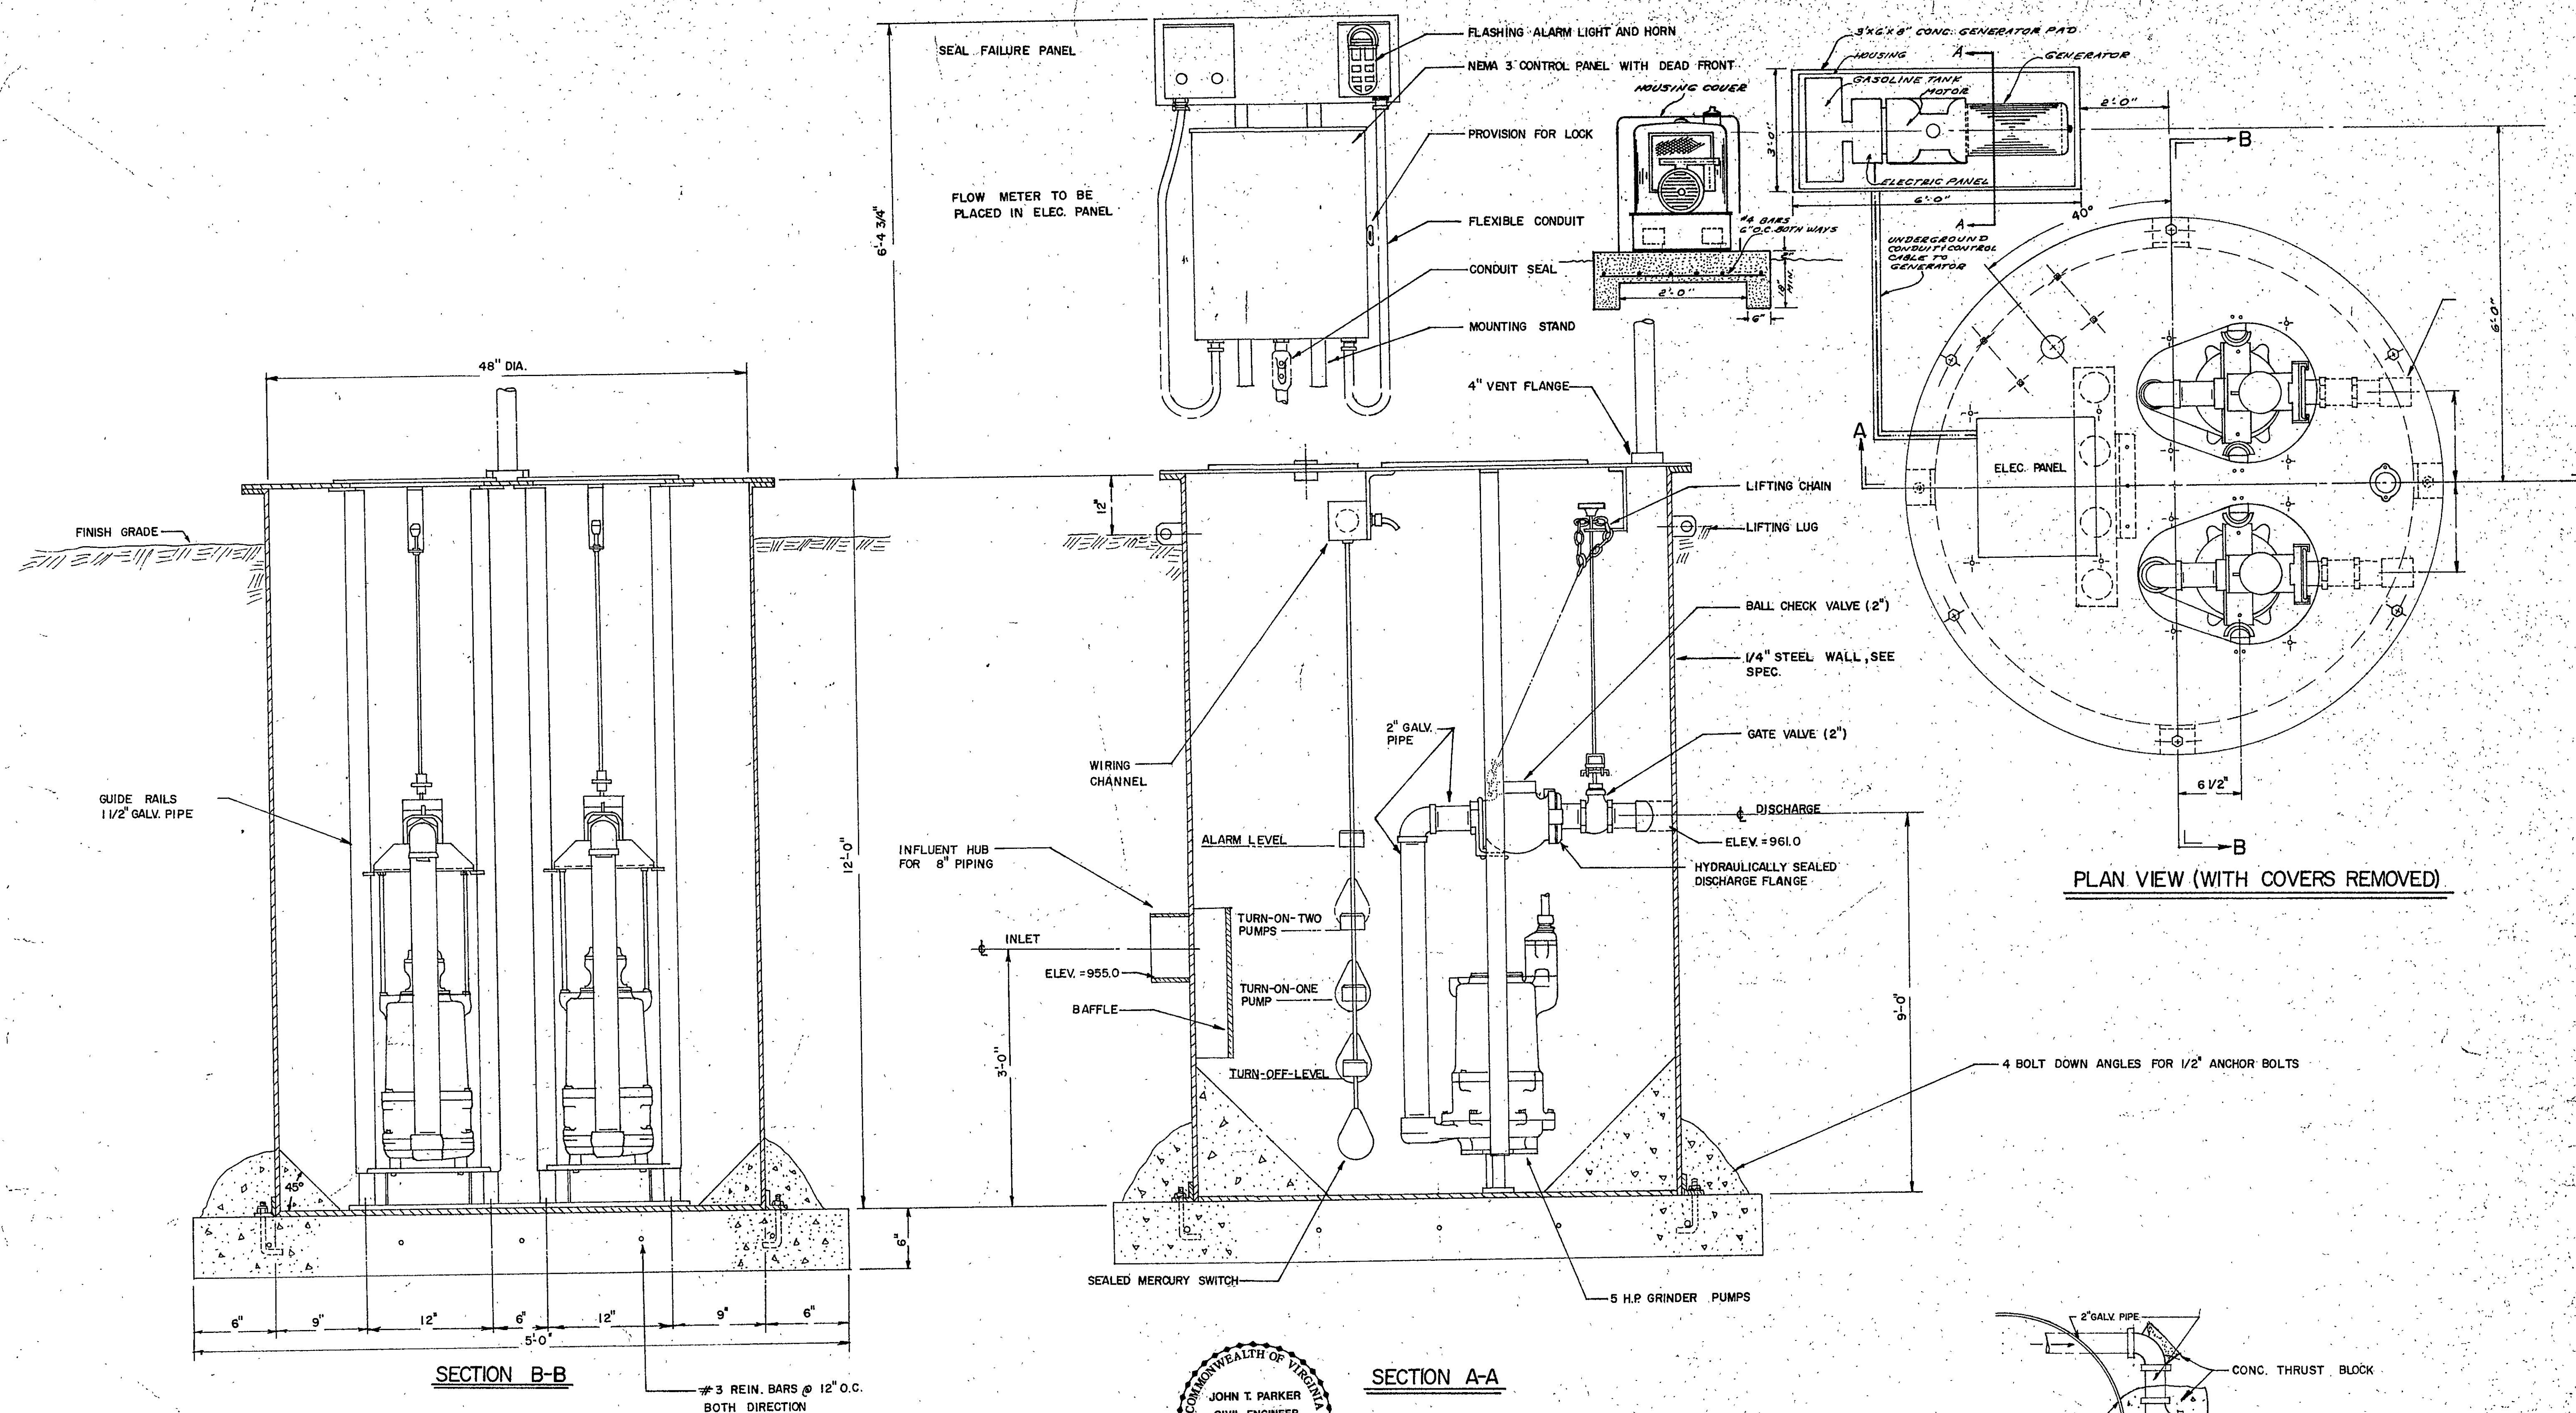

DUPLEX GRINDER PUMPING STATION

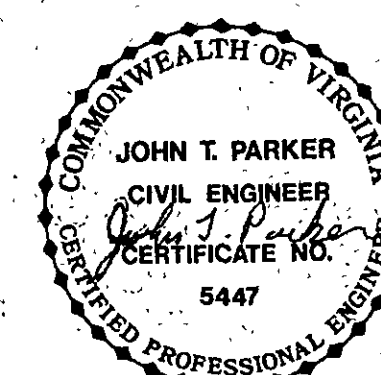

REVISIONS			
DRAWN BY:	DATE	REMARKS	BY
JTP	10/14/76	ADDED DETAIL OF CONNECTION	RJB
	7-11-78	DELETE HOLDING TANK - ADD EMERGENCY GENERATOR ES.	
APPROVED:			
DATE:			

T. P. PARKER & SON
engineers & surveyors

TELEPHONE (703) 387-1153
P.O. BOX 367, SALEM, VIRGINIA, 24153

DETAILS OF
PUMPING STATION

SHEET 5
OF 6

