


14221b000 ph2-apl-ss lat.plt

w:\drawings\2014\14221\sur\14221b000 ph2-apl.dwg

NOTES:


1. ALL SANITARY SEWER LATERAL LINES SHALL HAVE A MINIMUM OF 3.0 FEET OF COVER.
2. A WESTERN VIRGINIA WATER AUTHORITY INSPECTOR MUST BE ON SITE DURING INSTALLATION OF NEW MANHOLES AT, OR CONNECTIONS TO, TIE IN AT EXISTING SANITARY SEWER LINES.
3. SANITARY SEWER CONNECTION TO EXISTING MANHOLE SHALL BE EXCAVATED AND CORED BY THE CONTRACTOR AND A RUBBER BOOT SHALL BE INSTALLED. WESTERN VIRGINIA WATER AUTHORITY TO INSPECT THE CONTRACTOR'S CORE.
4. ALL SANITARY SEWER LATERAL LINES SHALL BE SDR-21 PVC PIPE MATERIAL.
5. CONTRACTOR SHALL REFER TO WVWA STANDARD DETAILS S-6 & S-7 FOR LATERAL CONNECTIONS.

GRAPHIC SCALE



SANITARY SEWER LATERAL CONNECTION PLAN

PREPARED FOR
JPR PROPERTIES, LLC
LOCATED ALONG
LAKELAND DRIVE
WITHIN
ROANOKE COUNTY, VIRGINIA

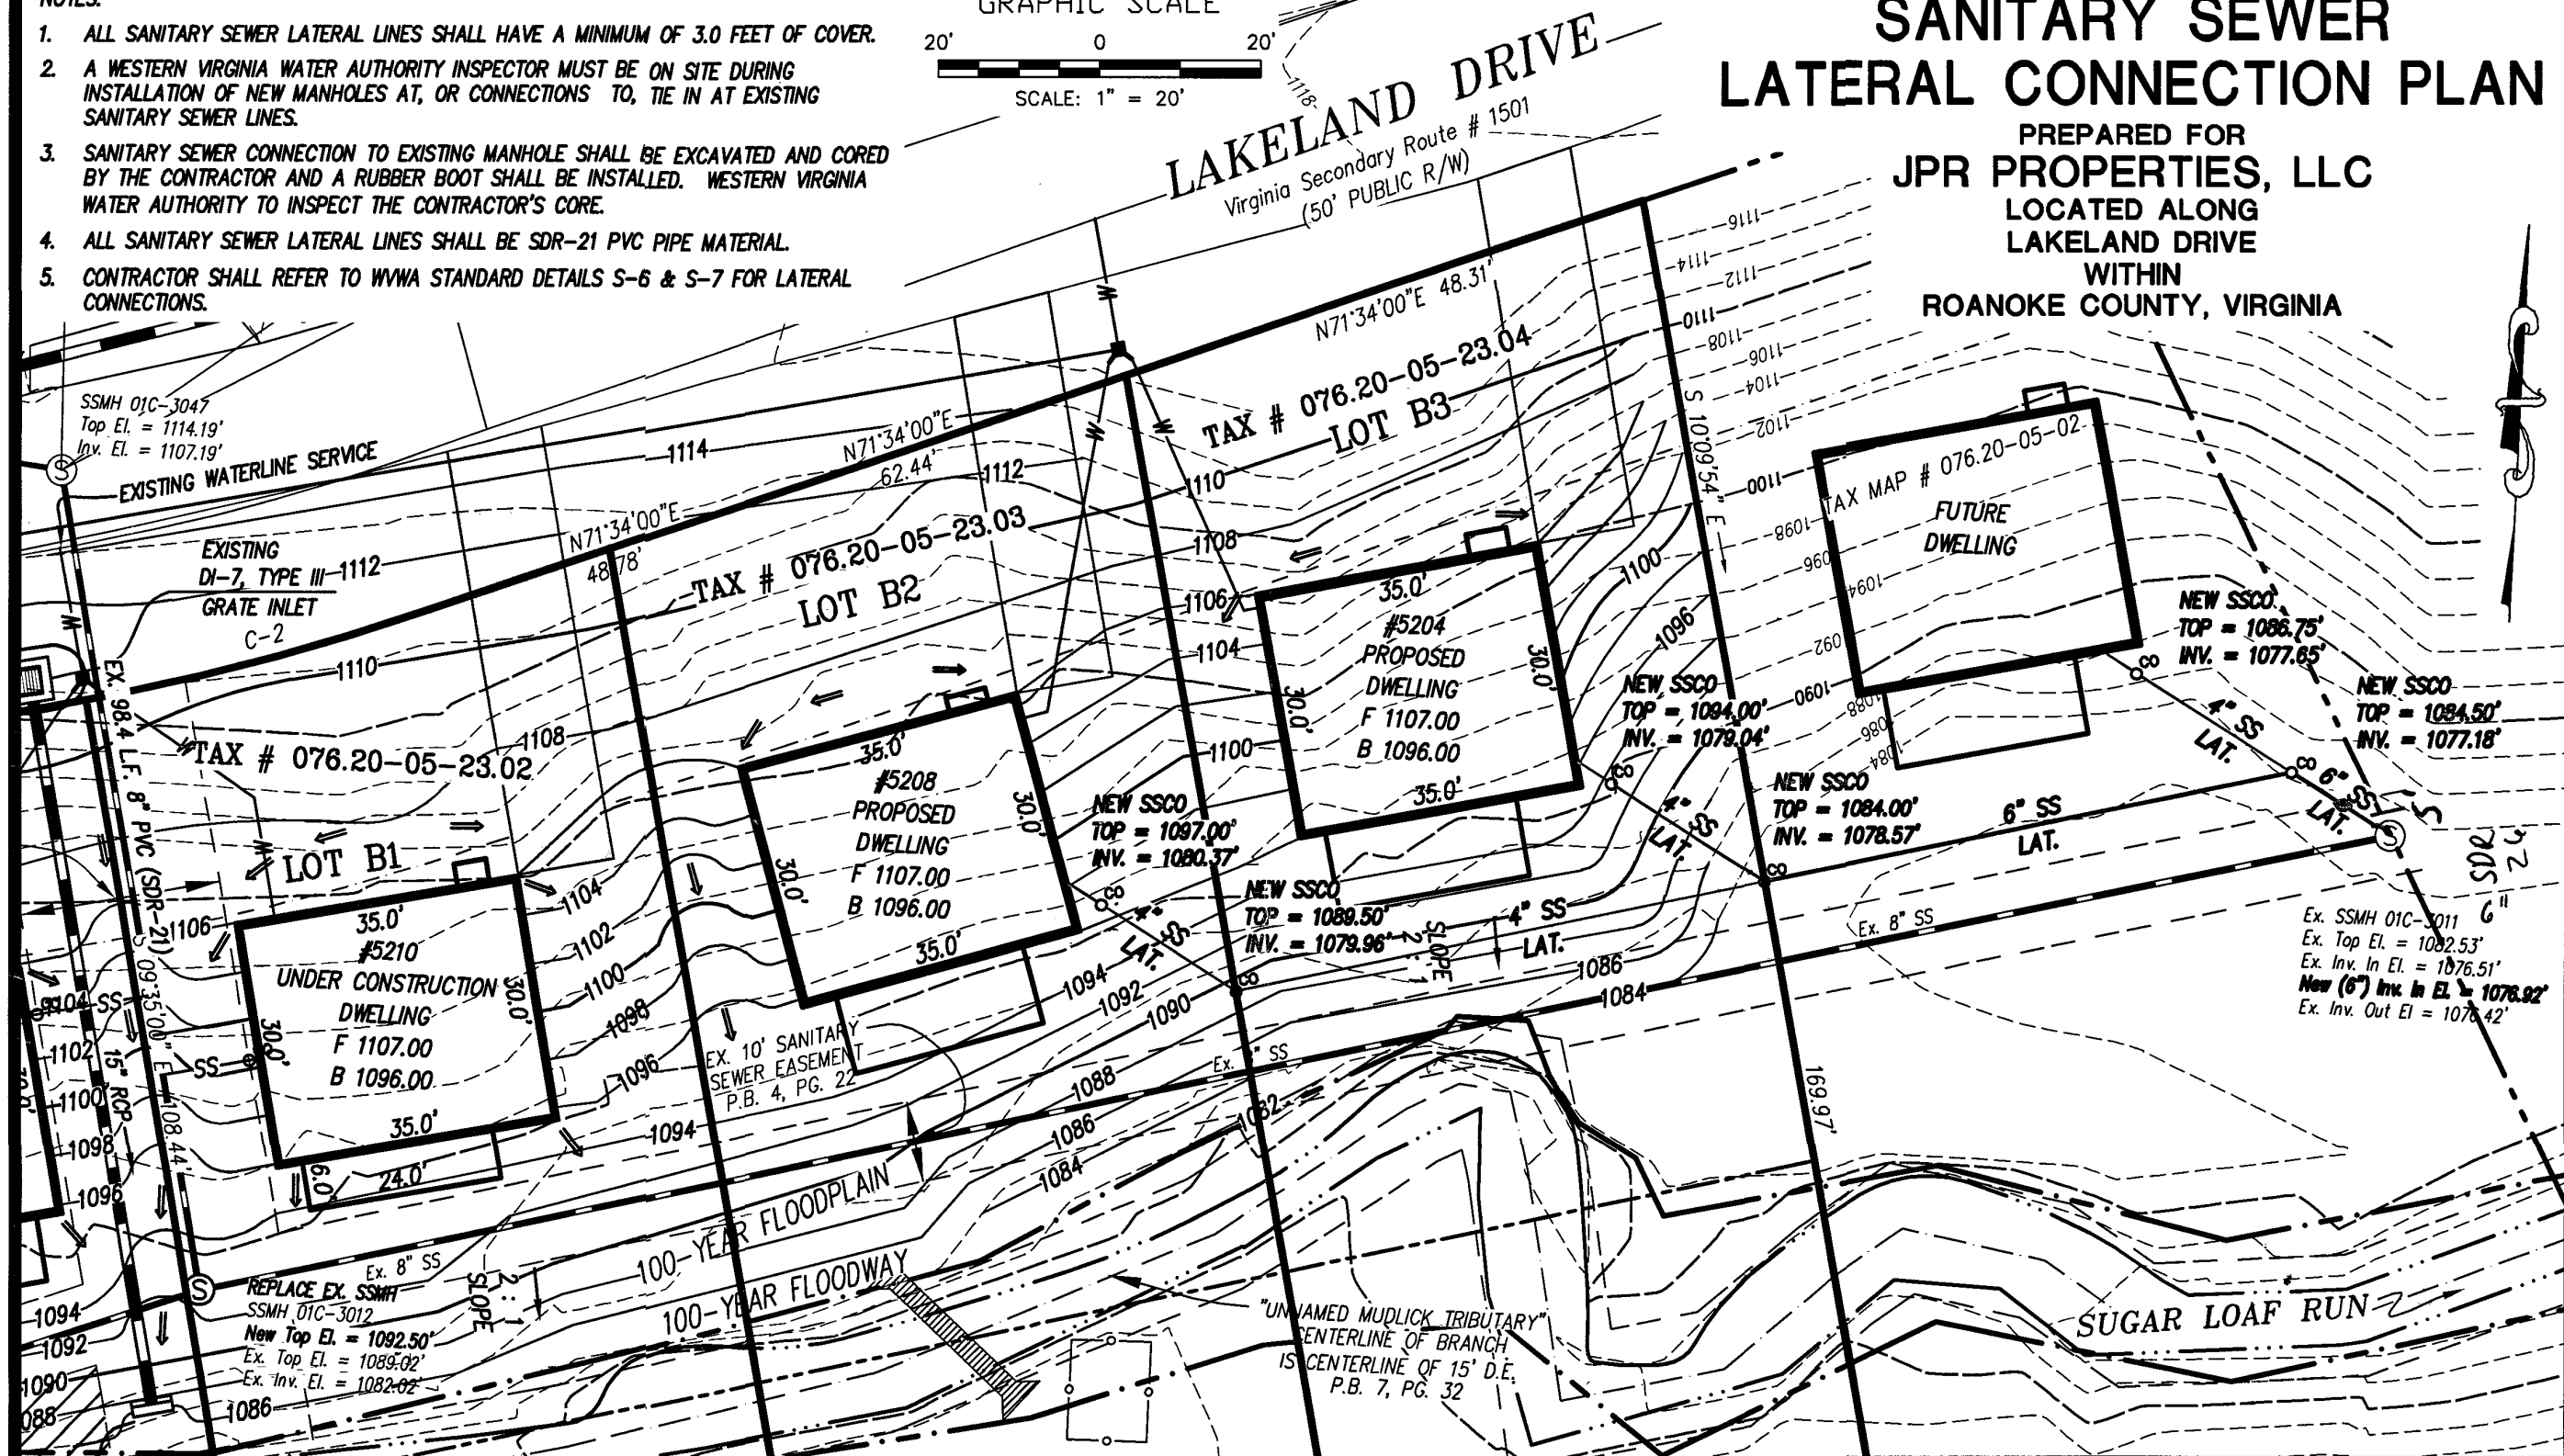

LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

4664 BRAMBLETON AVENUE
P.O. BOX 20669
ROANOKE, VIRGINIA 24018

PHONE: (540) 774-4411
FAX: (540) 772-9445
E-MAIL: MAIL@LUMSDENPC.COM

DATE:	February 27, 2017
COMM. NO.:	14-221
SCALE:	1" = 20'

SHEET 1 OF 1