


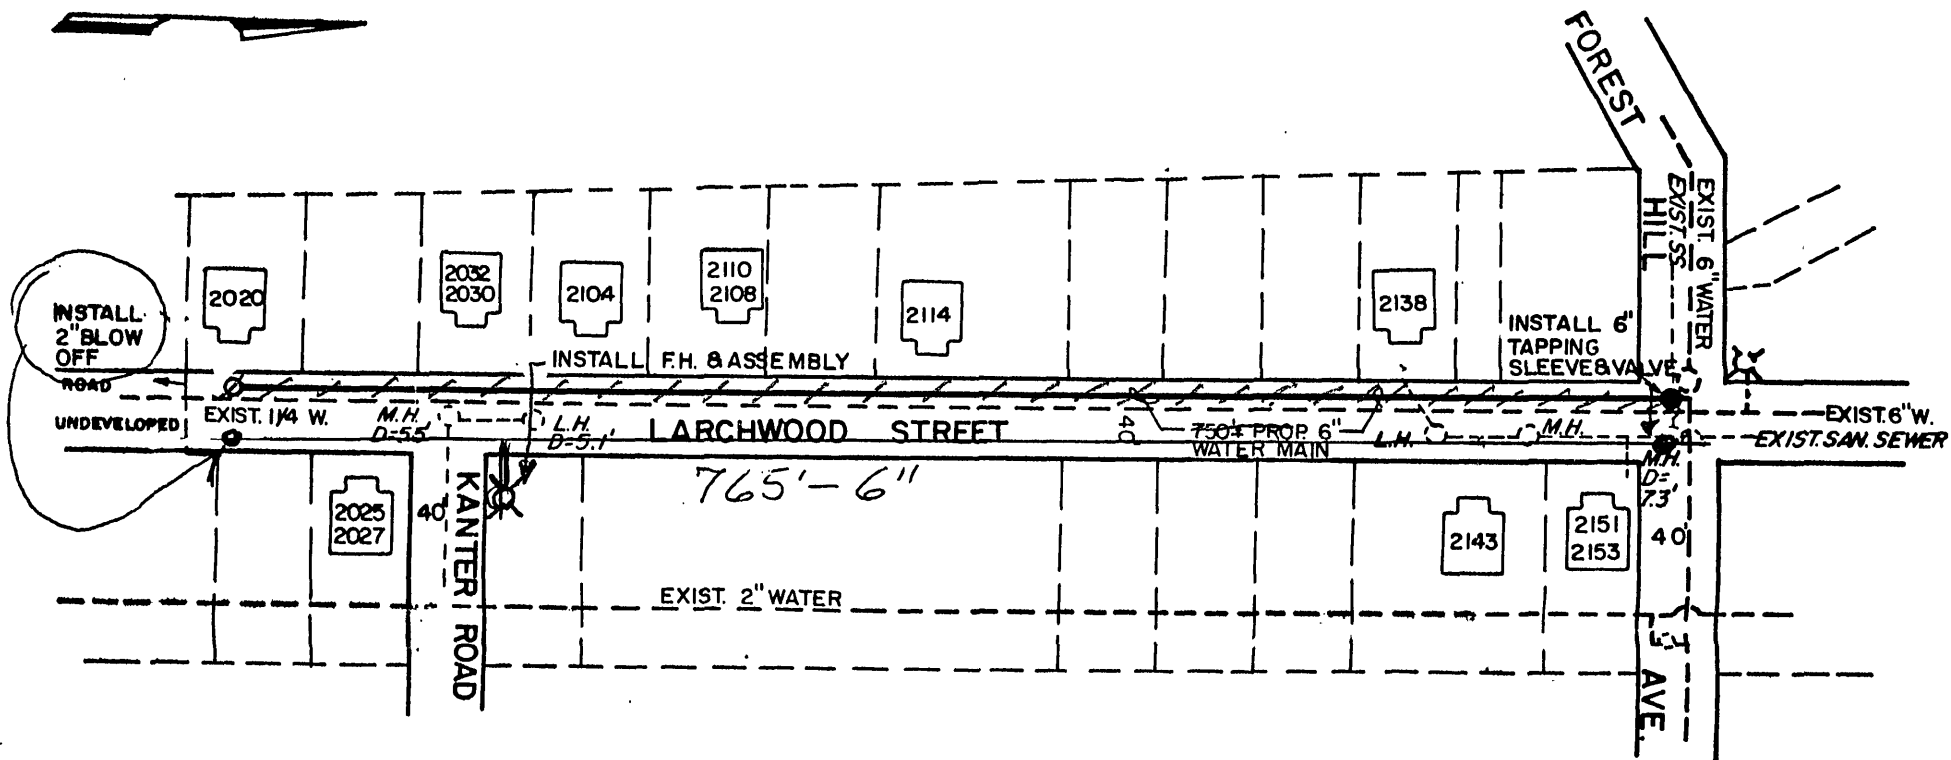

DATE STARTED 5-16-95
DATE COMP. 5-24-95

FEET MAIN	SIZE	VALVE	VAULT	BOX
765	6"	6"		#1

F.H. COMP. 1
F.H. RTUB ONLY 0

SERV. INS. BY: *John D. Rame*
MAIN INS. BY: *John D. Rame*
NO. 1/4" SERV. INS.
CITY OR CO.
DEPT. WWRP.

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

1/4" MAIN TO BE ABANDONED WHEN SERVICES TIED IN TO NEW MAIN.

James H. Paulin
MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT.
ROANOKE VIRGINIA

LARCHWOOD STREET, N.E.
REPLACEMENT
2000, 2100 BLOCKS

1"=100'
12/8/94
312
94-17