

Note:


Materials and construction of
san. sewer M.H.s and mains to be
in accordance with specifications and
standards of Engr. Dept. of City of Roanoke,
except Man hole lids to contain
the words "Roanoke Sewer County."

Infiltration of installation not
to exceed 1 gal. per ft. per 24 hr. for
1189.9 in. ft. of 8" sewer main

20 - 6" wyes & 2-6" stubs in M.H.s repd.

PLAN	DATE	BY	NOTED	APPROVED
PLAN	4-26-57	BY	NOTED	APPROVED
NOTE BOOK				
FLIGHT CHECKED				
NO. 82-54				

See Plan & Profile "As Built"
10" T.C. San. Sewer for
Roanoke County San. Auth.
from Peachtree Dr. along W. side
of Peters Creek to S. end of
Meadowbrook Rd. by C.B.M. & Son
dated Mar. 11, 1956

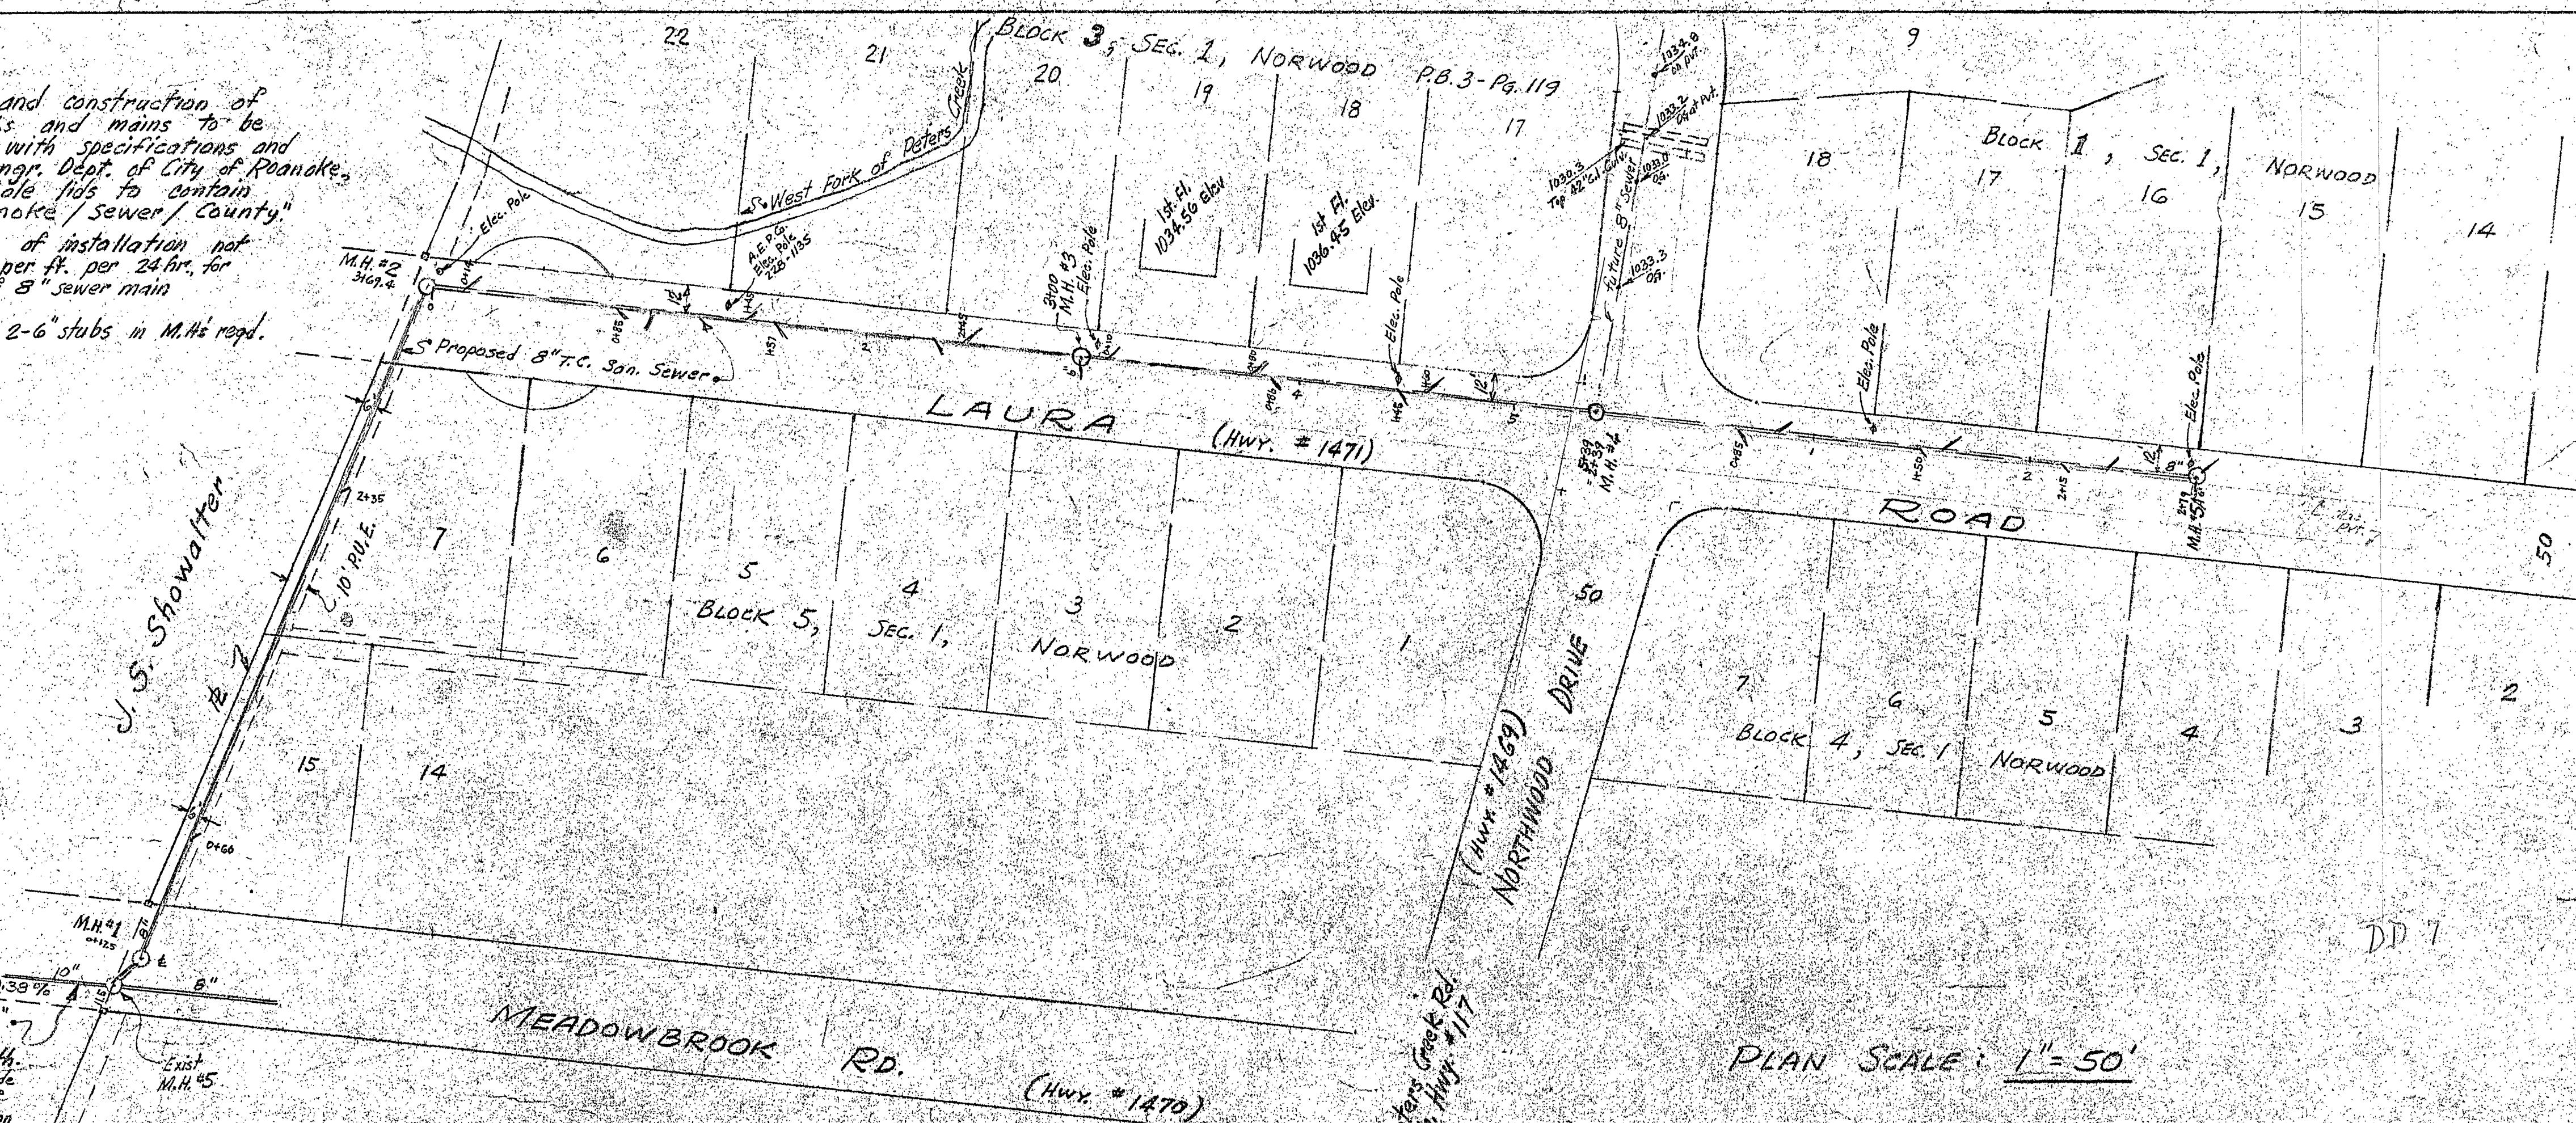

PLAN SCALE: 1" = 50'

Proposed San. Sewer Approved:

Paul L. Matthews, 4-26-57
Engineer for Roanoke County, date
James A. Beavers, 4-26-57
Executive Director, Robt. Co. San. Auth. date
H. Clinton Drayton, 5-27-57
City Engineer, Roanoke, Va. date
J. H. Smith, 5-27-57
Director of Public Works, Roanoke, Va. date

PROFILE	DATE	BY	NOTED	APPROVED
PROFILE	4-26-57	BY	NOTED	APPROVED
NOTE BOOK				
FLIGHT CHECKED				
NO. 82-54				

