


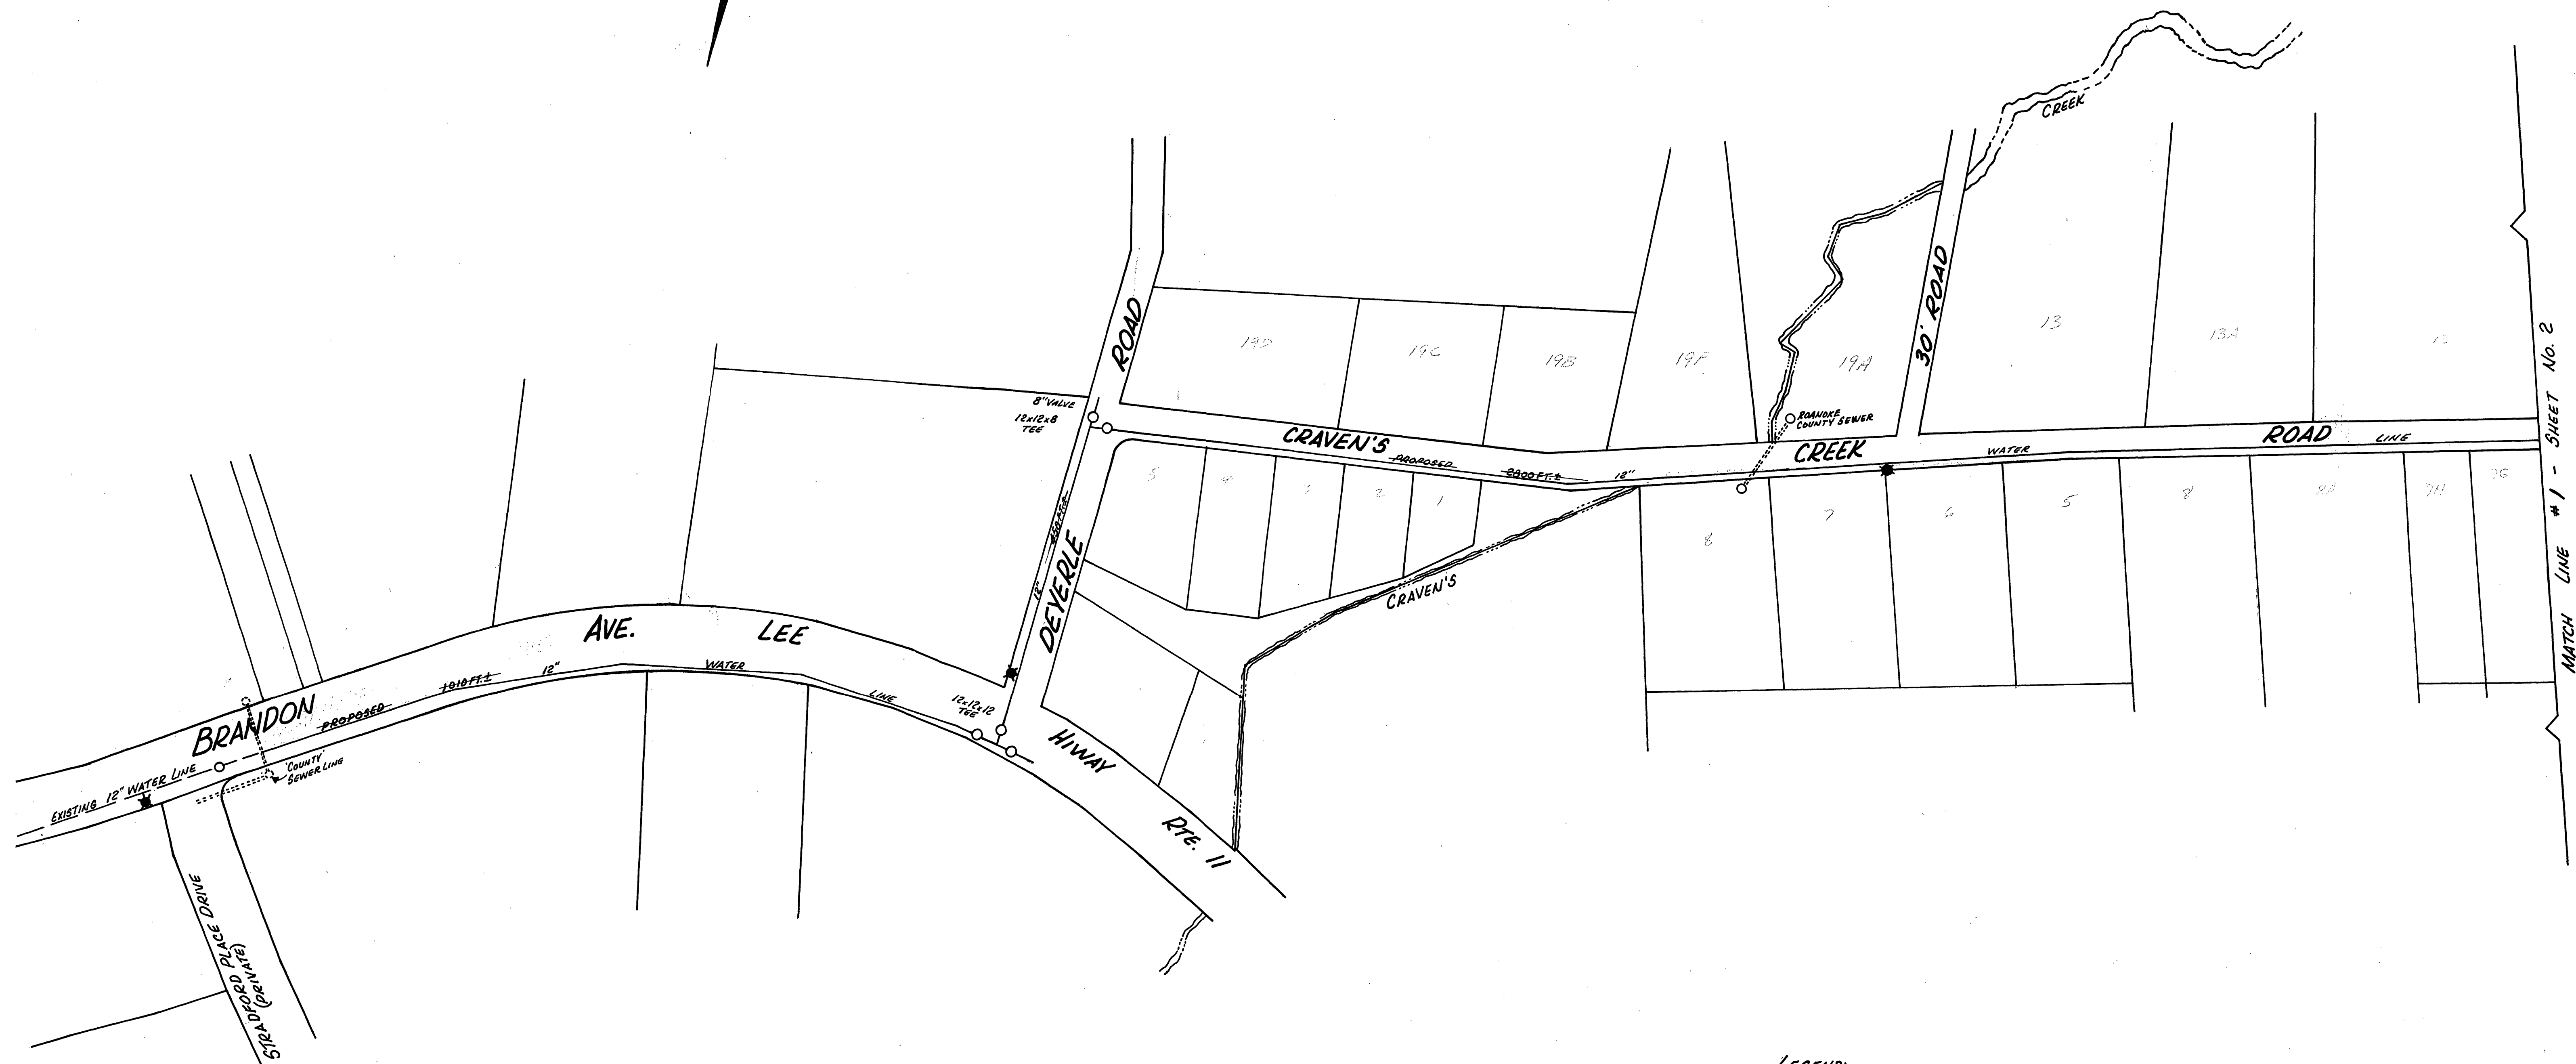

LEGEND:
 ○ VALVE
 ★ FIRE HYDRANT
 ALL PROPOSED LINE MEASUREMENTS FROM INTERSECTIONS

COMPLETE JOB					
DATE STARTED	11-8-76				
DATE COMP.	5-15-78				
FEET MAIN	SIZE	VALVE	VAULT	BOX	
8415'	12"	16	16	16#2	
105'	8"	3	3	3#2	
42'	6"	3	3	3#2	
F.H. COMP.	6	6"	6	6#2	
F.H. STUB ONLY					
SERV. INS. BY:	U.L.F.				
MAIN INS. BY:	U.L.F.				
NO. 3/4" SERV. INS.					
CITY OR CO.	CITY				
DEPT. INSP.	J.W. MOTLEY				

B. B. Kim
 DIRECTOR UTILITIES & OPERATIONS
Thomas J. Brady
 CITY ENGINEER OF ROANOKE, VA.
Richard B. Jorgensen
 DIRECTOR OF PUBLIC WORKS
W. C. ...
 AGENT FOR ROANOKE PLANNING COMM.

June 11, 1976
 DATE
 6-11-76
 DATE
 6-14-1976
 DATE

DATE	REV.	DESCRIPTION	BY
SCALE: 1" = 100'			
PROPOSED 12" WATER LINE FROM LEE HWY RTE 11 TO RTE 419 ELECTRIC ROAD			
CITY OF ROANOKE OFFICE OF CITY ENGINEER ROANOKE, VIRGINIA			
CONTRACTOR MUST VERIFY ALL DIMENSIONS AT PROJECT BEFORE PROCEEDING WITH WORK			
DRAWN BY STOCKTON CHECKED			CITY ENGINEER
APPRO			
DATE JUNE 10, 1976			
JOB NO.			76-12
SHEET			1
			2