



PLAN
NO. 1
DATE 11-21-78
BY T. P. PARKER
ENGINEER & SURVEYOR
STRUCTURE NOTATIONS CHECKED

PROFILE
NO. 1
DATE 11-21-78
BY T. P. PARKER
ENGINEER & SURVEYOR
STRUCTURE NOTATIONS CHECKED

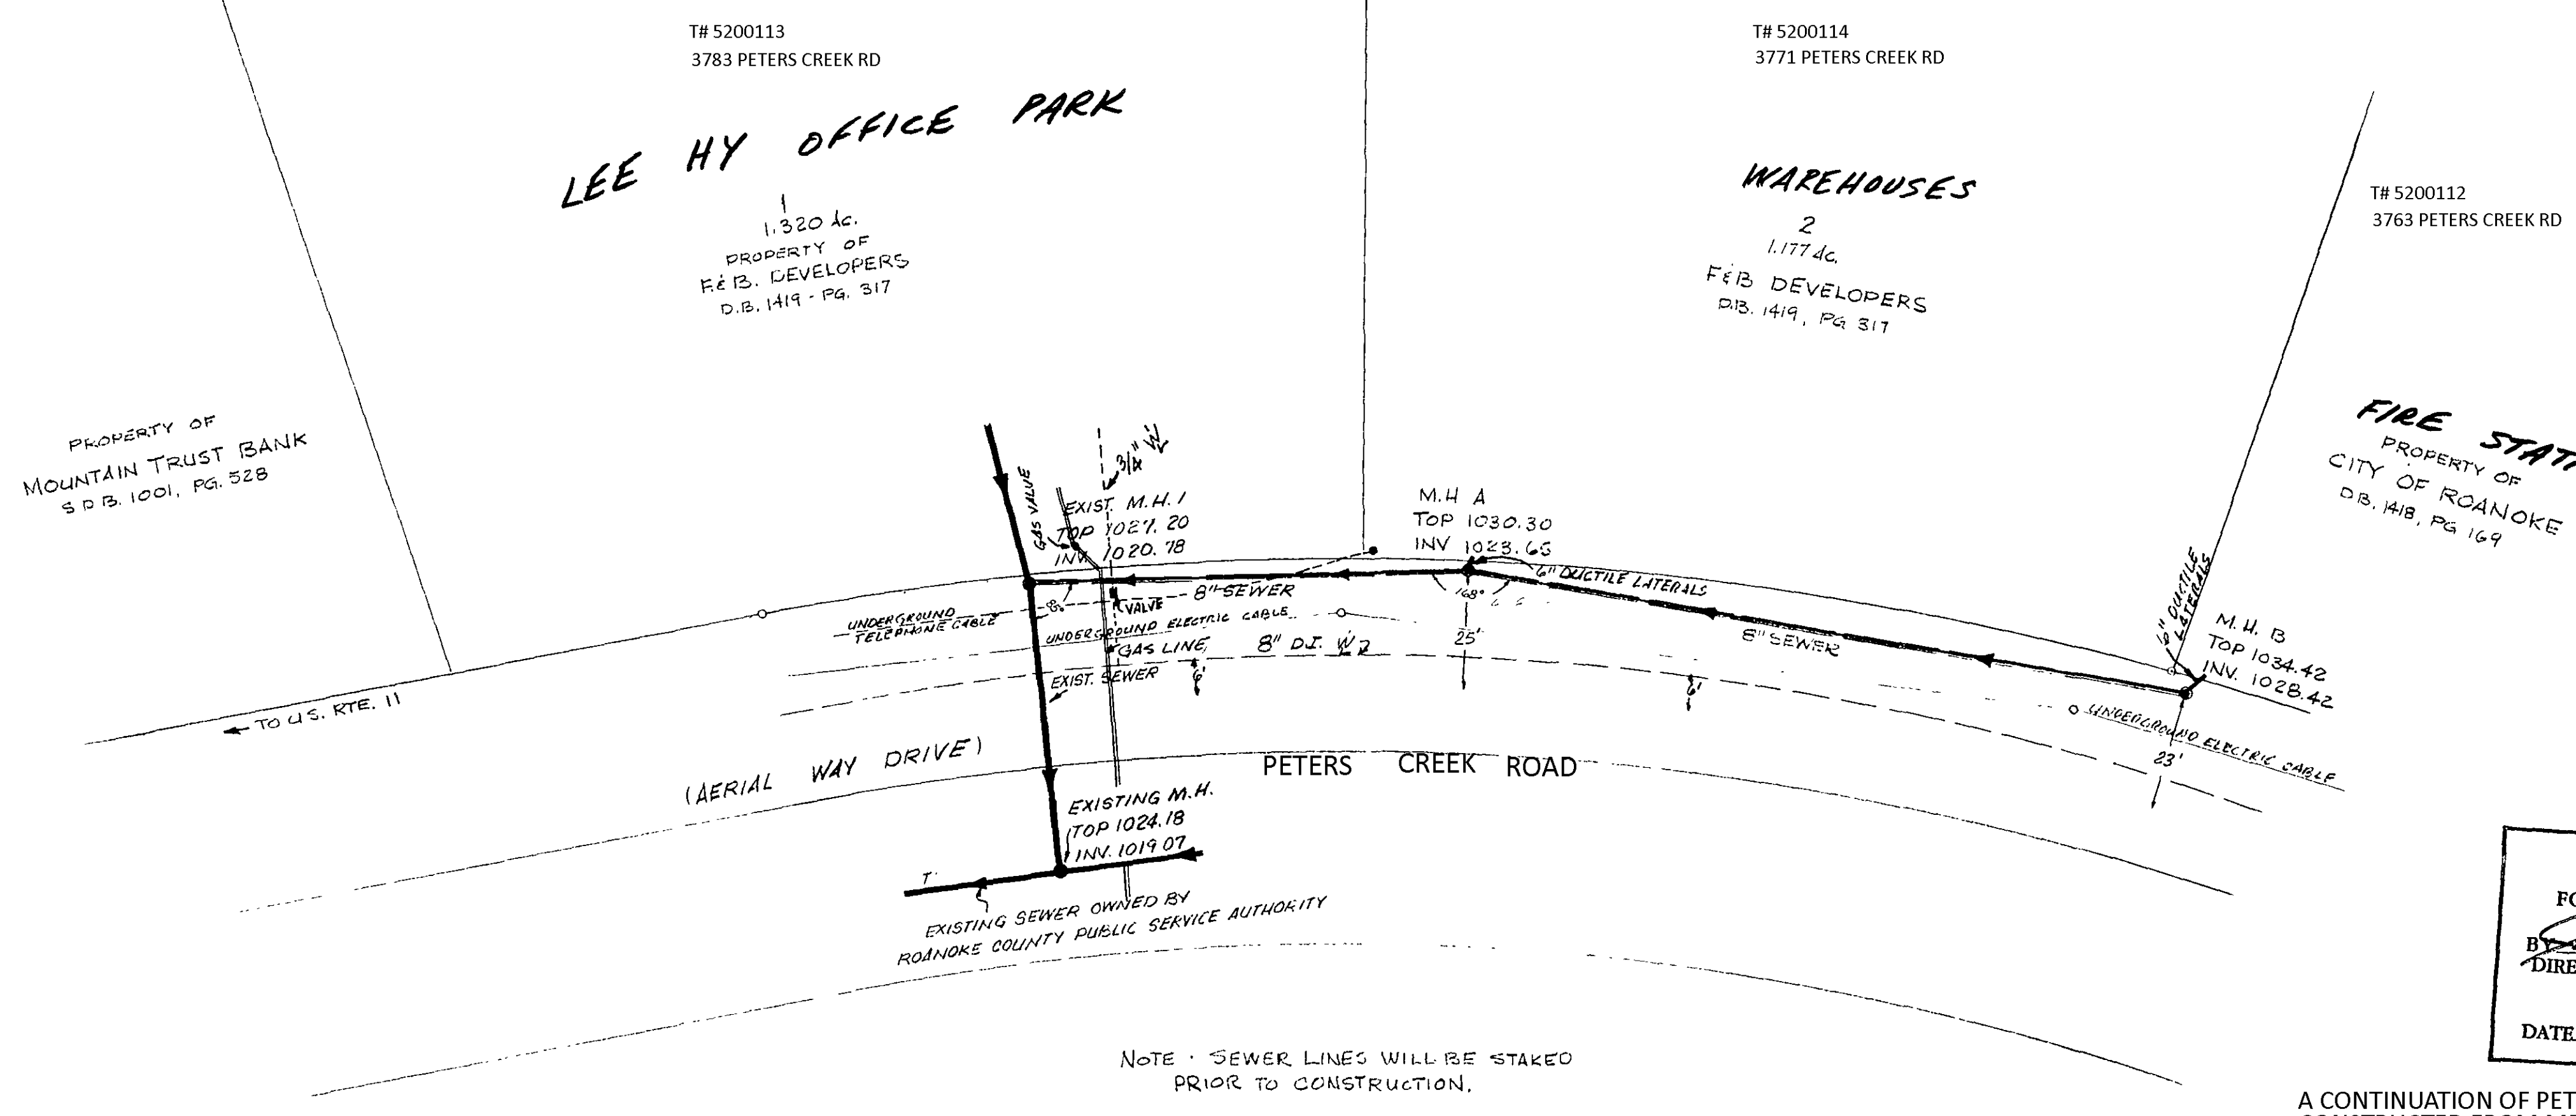


- SEWER NOTES
1. ALL MATERIAL SHALL BE SUPPLIED AND INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE ROANOKE COUNTY PUBLIC SERVICE AUTHORITY RULES AND REGULATIONS AND CONSTRUCTION STANDARDS AND SPECIFICATIONS.
 2. A MINIMUM COVER OF THREE (3) FEET OVER THE PROPOSED LINES IS REQUIRED.
 3. NO WORK SHALL BEGIN WITHOUT WRITTEN APPROVAL OF CONSTRUCTION PLANS FROM THE PUBLIC SERVICE AUTHORITY.
 4. NO WORK SHALL BEGIN WITHOUT NOTIFYING THE PUBLIC SERVICE AUTHORITY 24 HOURS IN ADVANCE. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ANY AND ALL NECESSARY PERMITS.
 5. WORK SHALL BE SUBJECT TO INSPECTION BY AUTHORITY INSPECTORS.
 6. CONTRACTORS SHALL BE RESPONSIBLE FOR LOCATING AND UNCOVERING ALL SEWER MANHOLES AFTER SURFACE TREATMENT OF ROADS AND ADJUSTING TOPS TO FINAL ROAD GRADES, IF NECESSARY.
 7. ALL EXISTING UTILITIES MAY NOT BE SHOWN OR MAY NOT BE SHOWN IN THE EXACT LOCATION. THE CONTRACTOR SHALL COMPLY WITH THE STATE WATER WORKS REGULATIONS SECTION 12.02.02, WHERE LINES CROSS.
 8. ALL HOUSE CONNECTIONS ARE TO BE MADE WITH 6-INCH SEWER PIPE AND INSTALLED ON A MINIMUM OF 1/4-INCH TO 1-FOOT GRADE FROM THE SEWER MAIN TO THE PROPERTY LINE. THE INVERT ELEVATION AT THE PROPERTY SHALL BE SHOWN ON THE AS-BUILT PLANS.
 9. ALL HOUSE CONNECTIONS MADE FROM MANHOLES SHALL BE DUCTILE IRON OF SUFFICIENT LENGTH TO PROVIDE TWO (2) FEET OF BEARING ON NATURAL GROUND. THE TRANSITION FROM DUCTILE IRON TO CONCRETE OR ASBESTOS CEMENT PIPE SHALL BE MADE WITH AN ADAPTER COUPLING.
 10. THE CONTRACTOR SHALL NOTIFY THE AUTHORITY OF ANY FIELD CORRECTIONS TO THE APPROVED PLANS PRIOR TO SUCH CONSTRUCTION.
 11. ALL TRENCHES WITHIN THE EXISTING OR FUTURE VIRGINIA DEPARTMENT OF HIGHWAYS AND TRANSPORTATION RIGHT OF WAYS MUST BE COMPACTED IN SIX-INCH LAYERS.

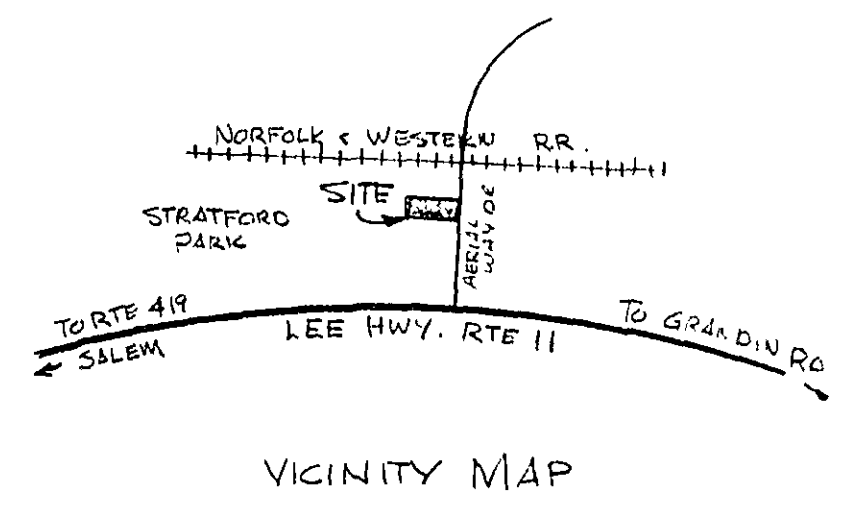

PLAN SCALE 1" = 25'

PROFILE OF PROPOSED SANITARY SEWER EXTENSION
SCALE HORIZONTAL 1" = 25'
VERTICAL 1" = 10'

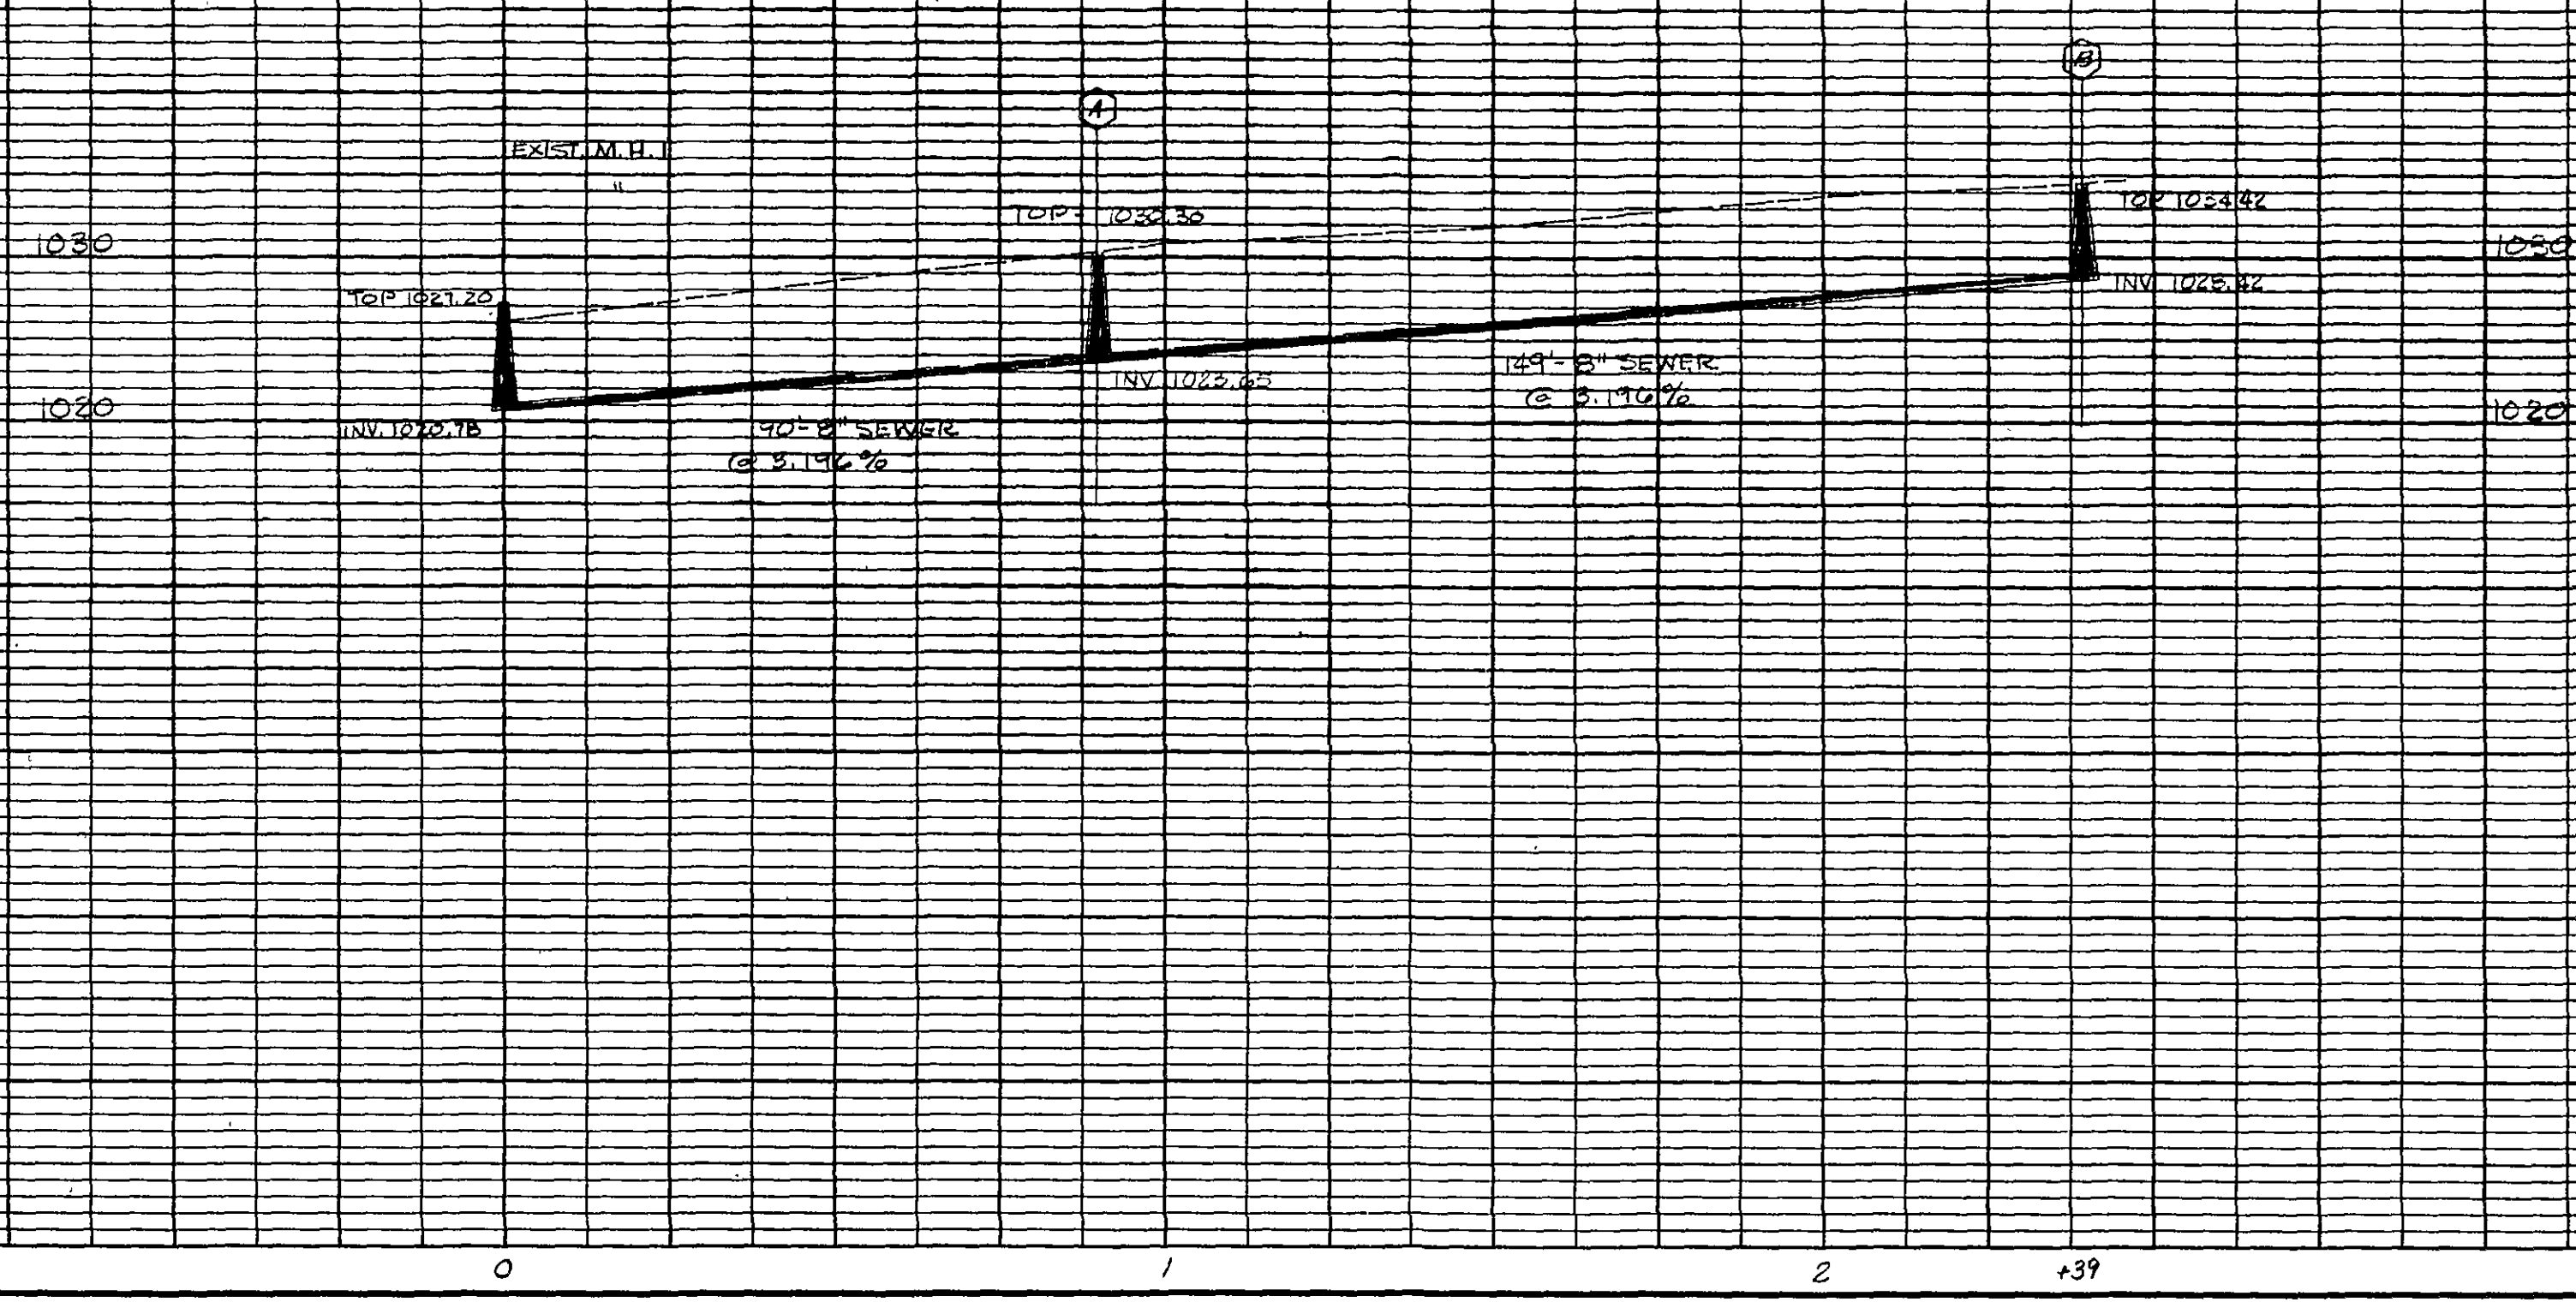

Lee Hy Office Park EXT.

PLAN & PROFILE
OF PROPOSED
SANITARY SEWER EXTENSION
FOR
F&B DEVELOPERS
ON AERIAL WAY DRIVE S.W.
ROANOKE VIRGINIA
BY T. P. PARKER & S. PARKER
ENGINEERS & SURVEYORS
SCALE AS SHOWN

