


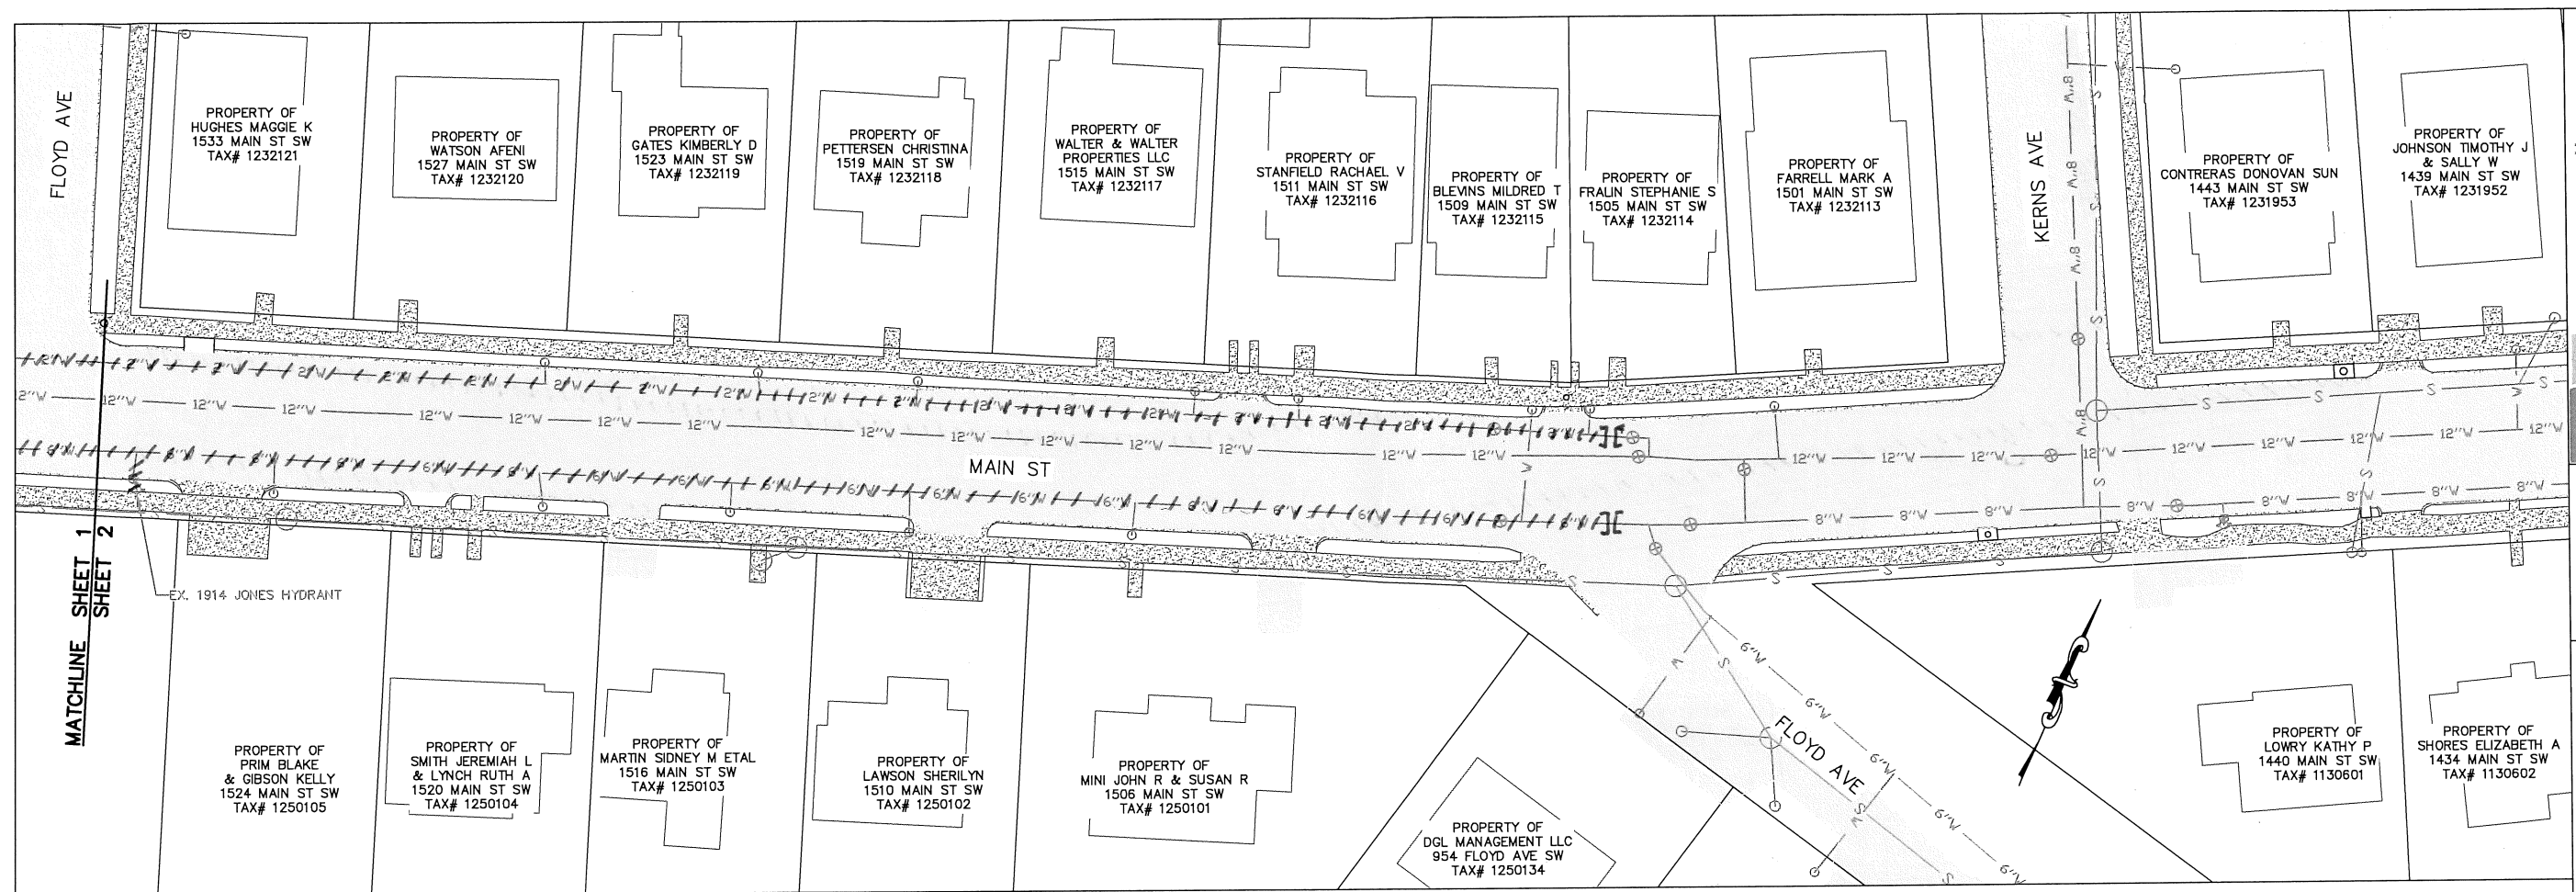

Project Name	
Install Contractor	WUWA / Kyle Boone
Construction Start Date	8/2018
Completion Date	5/2019
Water Main(s)	
Manufacturer	
Diameter	
Pipe Class	
Material	DI
Comments	
Water Service(s)	
Manufacturer	Endot
Diameter	1"
Pipe Class	PE470
Material	HDPE
Comments	

*all services re-newed from 12" main w/ new box & setter.

Water Valve(s) 1	
Manufacturer	Am. Flow Control
Valve Type	Gate Resilient Seat
Diameter	
Direction to Open / Turns to Close	
Comments	
Water Valve (s) 2	
Manufacturer	
Valve Type	
Diameter	
Direction to Close / Turns to Close	
Comments	
Hydrant(s)	
Authority ID #	
Manufacturer	
Model	
Cast Date	
Static Pressure	
Comments	

Denotes Abandoned Water Lines

