




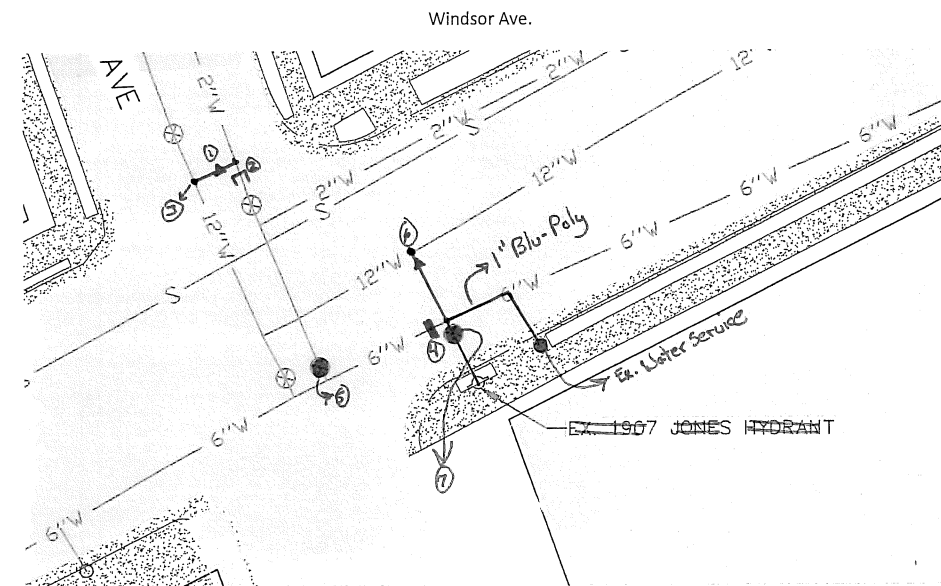


- ① 2" gate valve
- ② 2" Ex. line cut & capped 6' from Ex. 2" valve
- ③ 2" Corp Stop
- ④ 6" cap
- ⑤ 2" valve off & buried
- ⑥ 12x6 T/S & valve
- ⑦ Repl. 6" Hyd Valve

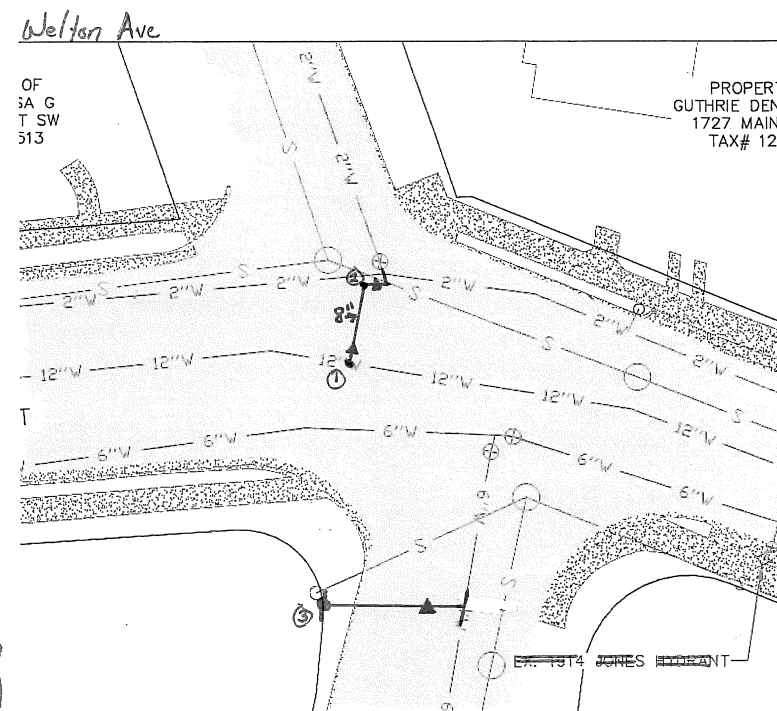


- ① 8" T/S & T/Valve
- ② 8x2 Red. w/ 2" G/V
- ③ Hyd. 12527 re-located

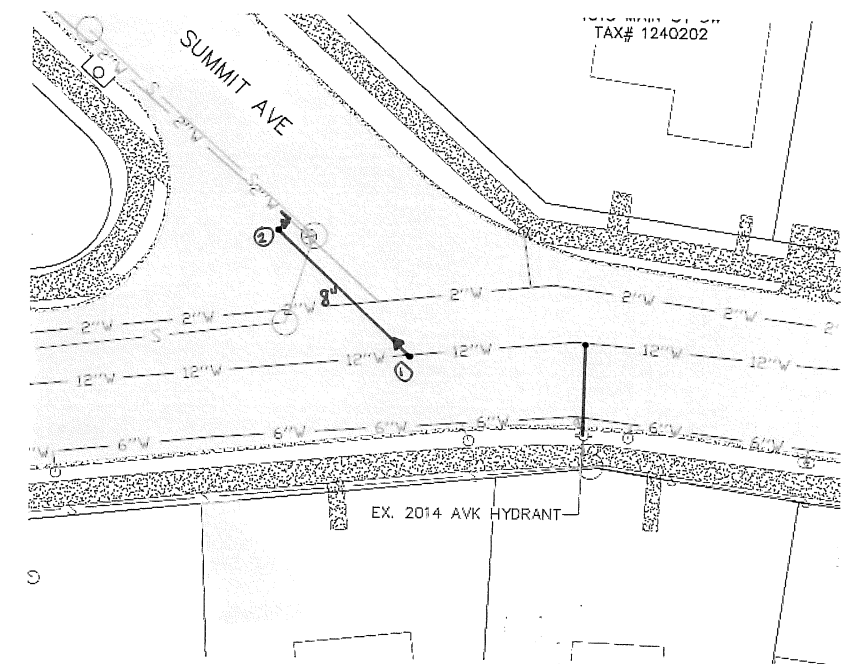

- ① 8" T/S & T/Valve
- ② 8x2 Red w/ 2" Gate Valve
- ③ Hyd. 12542 connected to 12" main

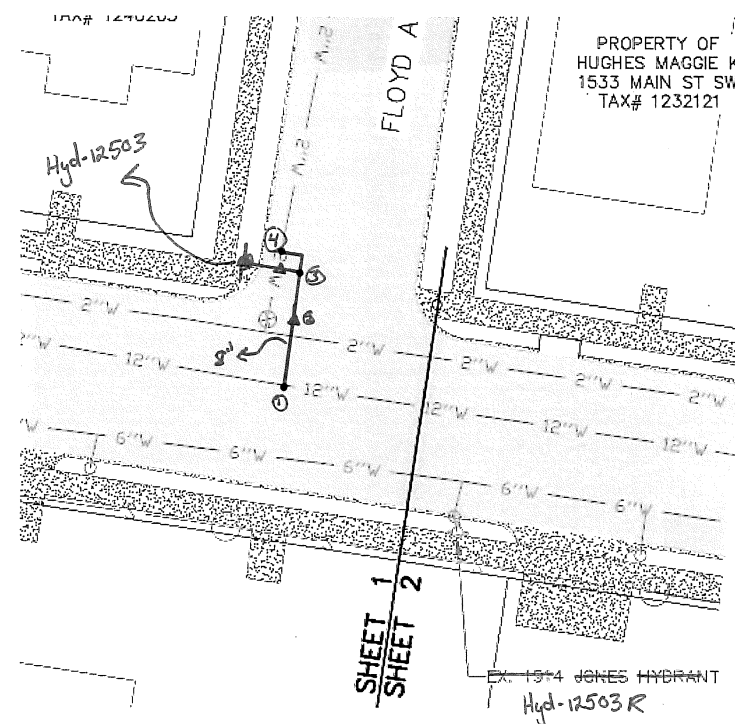

- ① 12x8 Tee
- ② 8" Gate Valve
- ③ 8x6 Tee for Hyd w/ 2" plug out of to connect

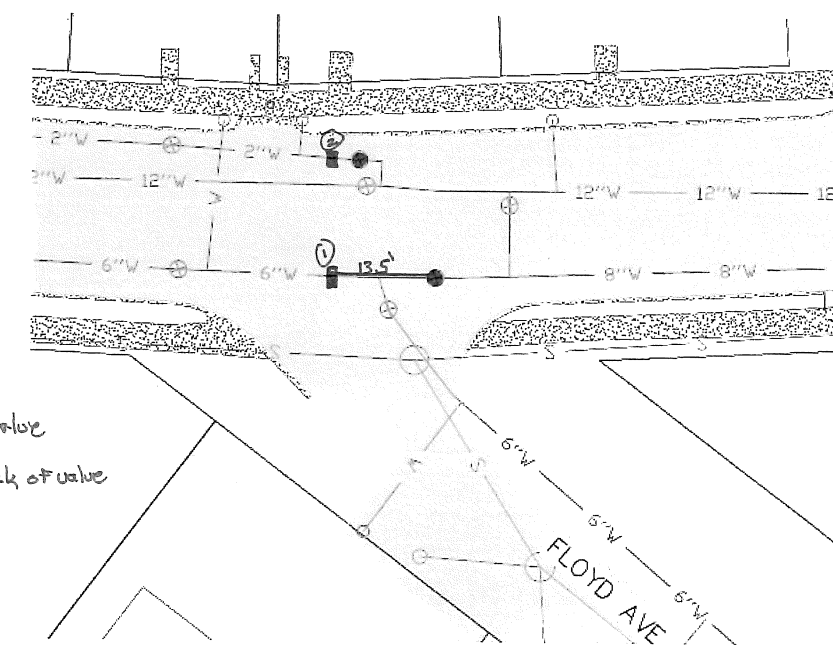

- ① 6" cap 13.5' from valve
- ② 6" cap 2' out of back of valve

Main St Waterline Abandonment
2019
Cross St Connections