


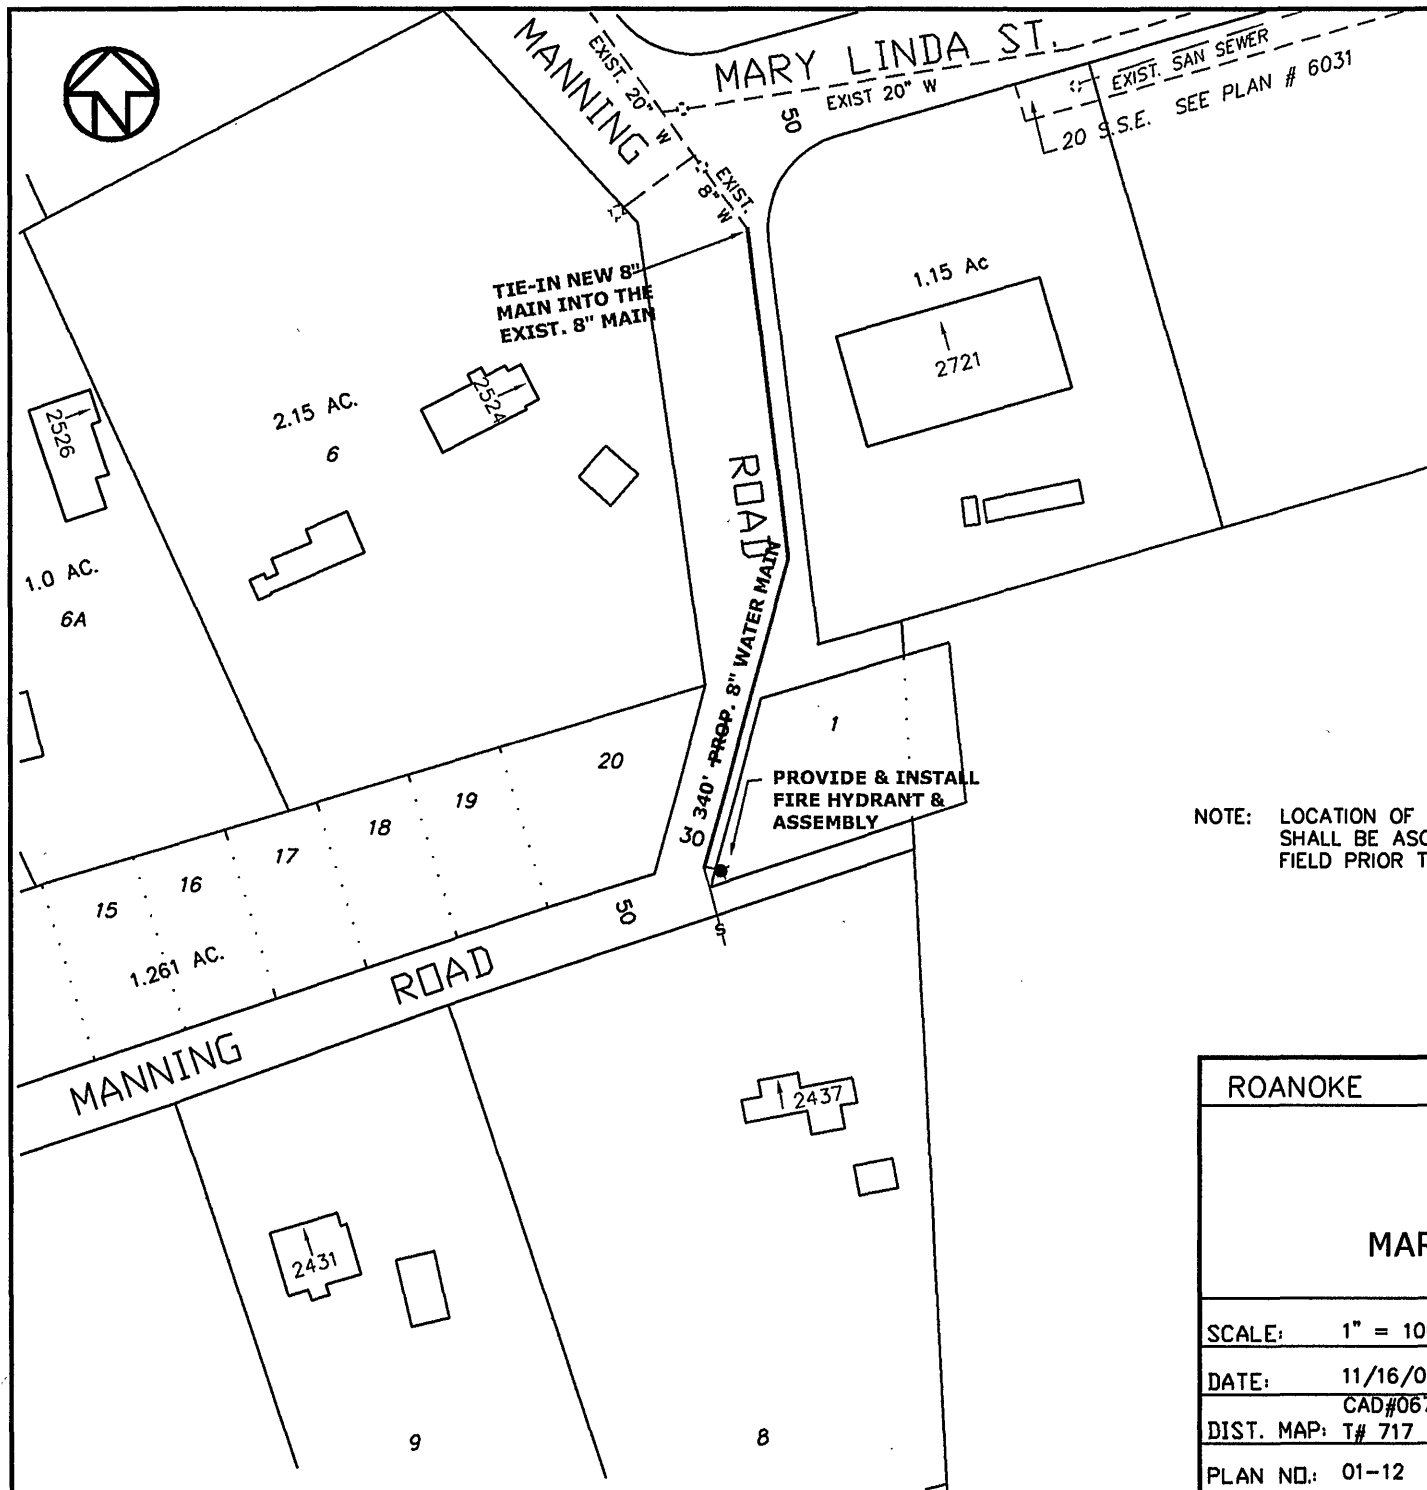

DATE STARTED:		2001		
DATE COMP.:		2001		
FEET MAIN	SIZE	VALVE	VAULT	BOX
± 340'	8"			
F.H. COMP. 1				
F.H. STUB ONLY				
SERV.INS.BY:		U.L.S.		
MAIN INS.BY:		U.L.S.		
NO. 3/4" SERV.INS.:		1		
CITY OR CO.:		City		
DEPT. INSP.		U.L.S.		

NOTE: LOCATION OF ALL UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

ROANOKE		WATER DIVISION		VIRGINIA	
MANNING STREET MARY LINDA AVENUE, N.E.					
SCALE: 1" = 100'					
DATE: 11/16/01		DIRECTOR OF UTILITIES		DATE	
CAD#0673		MANAGER OF WATER DIVISION		DATE	
DIST. MAP: T# 717		SUPERINTENDENT OF UTILITY LINE SERVICES		DATE	
PLAN NO.: 01-12					