


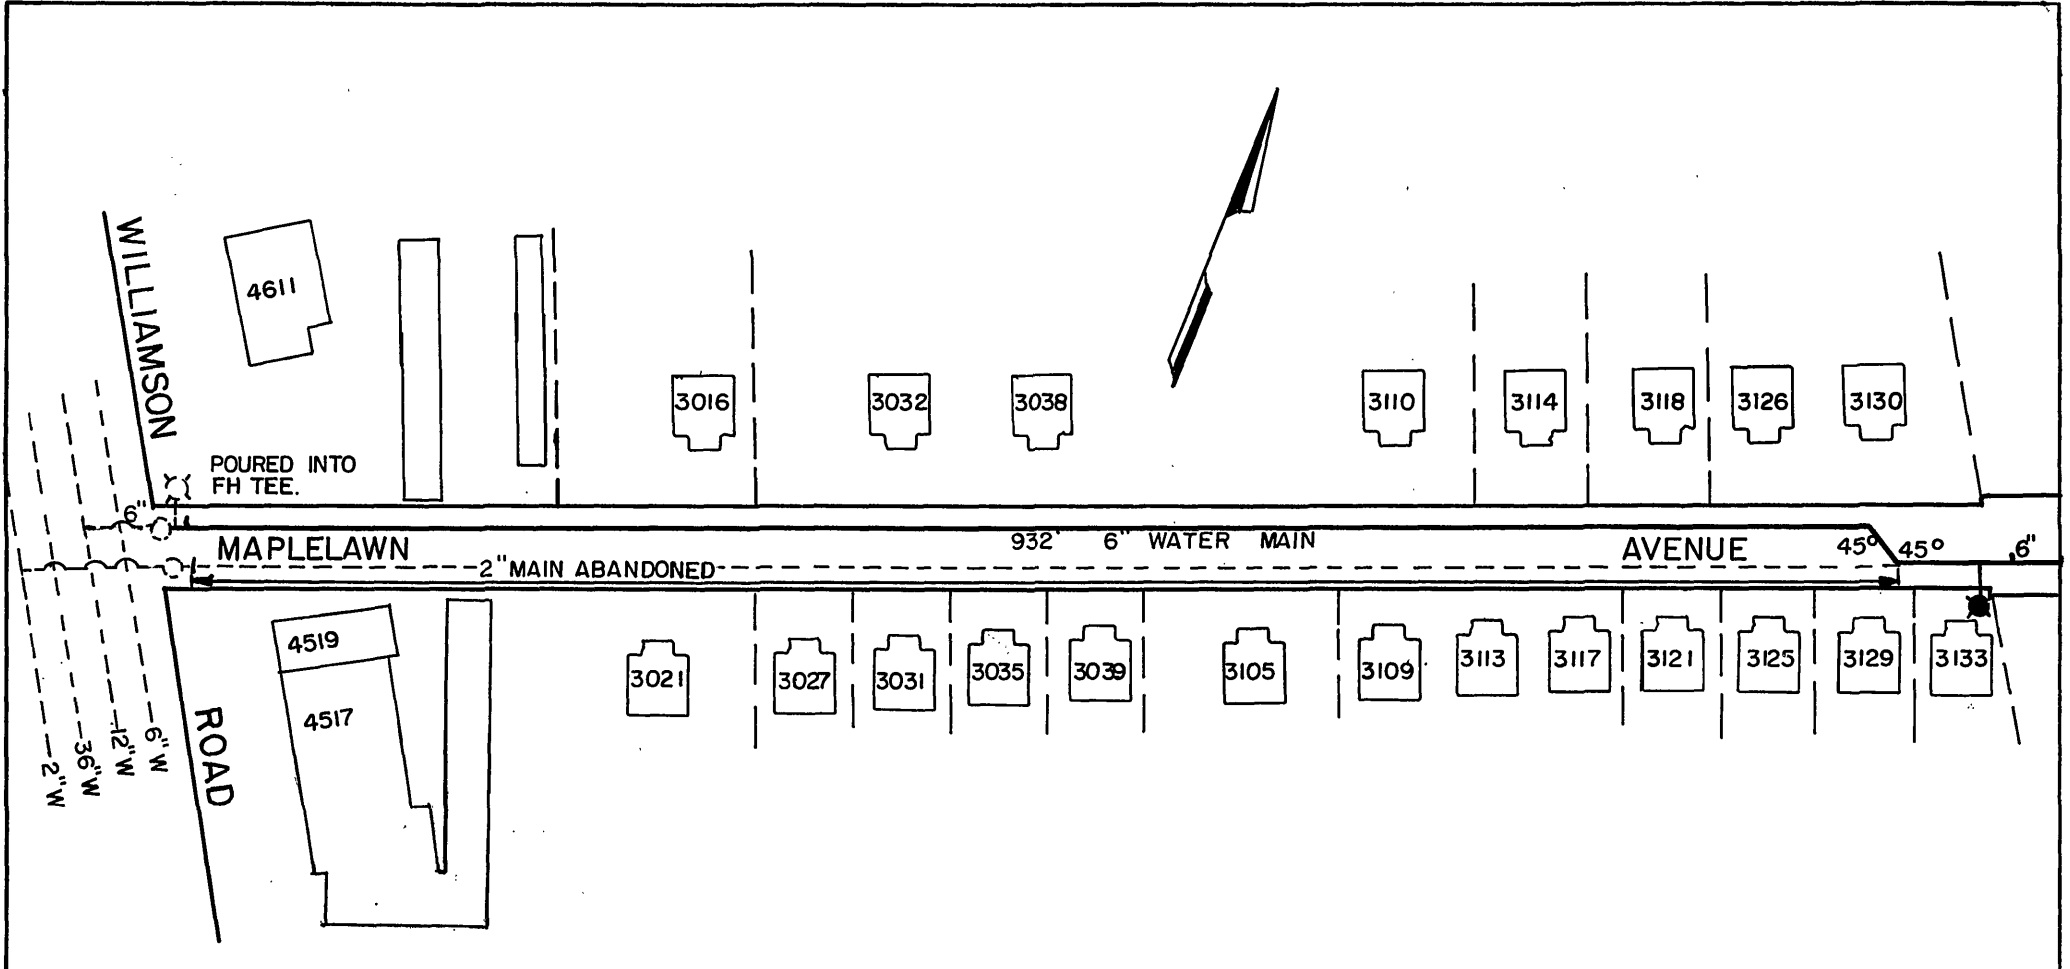

|                     |      |                    |       |     |
|---------------------|------|--------------------|-------|-----|
| DATE STARTED        |      | 10-1-90            |       |     |
| DATE COMP.          |      | 10-25-90           |       |     |
| FEET MAIN           | SIZE | VALVE              | VAULT | BOX |
| 932'                | 6"   | -                  | -     | -   |
| F. H. COMP.         |      | 1                  |       |     |
| F. H. STUB ONLY     |      | 0                  |       |     |
| SERV. INS. BY:      |      | C.O. DAME          |       |     |
| MAIN INS. BY:       |      | C.O. DAME          |       |     |
| NO. 3/4" SERV. INS. |      | ATTACHED OLD       |       |     |
| CITY OR CO.         |      | CITY               |       |     |
| DEPT. INSP.         |      | U.L.S. - C.O. DAME |       |     |

|                       |          |
|-----------------------|----------|
| WATER DEPARTMENT      |          |
| ROANOKE               | VIRGINIA |
| MAPLELAWN AVENUE, NE. |          |
| REPLACEMENT           |          |

|                  |                                 |      |
|------------------|---------------------------------|------|
| SCALE: 1" = 100' | DIRECTOR UTILITIES & OPERATIONS | DATE |
| DATE: 11-16-90   |                                 |      |
| DIST. MAP: 217   |                                 |      |
| PLAN NO.: 90-17  | DIRECTOR OF PUBLIC WORKS        | DATE |