

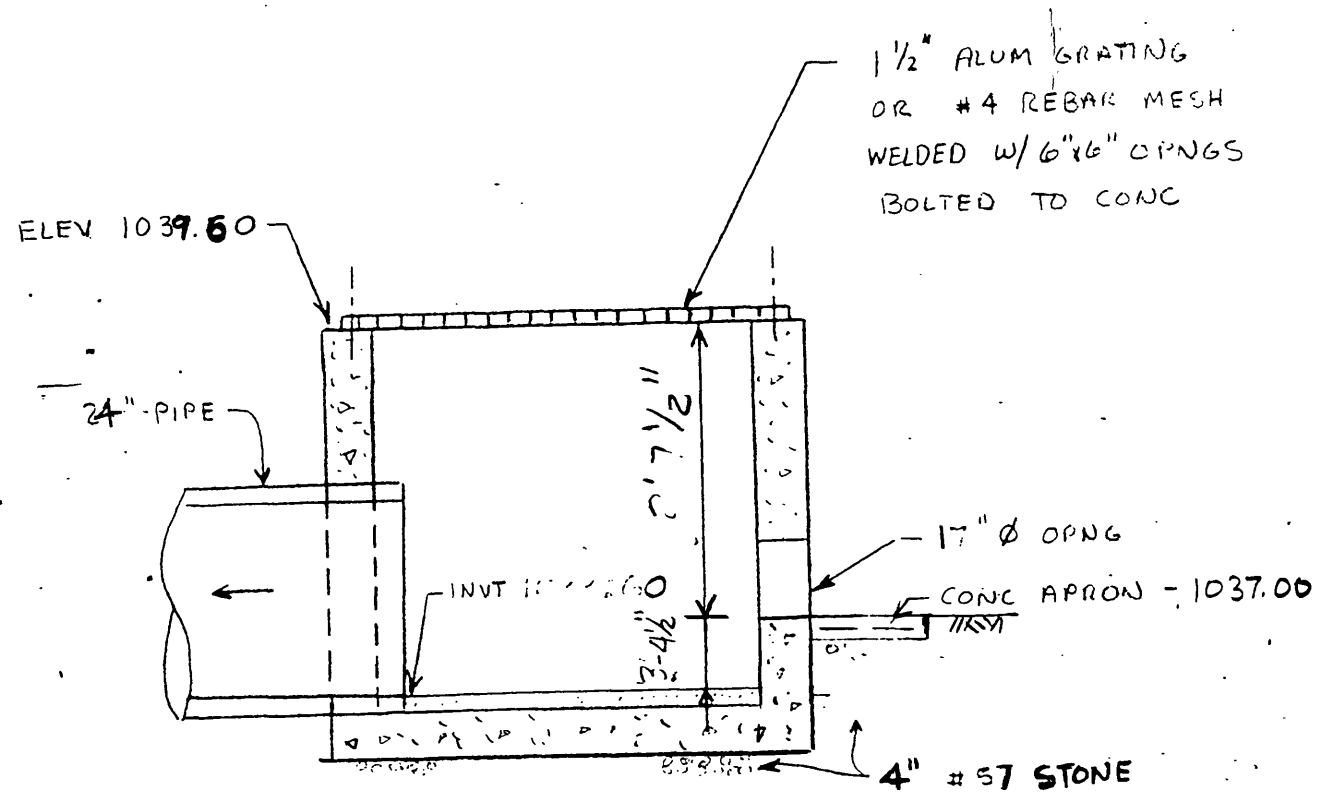
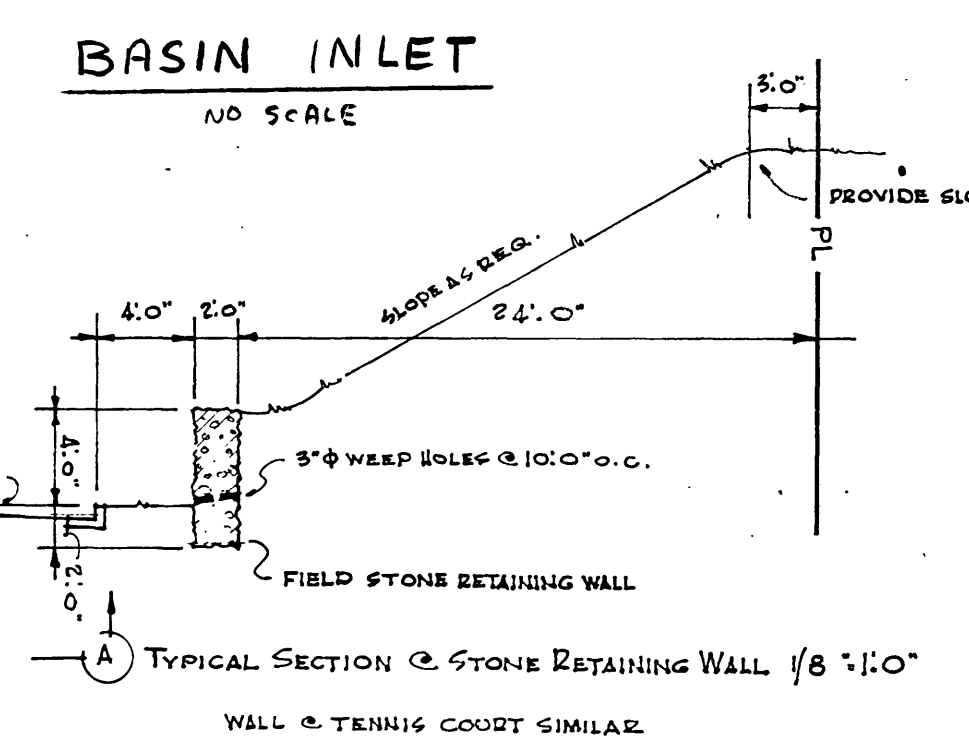
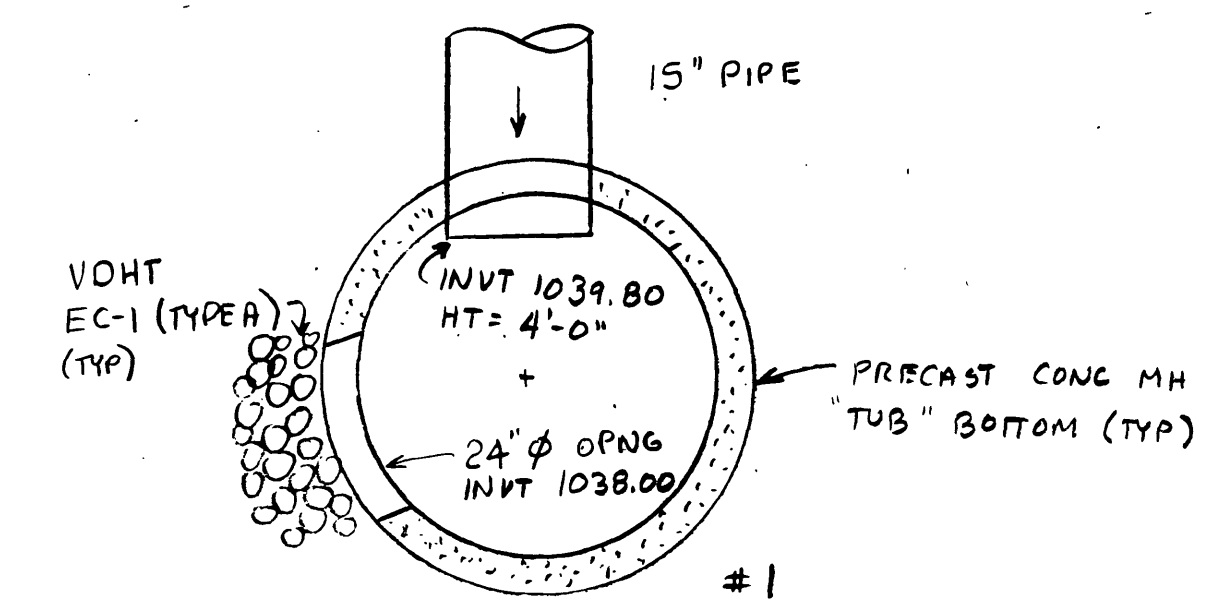


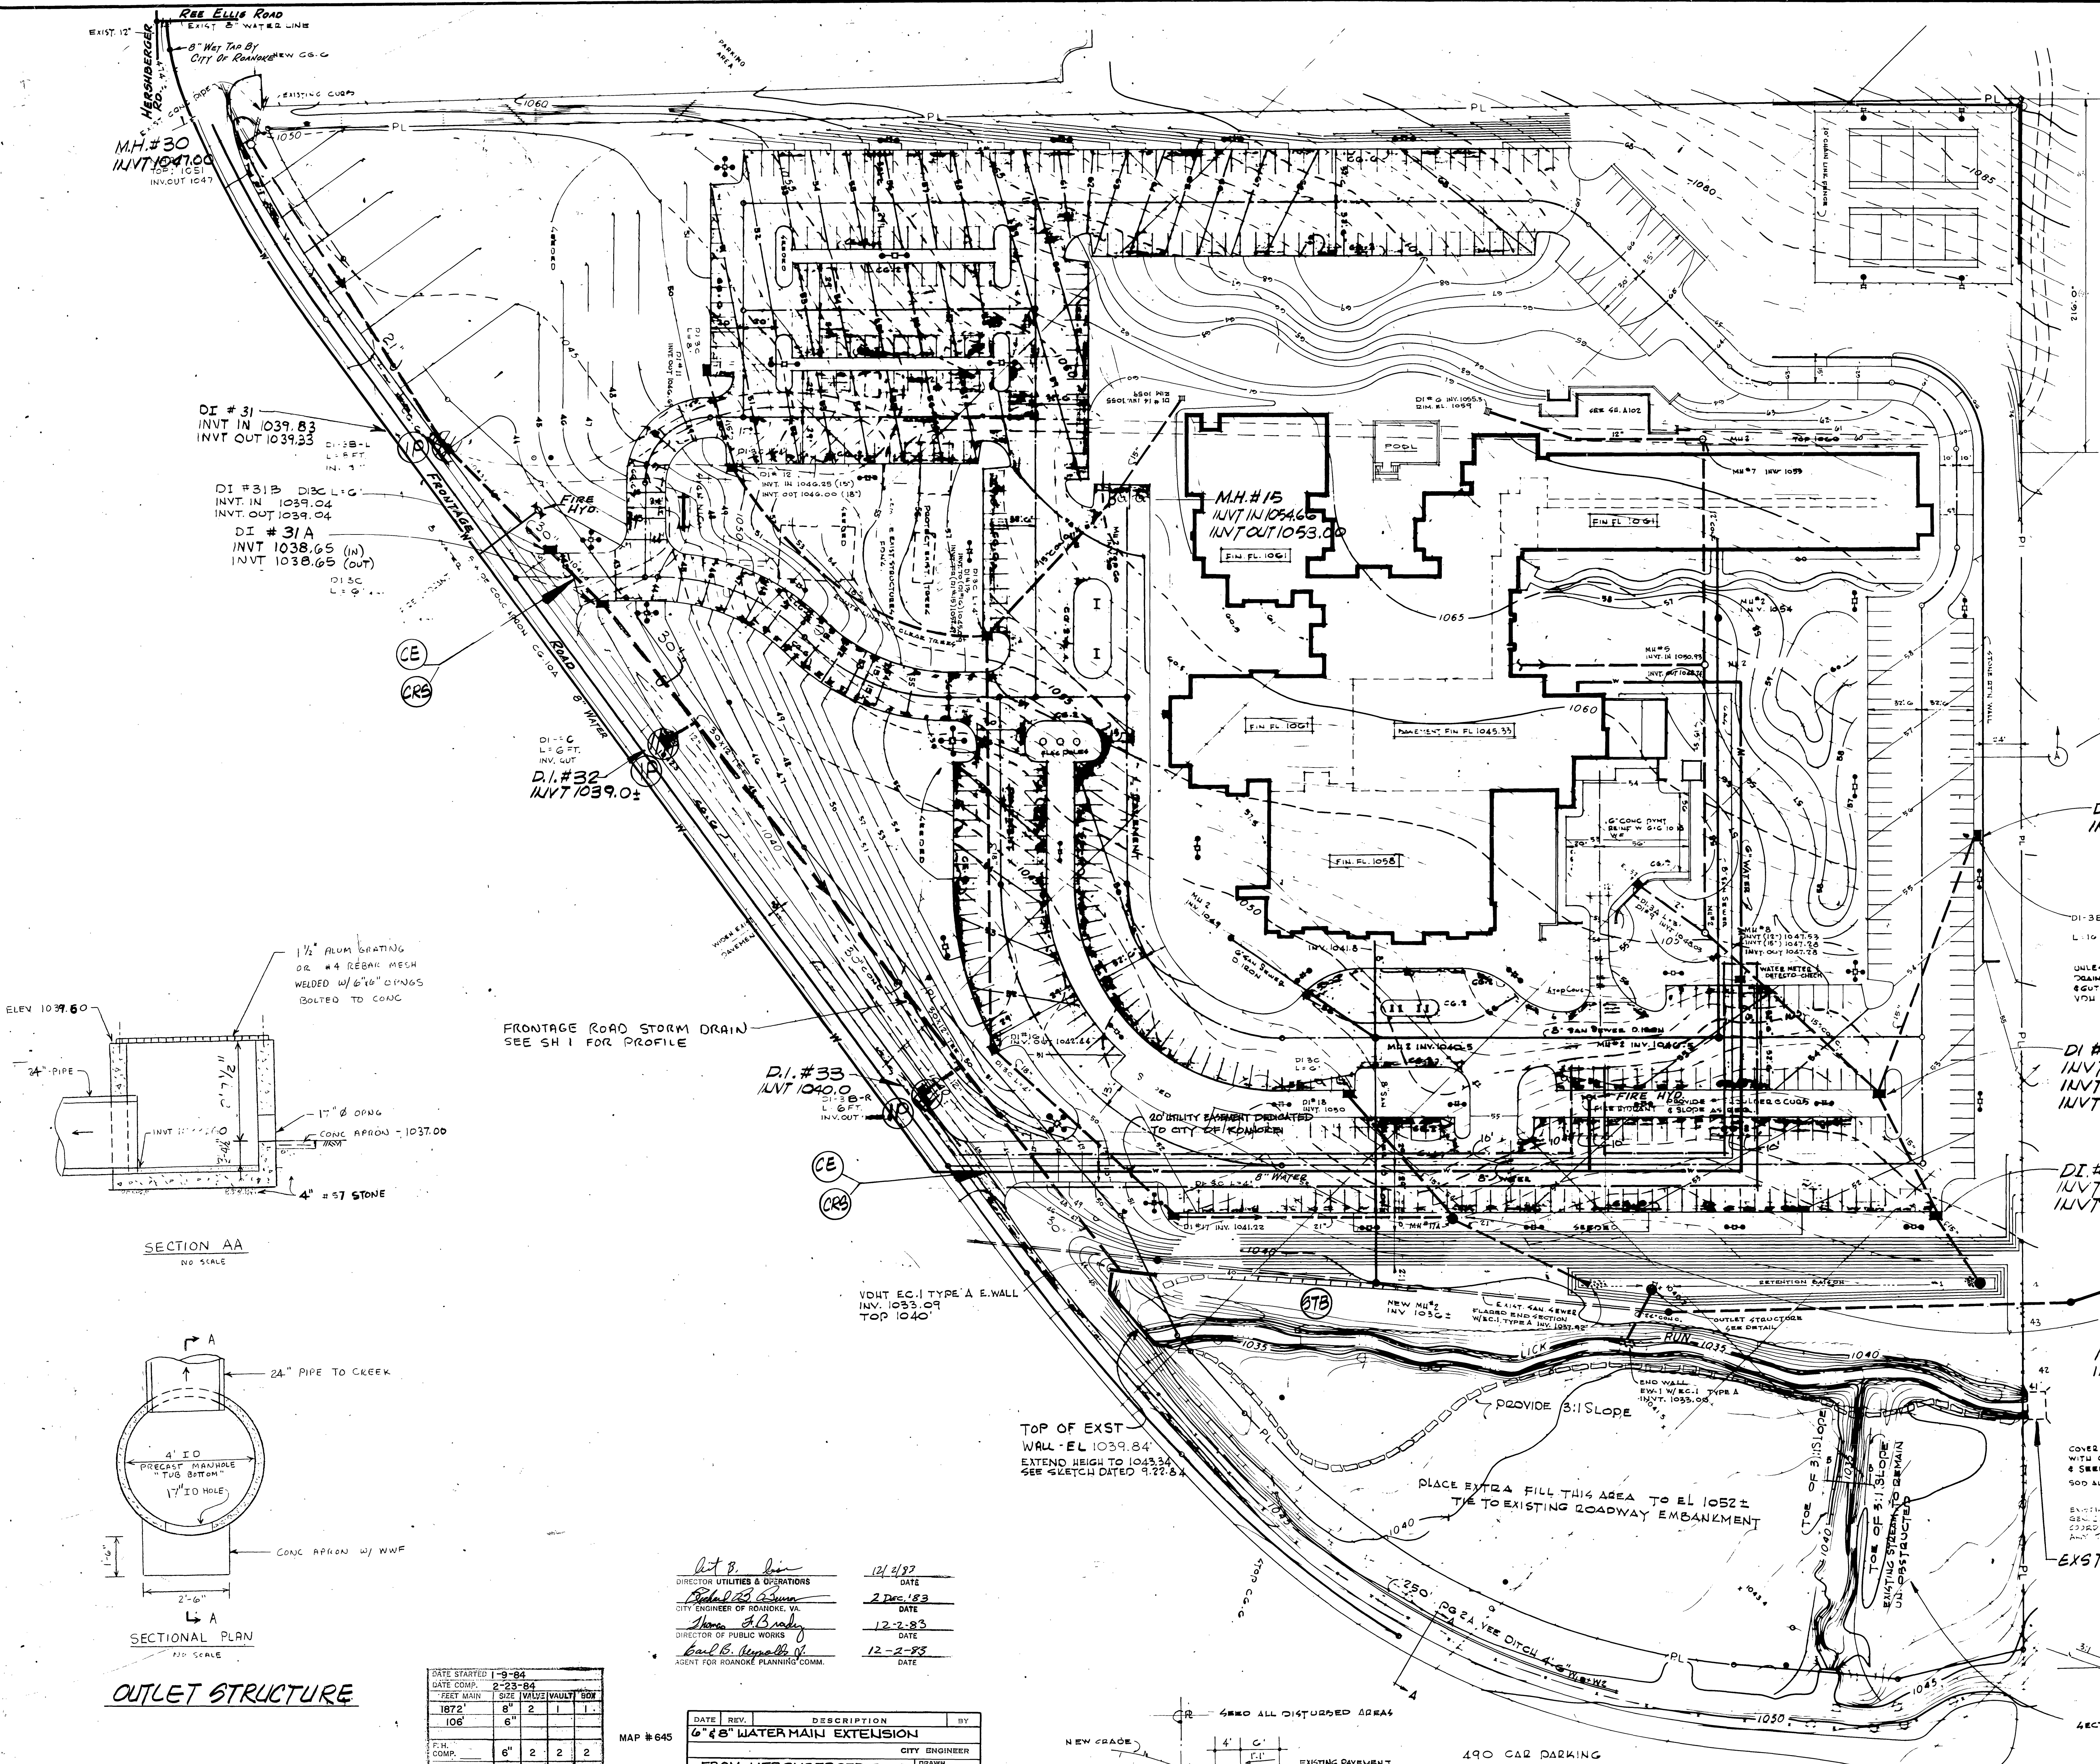

SECTION AA
NO SCALE

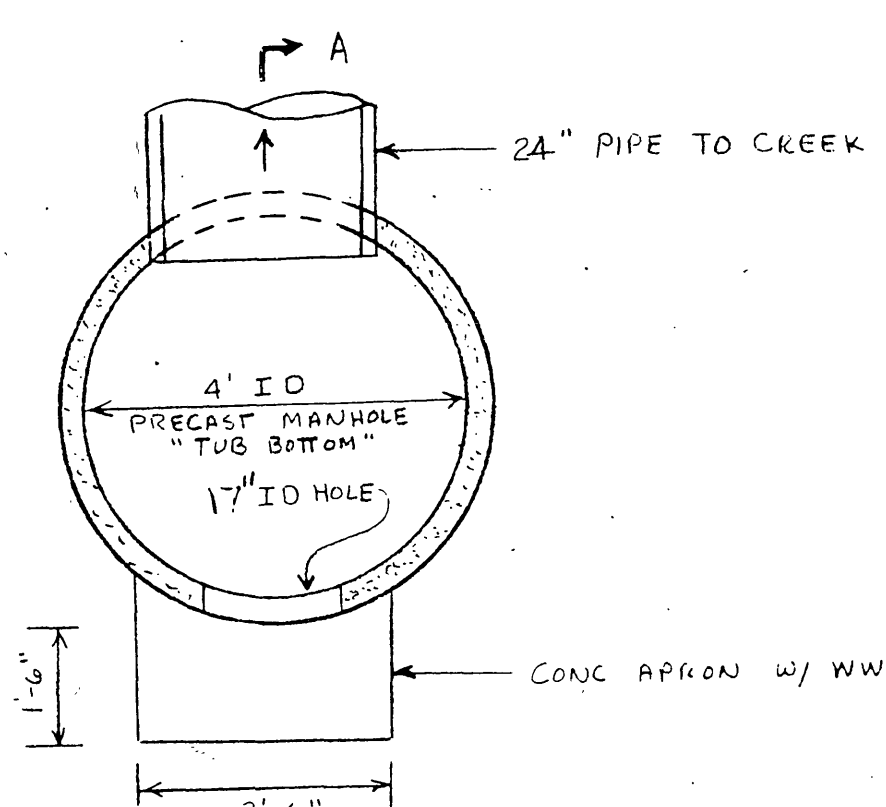

SECTIONAL PLAN
NO SCALE

OUTLET STRUCTURE

DATE STARTED	1-9-84
DATE COMP.	2-23-84
FEET MAIN	1872
SIZE	6"
VALVE/VAULT	2
BOX	2
F.H. COMP.	6"
F.H. STUB ONLY	2
SERV. INS. BY	J.C. MOTLEY
CH. INS. BY	A.J. CONNER
NO. OF SERV. INS.	2
CITY OR CO.	CITY
DEPT. INSP.	J.C. MOTLEY

MAP #645

At 8. di
 DIRECTOR UTILITIES & OPERATIONS
 Robert L. G. Summ
 CITY ENGINEER OF ROANOKE, VA.
 Date 12-2-83
 Date 12-2-83
 Date 12-2-83
 Date 12-2-83

DATE	REV.	DESCRIPTION	BY
12-2-83	1	6" x 8" WATER MAIN EXTENSION	AT 8. di
12-2-83	2	FROM HERSHBERGER ROAD DOWN FRONTAGE ROAD TO MARRIOTT INN	Robert L. G. Summ
12-2-83	3	ROANOKE, VIRGINIA	Robert L. G. Summ
12-2-83	4	CITY OF ROANOKE	Robert L. G. Summ
12-2-83	5	OFFICE OF CITY ENGINEER	Robert L. G. Summ
12-2-83	6	ROANOKE, VIRGINIA	Robert L. G. Summ
12-2-83	7	CONTRACTOR MUST VERIFY ALL DIMENSIONS AT PROJECT BEFORE PROCEEDING WITH WORK	Robert L. G. Summ

CHECKED
 APP'D
 DATE 11/11/83
 83-09
 SHEET 1
 OF 1

BENCH EXISTING EMBANKMENT FOR THE IN OFFILL ALL WALL TO BE PER VDOT ST04
 EXISTING GRADE
 TYPICAL SHOULDER CROSSSECTION A-A
 1" = 10'

NOTES: EROSION CONTROL SHALL COMPLY W/ ROANOKE EROSION & SEDIMENT CONTROL MANUAL. SYMBOLS FOR EROSION CONTROL FEATURES ARE FROM THE MANUAL (ALSO VIRGINIA MANUAL) & ARE THE MINIMUM REQUIREMENTS. TEMPORARY SEEDING WILL BE REQUIRED ON EMBANKMENTS.

(1) ONE HUNDRED YR FLOOD PLAIN @ 1035
 (2) ANY EXCESS FILL MATERIAL SHALL BE PLACED ON THE NORTHEAST SIDE OF LICK RUN, ONLY ON GROUND ABOVE EXST. ELEV 1040.

EROSION CONTROL PLAN	
REV 8/29/83	REV 10-14-83
REV 7/25/83	REV 9/17/83
T. A. CARTER, JR., ARCHITECT	SALEM, VIRGINIA
COMM: 1607	NAME: MARRIOTT INN
DATE: 12-14-83	LOCATION: ROANOKE, VIRGINIA
SCALE: 1" = 40'	SITE PLAN

Marriott Inn