GENERAL NOTES:

1. SEWER LATERALS SHOWN ARE BASED ON CCTV FOOTAGE. ADDITIONAL LATERALS & CONFLICTS SHALL BE INVESTIGATED BY CONTRACTOR PRIOR TO EXCAVATION.
2. PROPERTY LINES SHOWN ON THIS PAGE ARE BASED ON GIS DATA AND HAVE NOT BEEN FIELD SURVEYED.

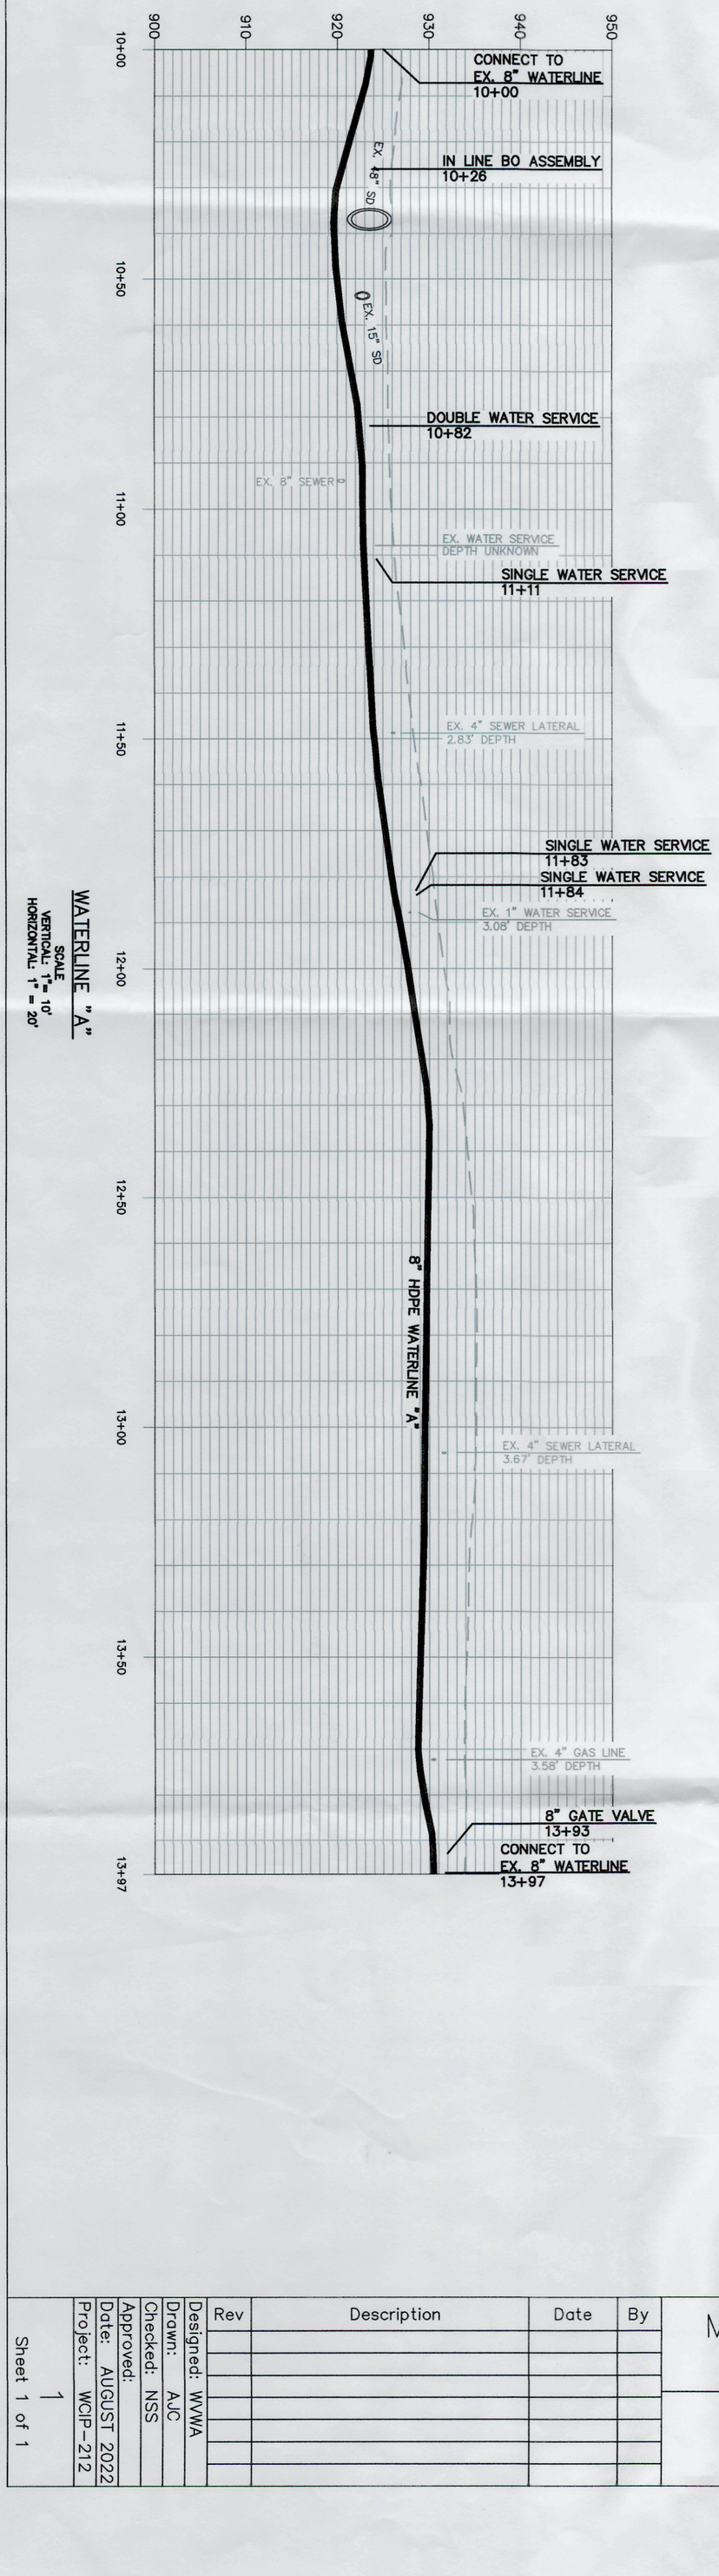

WATERLINE "A"

SCALE
VERTICAL: 1"= 10'
HORIZONTAL: 1" = 20'

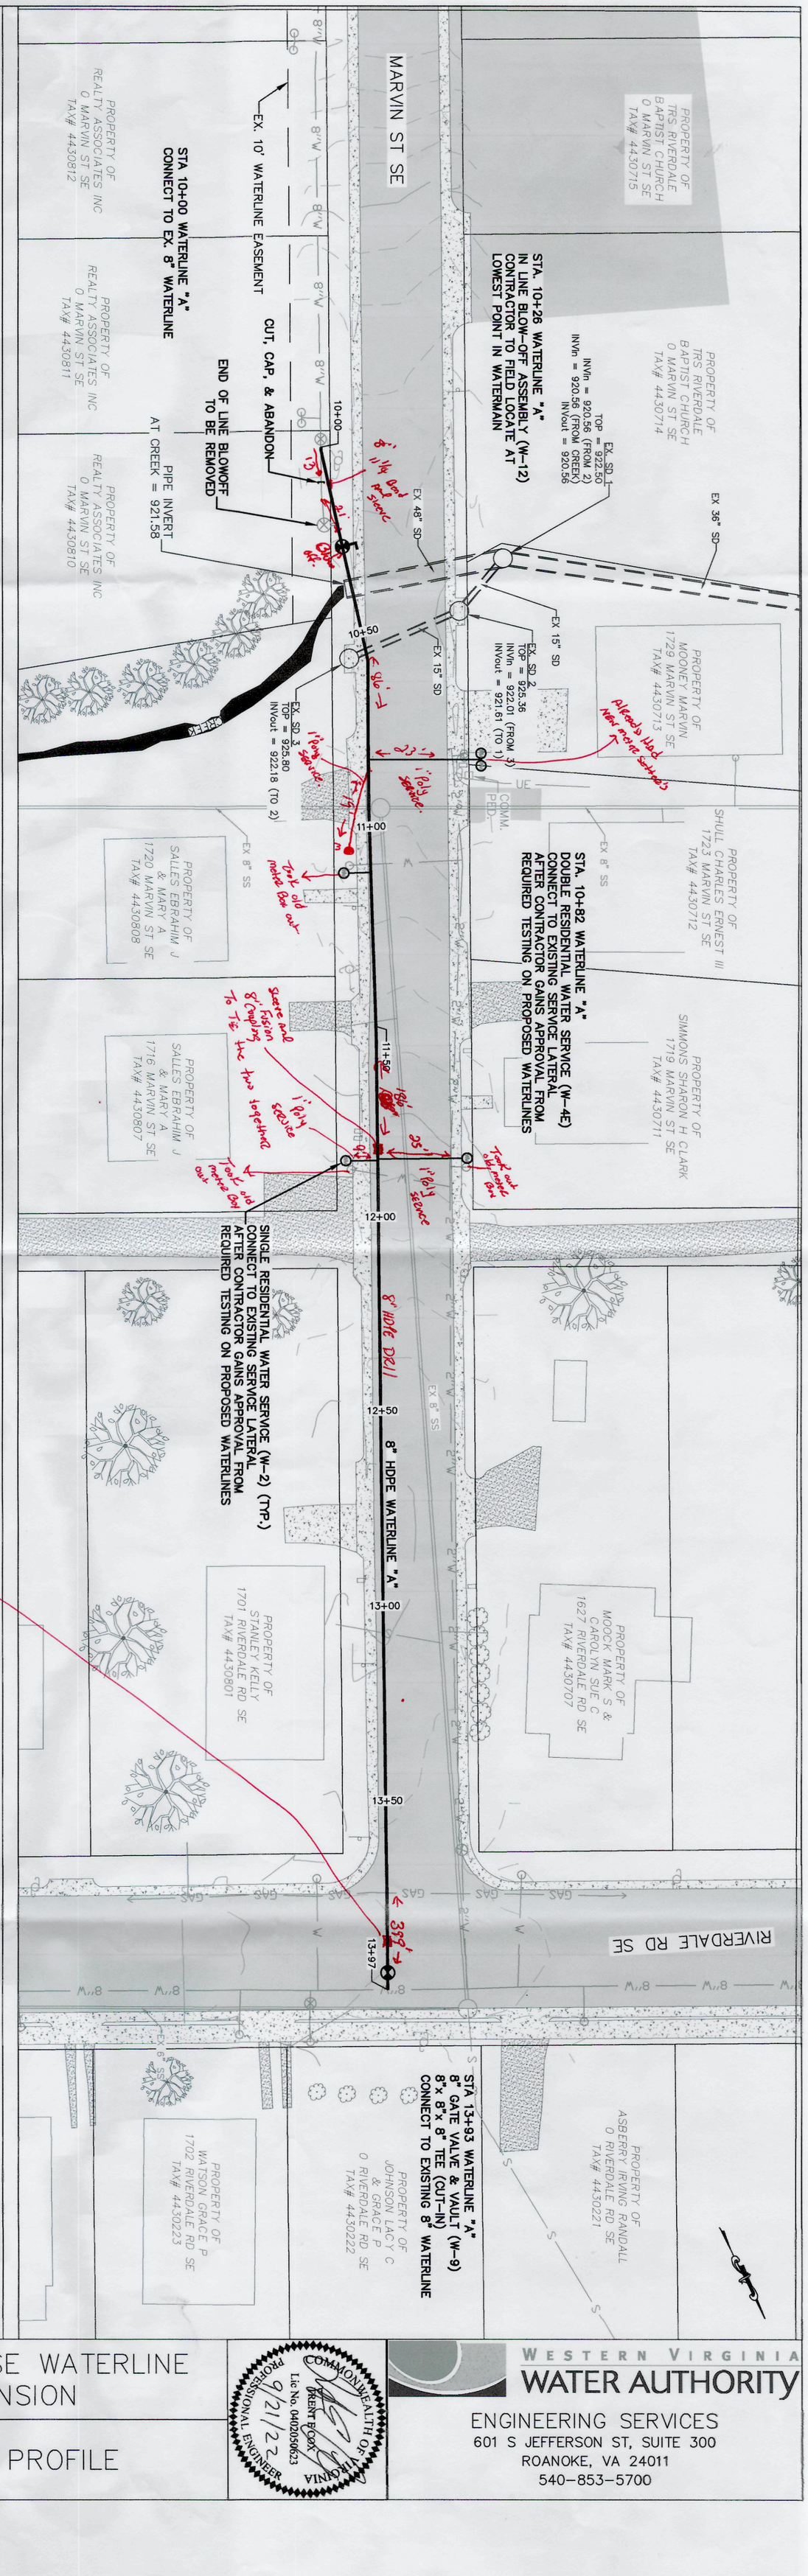

4' from 8" valve is a 8" fusion coupling and 4' of 8" Ductile pipe from valve to the 8" fusion coupling.

Rev	Description	Date	By

Designed: WVWA
Drawn: AJC
Checked: NSS
Approved:
Date: AUGUST 2022
Project: WCIP-212

1
Sheet 1 of 1

MARVIN ST SE WATERLINE EXTENSION

PLAN & PROFILE

COMMONWEALTH OF VIRGINIA
TRENT BOOK
Lic No. 040205623
PROFESSIONAL ENGINEER
9/21/22

WESTERN VIRGINIA WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700