



04217comp01.dwg

04217comp01.dwg

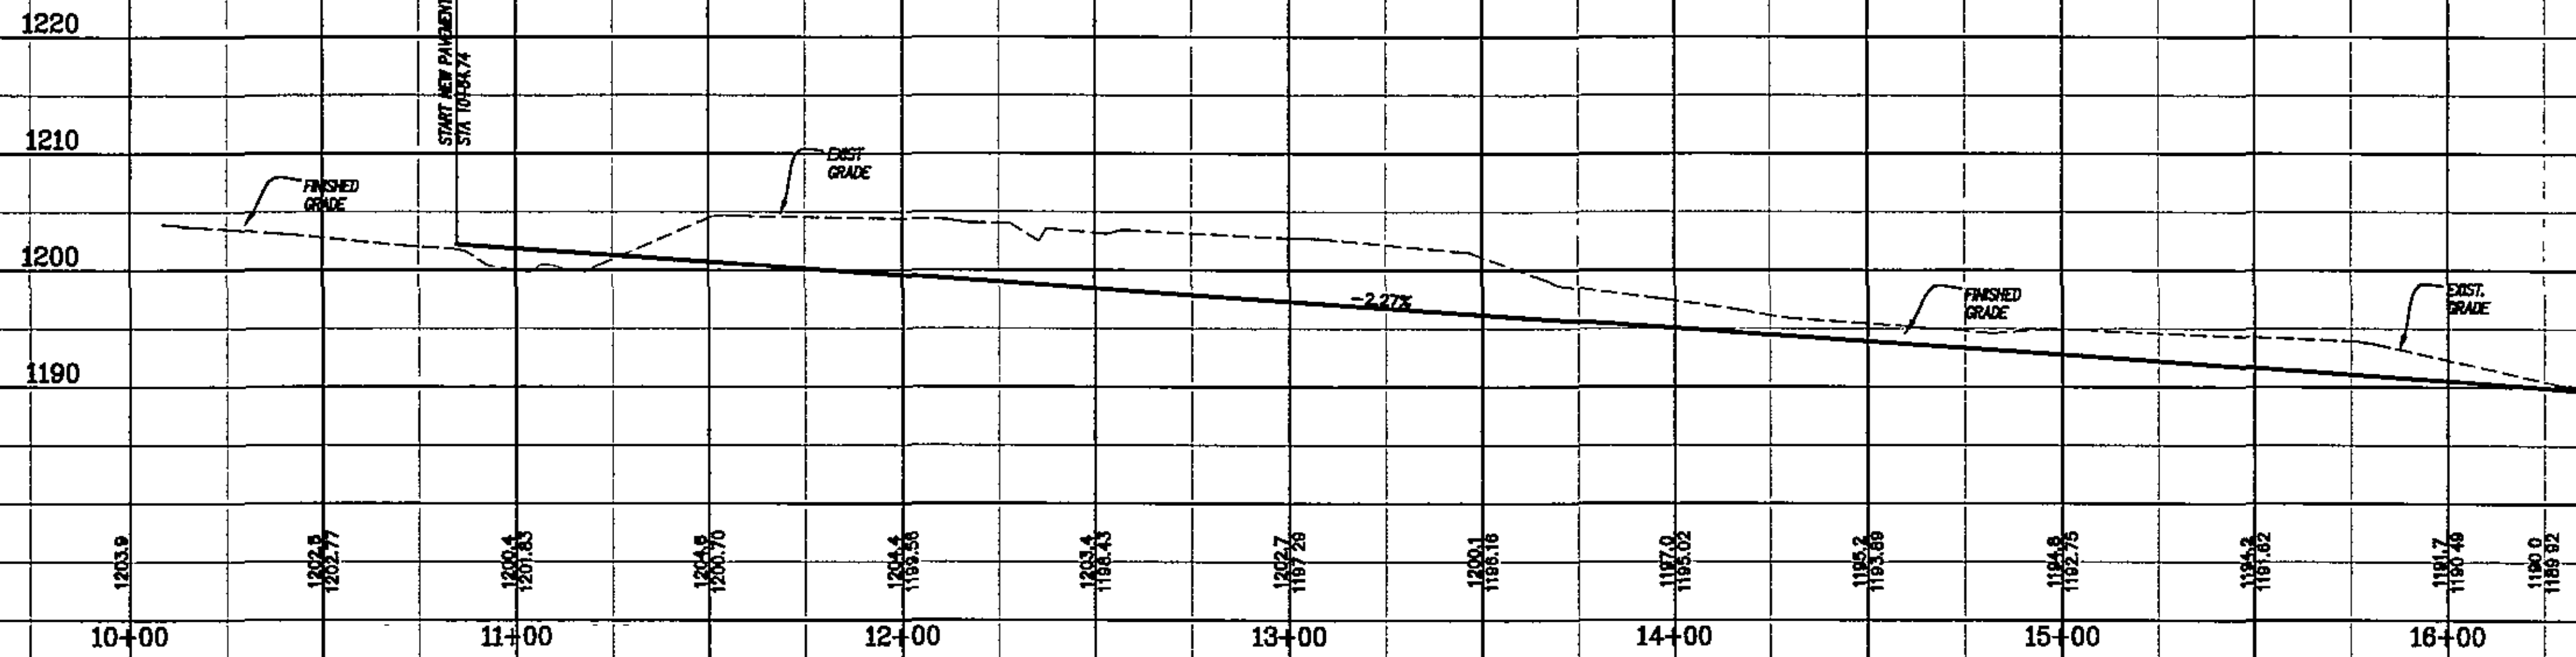


ENTRANCE ROAD

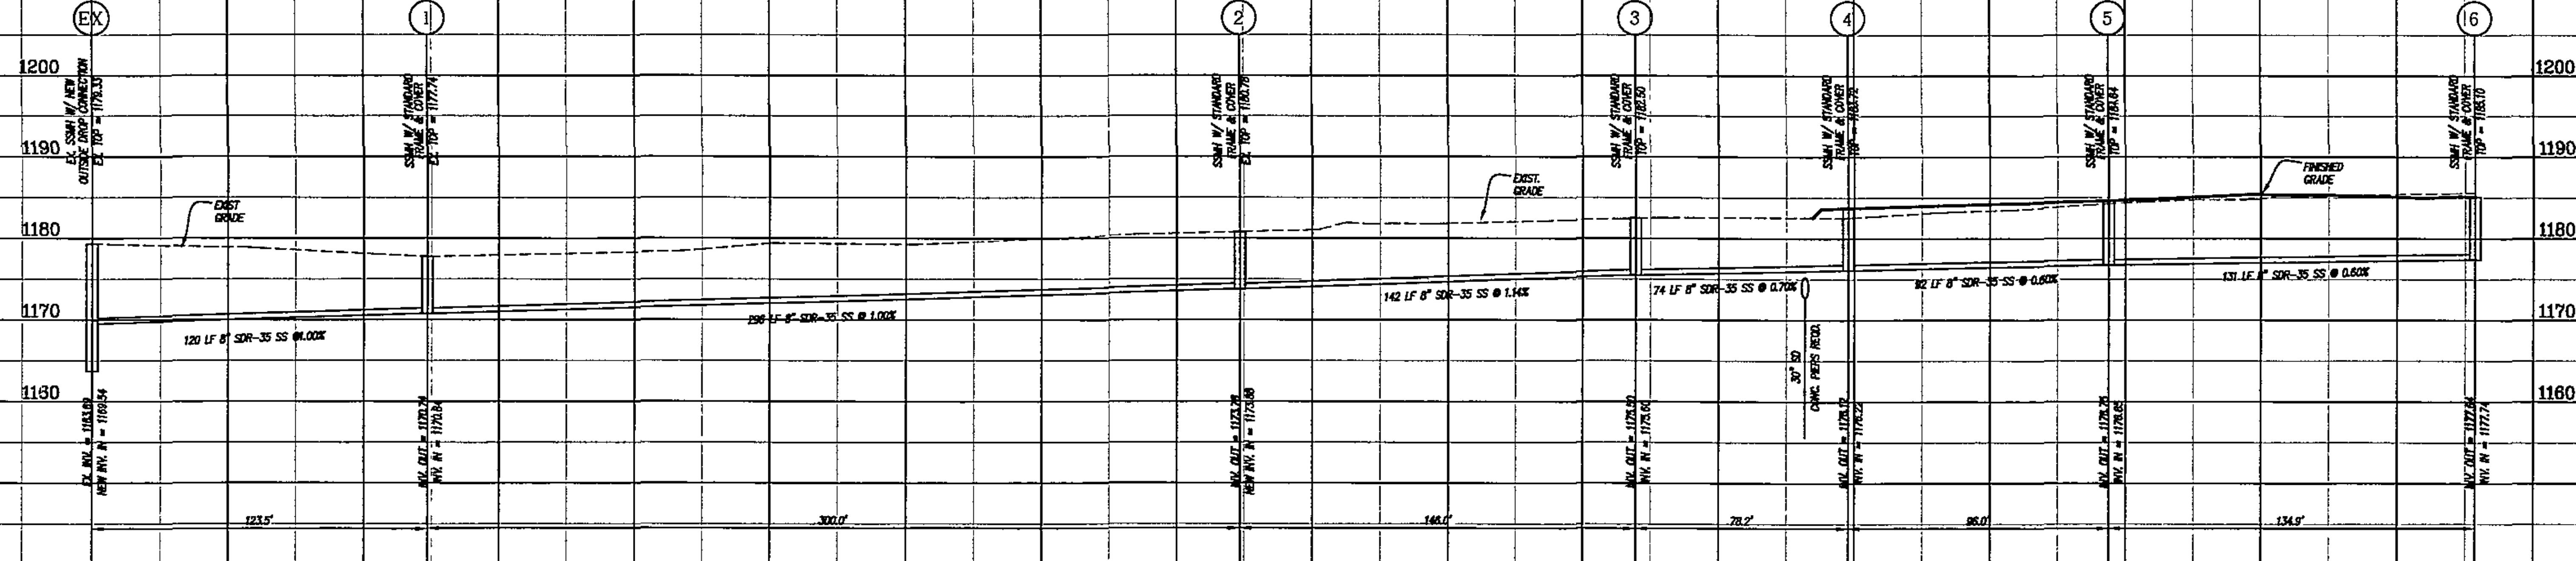


SANITARY SEWER

SANITARY SEWER

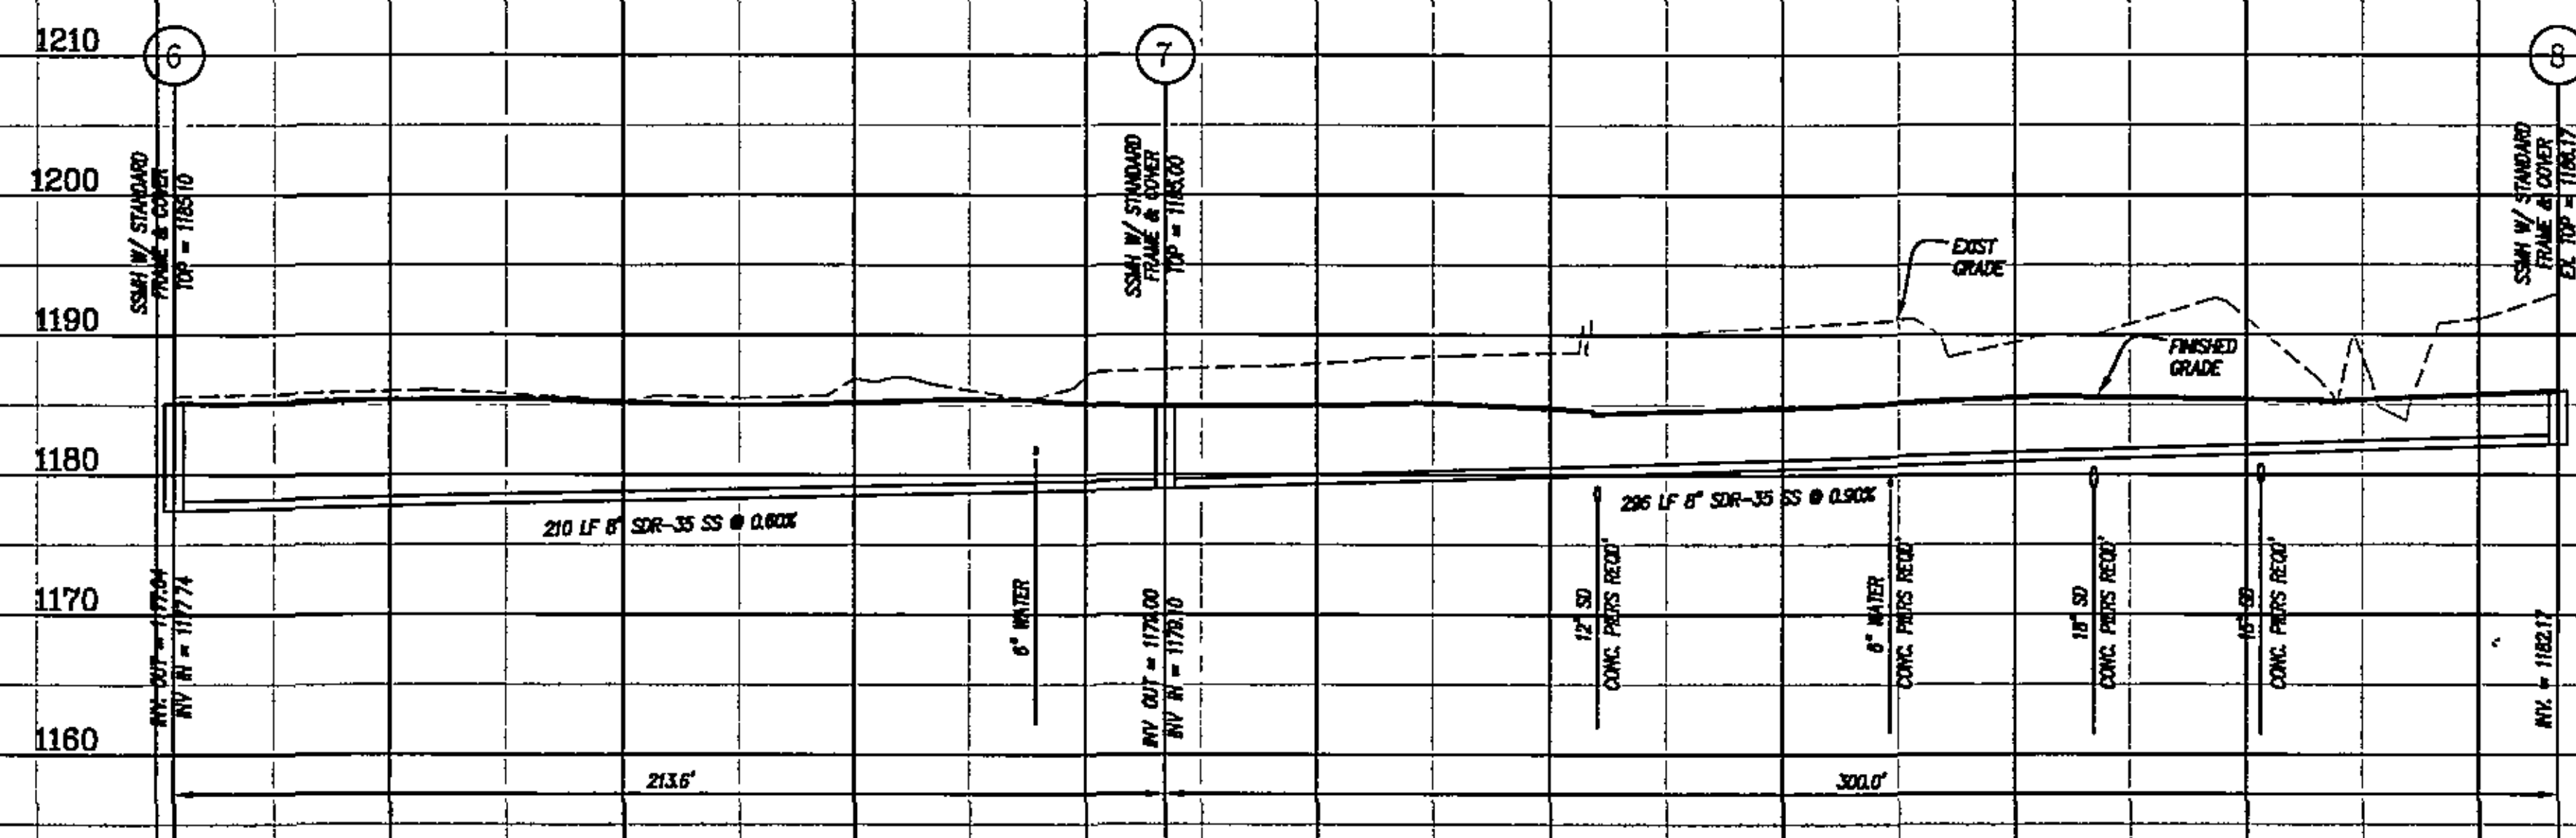

SANITARY SEWER

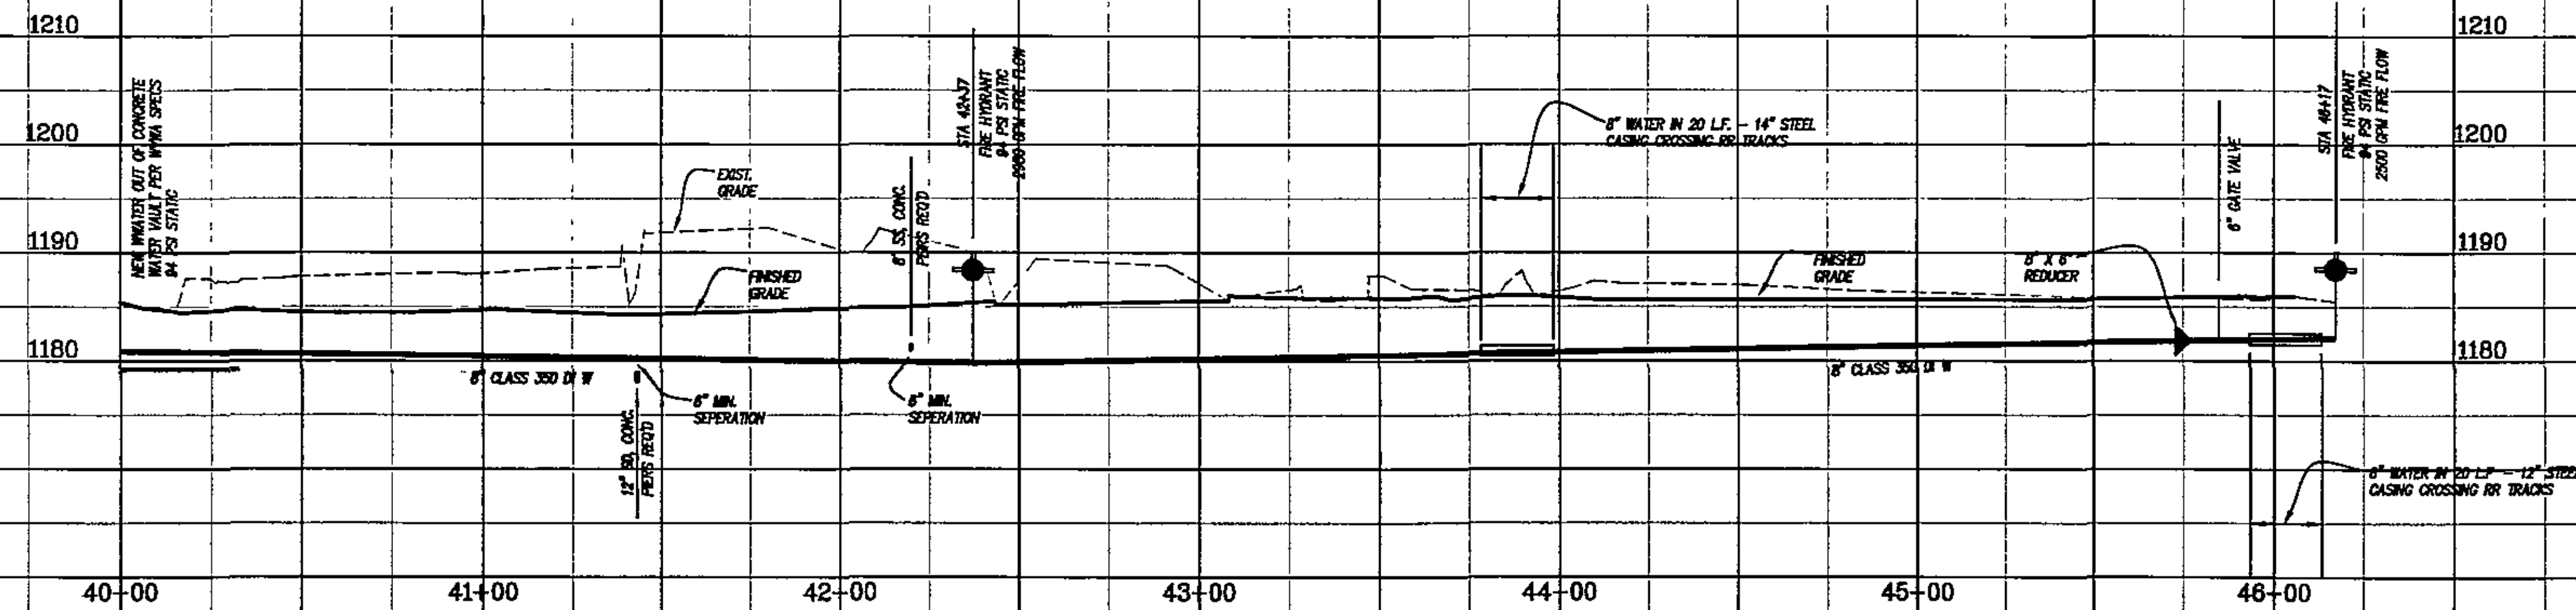


WATER LINE

NOTES

1. ALL WATER AND SANITARY SEWER LINES TO HAVE MINIMUM OF 3.0 FEET OF COVER.
2. SANITARY SEWER LINE SHALL BE SDR-35 PVC UNLESS OTHERWISE NOTED. SANITARY SEWER LINES AT DEPTHS 12' OR GREATER SHALL BE SDR-26, OR SDR-21, OR CONCRETE ENCASED SDR-35.
3. WATER LINE SHALL BE CLASS 350 DUCTILE IRON UNLESS OTHERWISE NOTED.
4. SANITARY SEWER CONNECTION TO EXISTING MANHOLE SHALL BE DECATYED BY THE CONTRACTOR AND CENTERMARKED FOR TAPPING. TAP TO BE PERFORMED BY THE WESTERN VIRGINIA WATER AUTHORITY AT THE CONTRACTOR'S EXPENSE.

LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

4654 BRAMBLETON AVENUE
P.O. BOX 2069
ROANOKE, VIRGINIA 24018

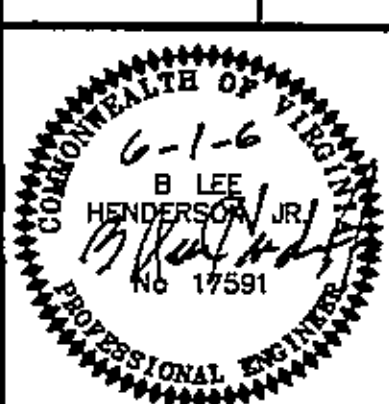

ROAD, WATER & SANITARY
SEWER PROFILES

MENNEL MILLING CO. FLOUR MILL
PREPARED FOR
MENNEL MILLING COMPANY
CAVE SPRING MAGISTERIAL DISTRICT
ROANOKE COUNTY, VIRGINIA

NO.	DATE	DESCRIPTION
1		
2		
3		
4		
5		

DATE: JUNE 1, 2006
SCALE: 1"=30'(H), 1"=10'(V)
COMMISSION NO.: 04-21718E
SHEET 10 OF 16