


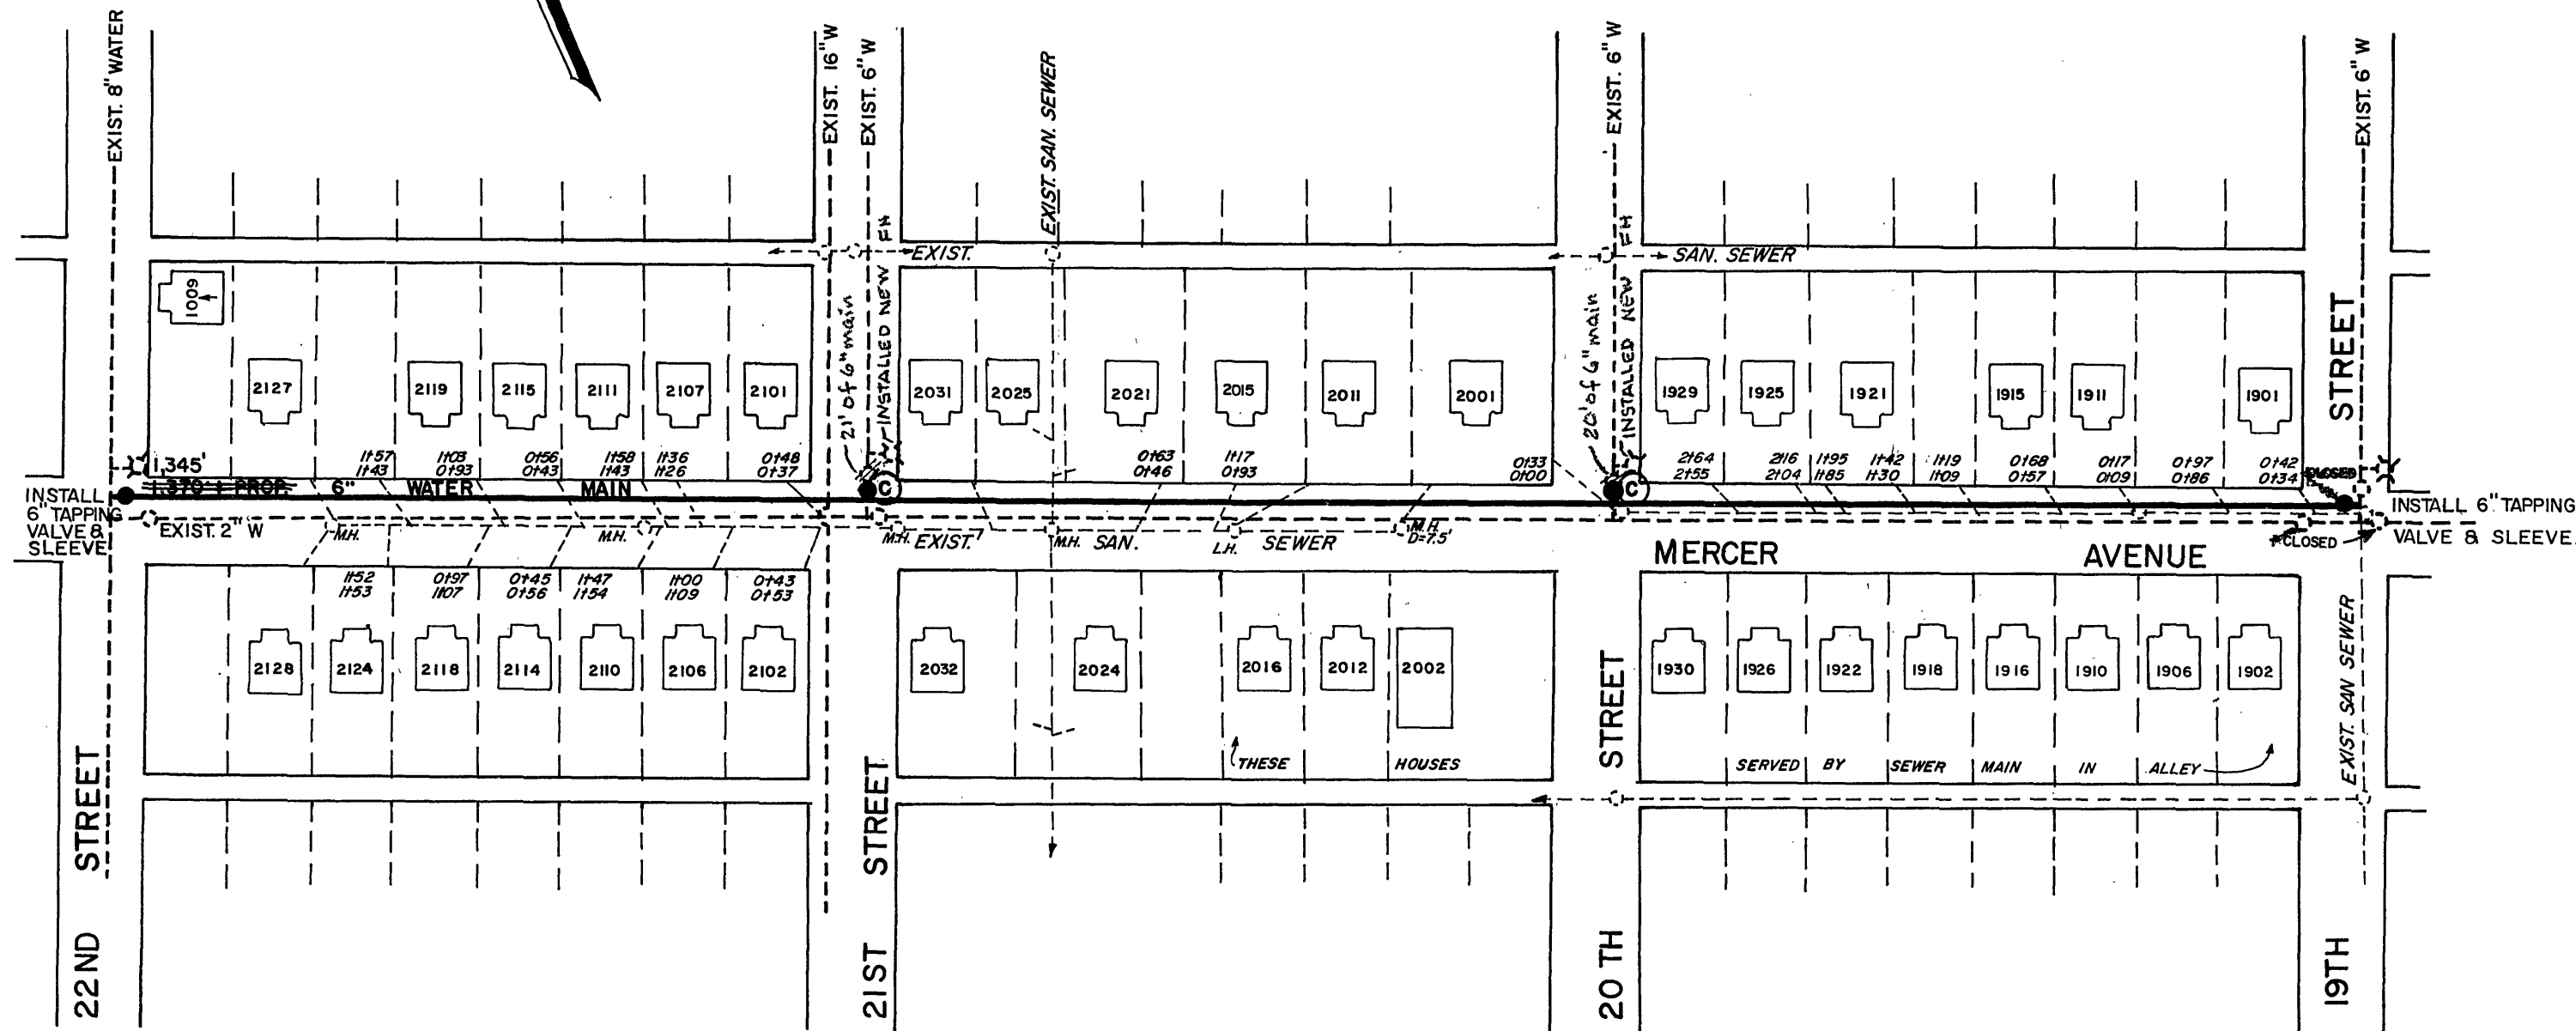

NOTES:

- (C) CONNECT NEW 6" MAIN TO EXIST. 6" WHERE MAINS CROSS IN 20TH & 21ST STREETS.
- EXIST. 2" MAIN TO BE ABANDONED AFTER COMPLETED SERVICES TIED INTO NEW 6" MAIN.
- ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.
- 6" VALVE TO BE CLOSED IN 19TH STREET.

DATE STARTED	1-29-90
DATE COMP.	4-12-90
FEET MAIN	SIZE VALVE VAULT BOX
1,386'	6" 4 4 #2
F.H. COMP. 2	6"
F.H. STUB ONLY	
SERV. INS. BY: C.O. DAME	
MAIN INS. BY: C.O. DAME	
NO. 3/4" SERV. INS. 38	
CITY OR CO. CITY	
DEPT. INSP. U.L.S.	

WATER DEPARTMENT	
ROANOKE VIRGINIA	
MERCER AVENUE, NW	
FROM	
19TH STREET TO 22ND STREET	
SCALE: 1" = 100'	
DATE: 11/29/89	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 233	
PLAN NO.: 89-05	DIRECTOR OF PUBLIC WORKS DATE

John H. P. [Signature]
MANAGER UTILITY LINE SERVICES