



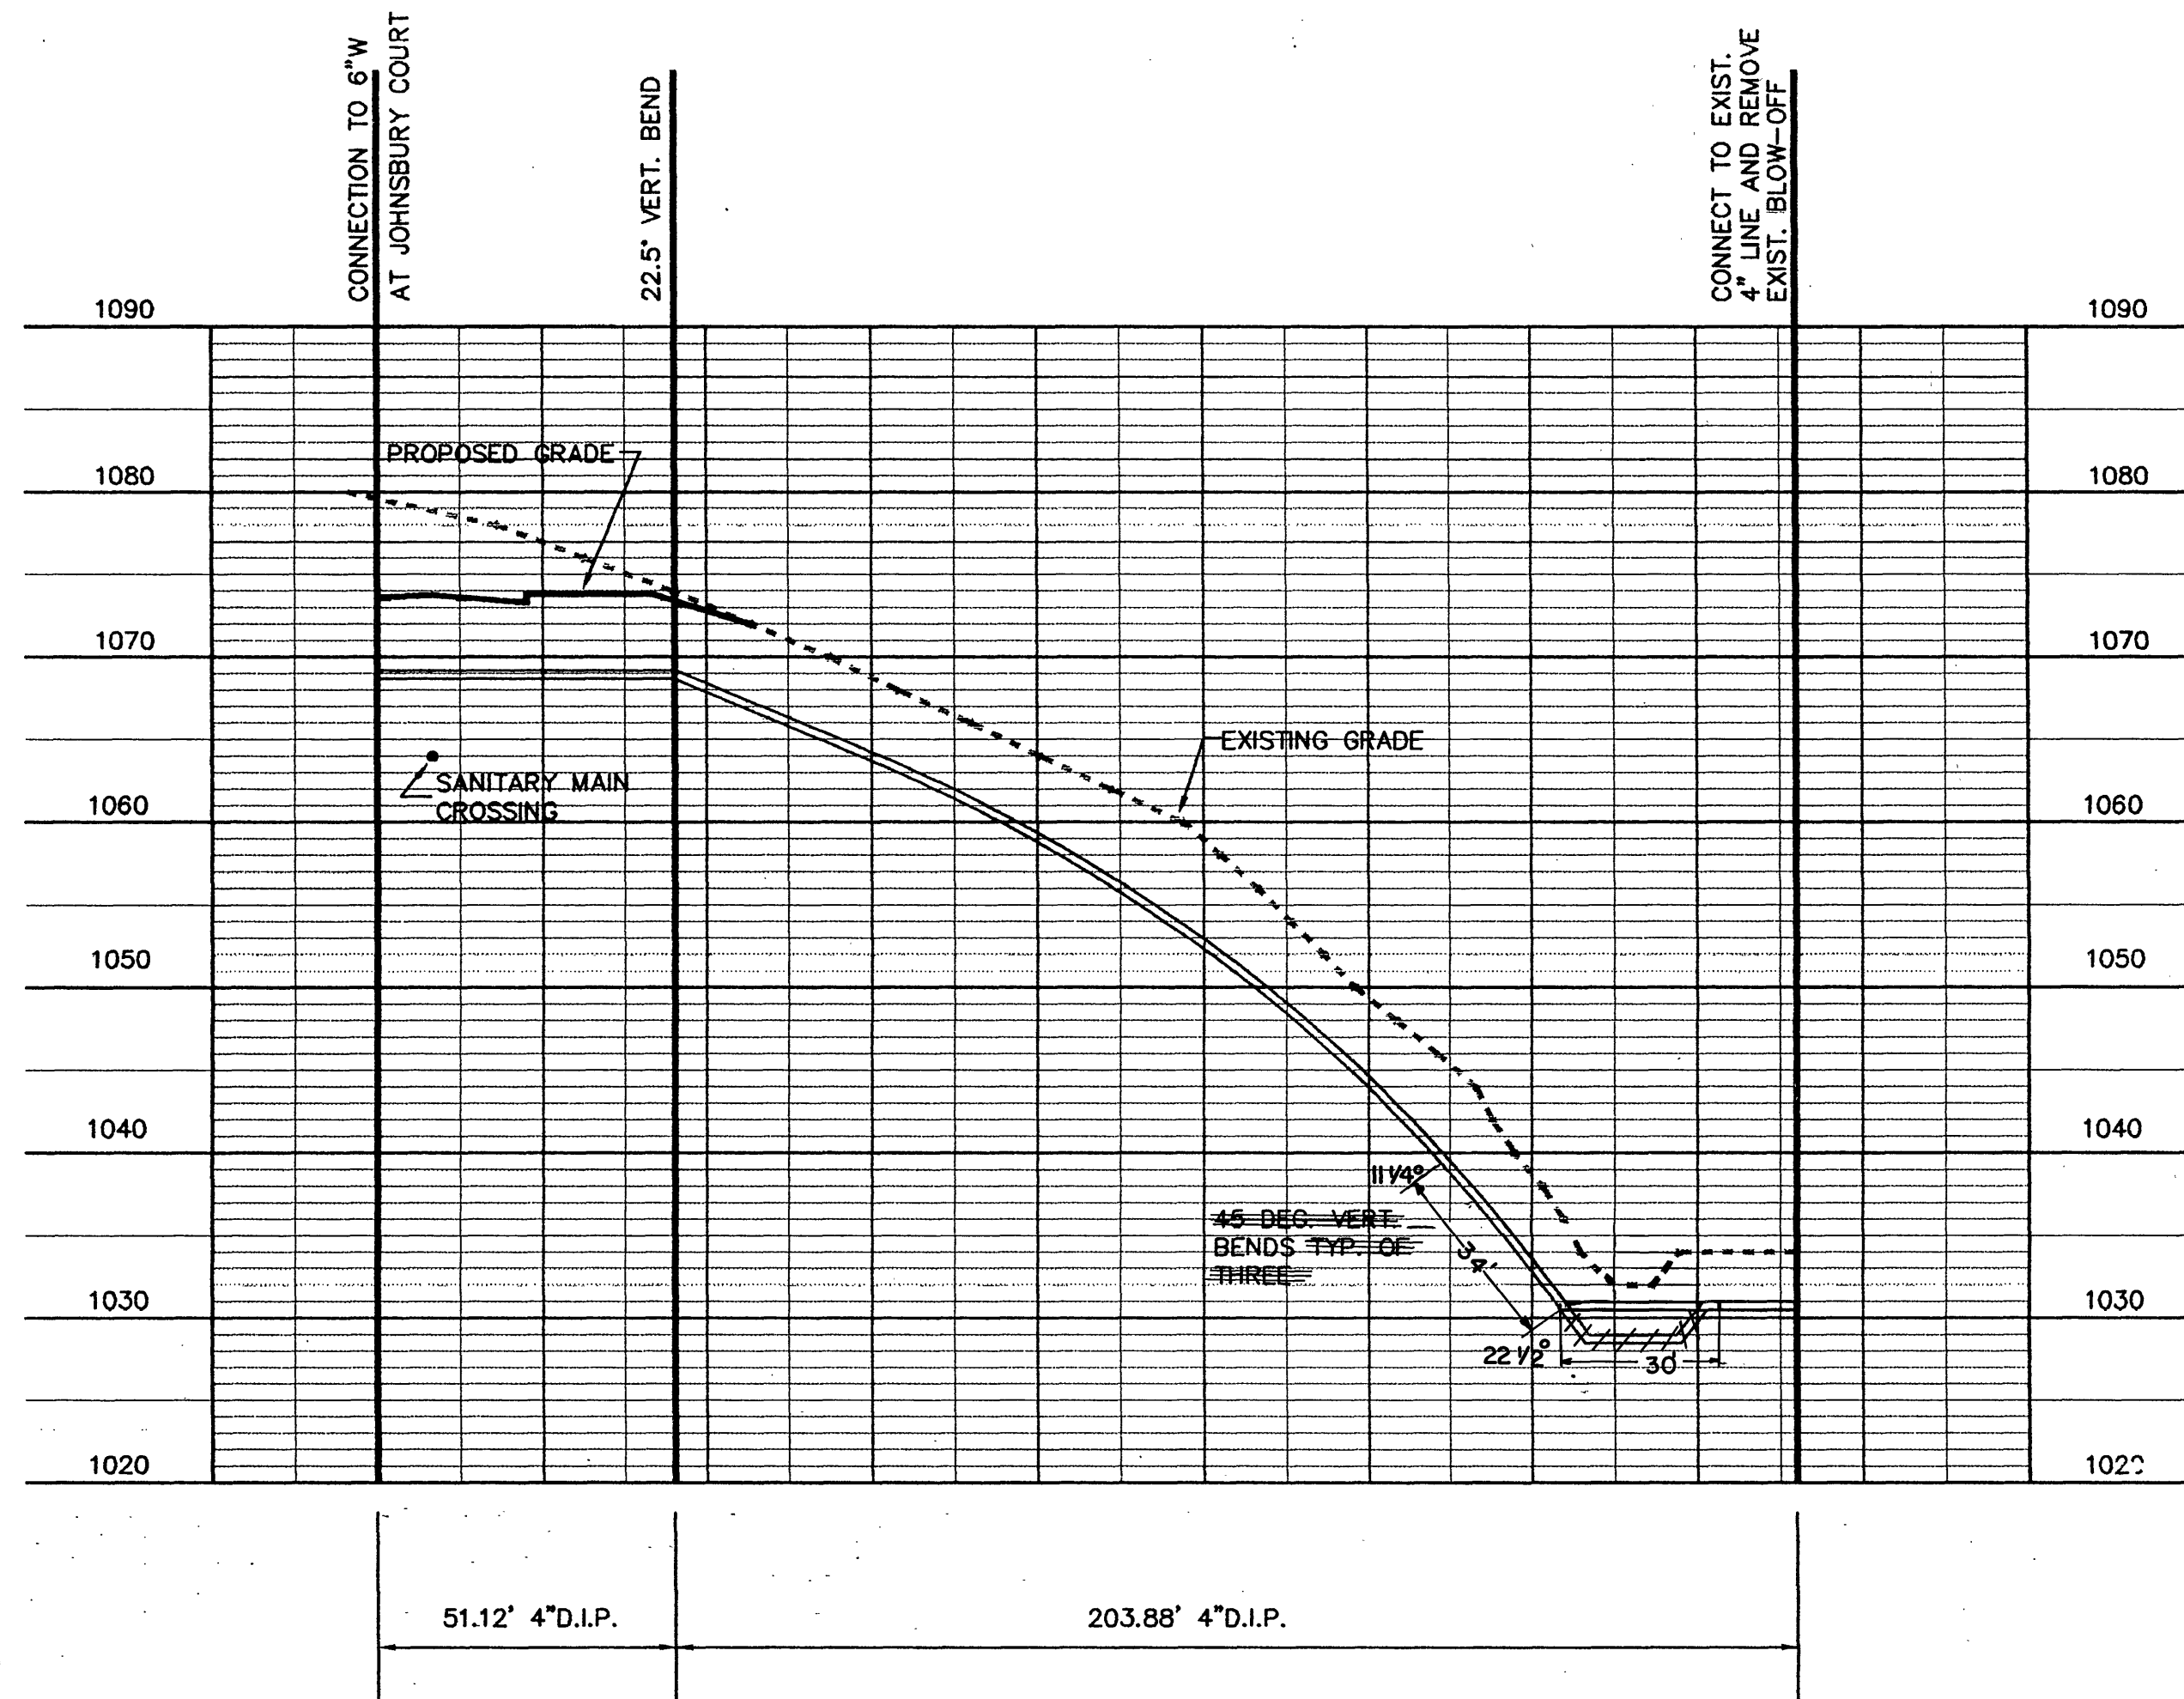


4" WATER MAIN PROFILE (LOOP TO EXIST.)
SCALE: HORZ: 1" = 30' VERT: 1" = 10'

SHEET NOTES:

1. UNLESS STATED OTHERWISE, ALL WATER PIPING, VALVES AND FITTINGS SHALL BE AS NOTED IN THE SPECIFICATIONS ON SHEET C-1.
2. ALL VERTICAL BENDS SHOWN ARE 300 FOOT RADIUS. CONTRACTOR SHALL VERIFY VERTICAL BEND CHARACTERISTICS WITH PIPE MANUFACTURER.
3. DISINFECT ALL NEW PIPING IN ACCORDANCE WITH STATE AND LOCAL REGULATIONS.
4. THRUST/REACTION BLOCKING AT ALL HORIZONTAL AND VERTICAL BENDS.

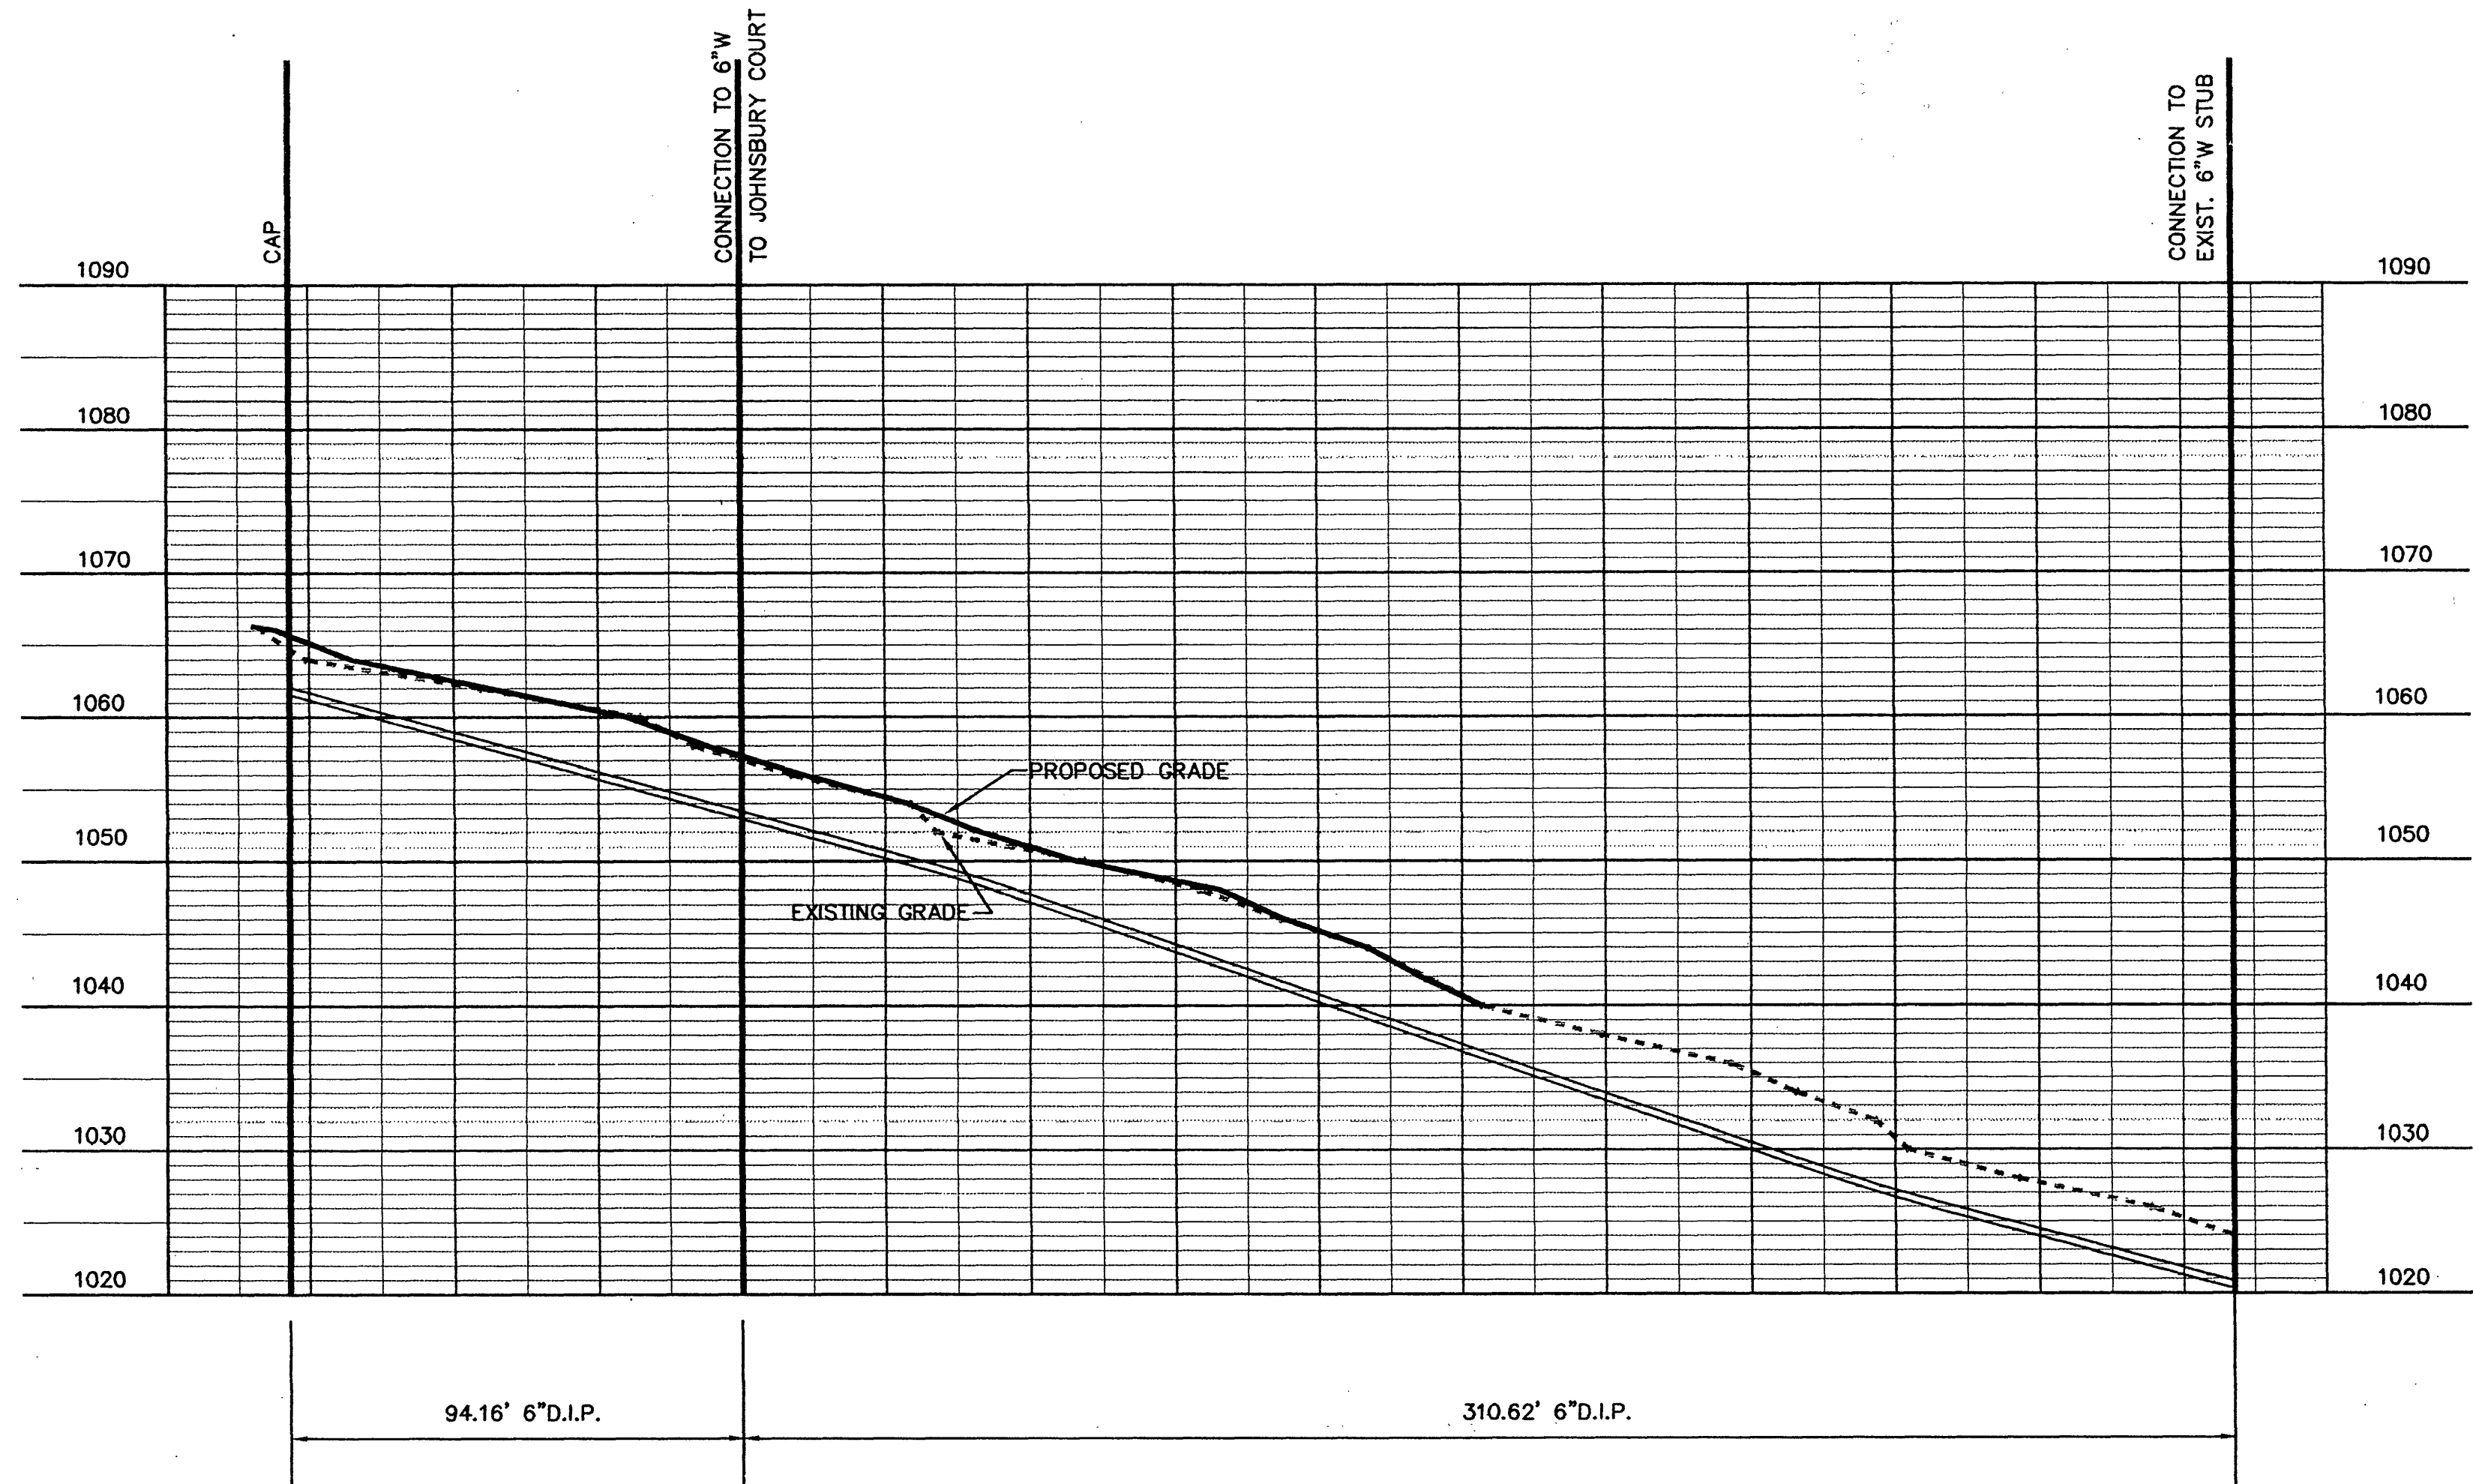


6" WATER EXTENSION PROFILE (MONTEREY ROAD)
SCALE: HORZ: 1" = 30' VERT: 1" = 10'


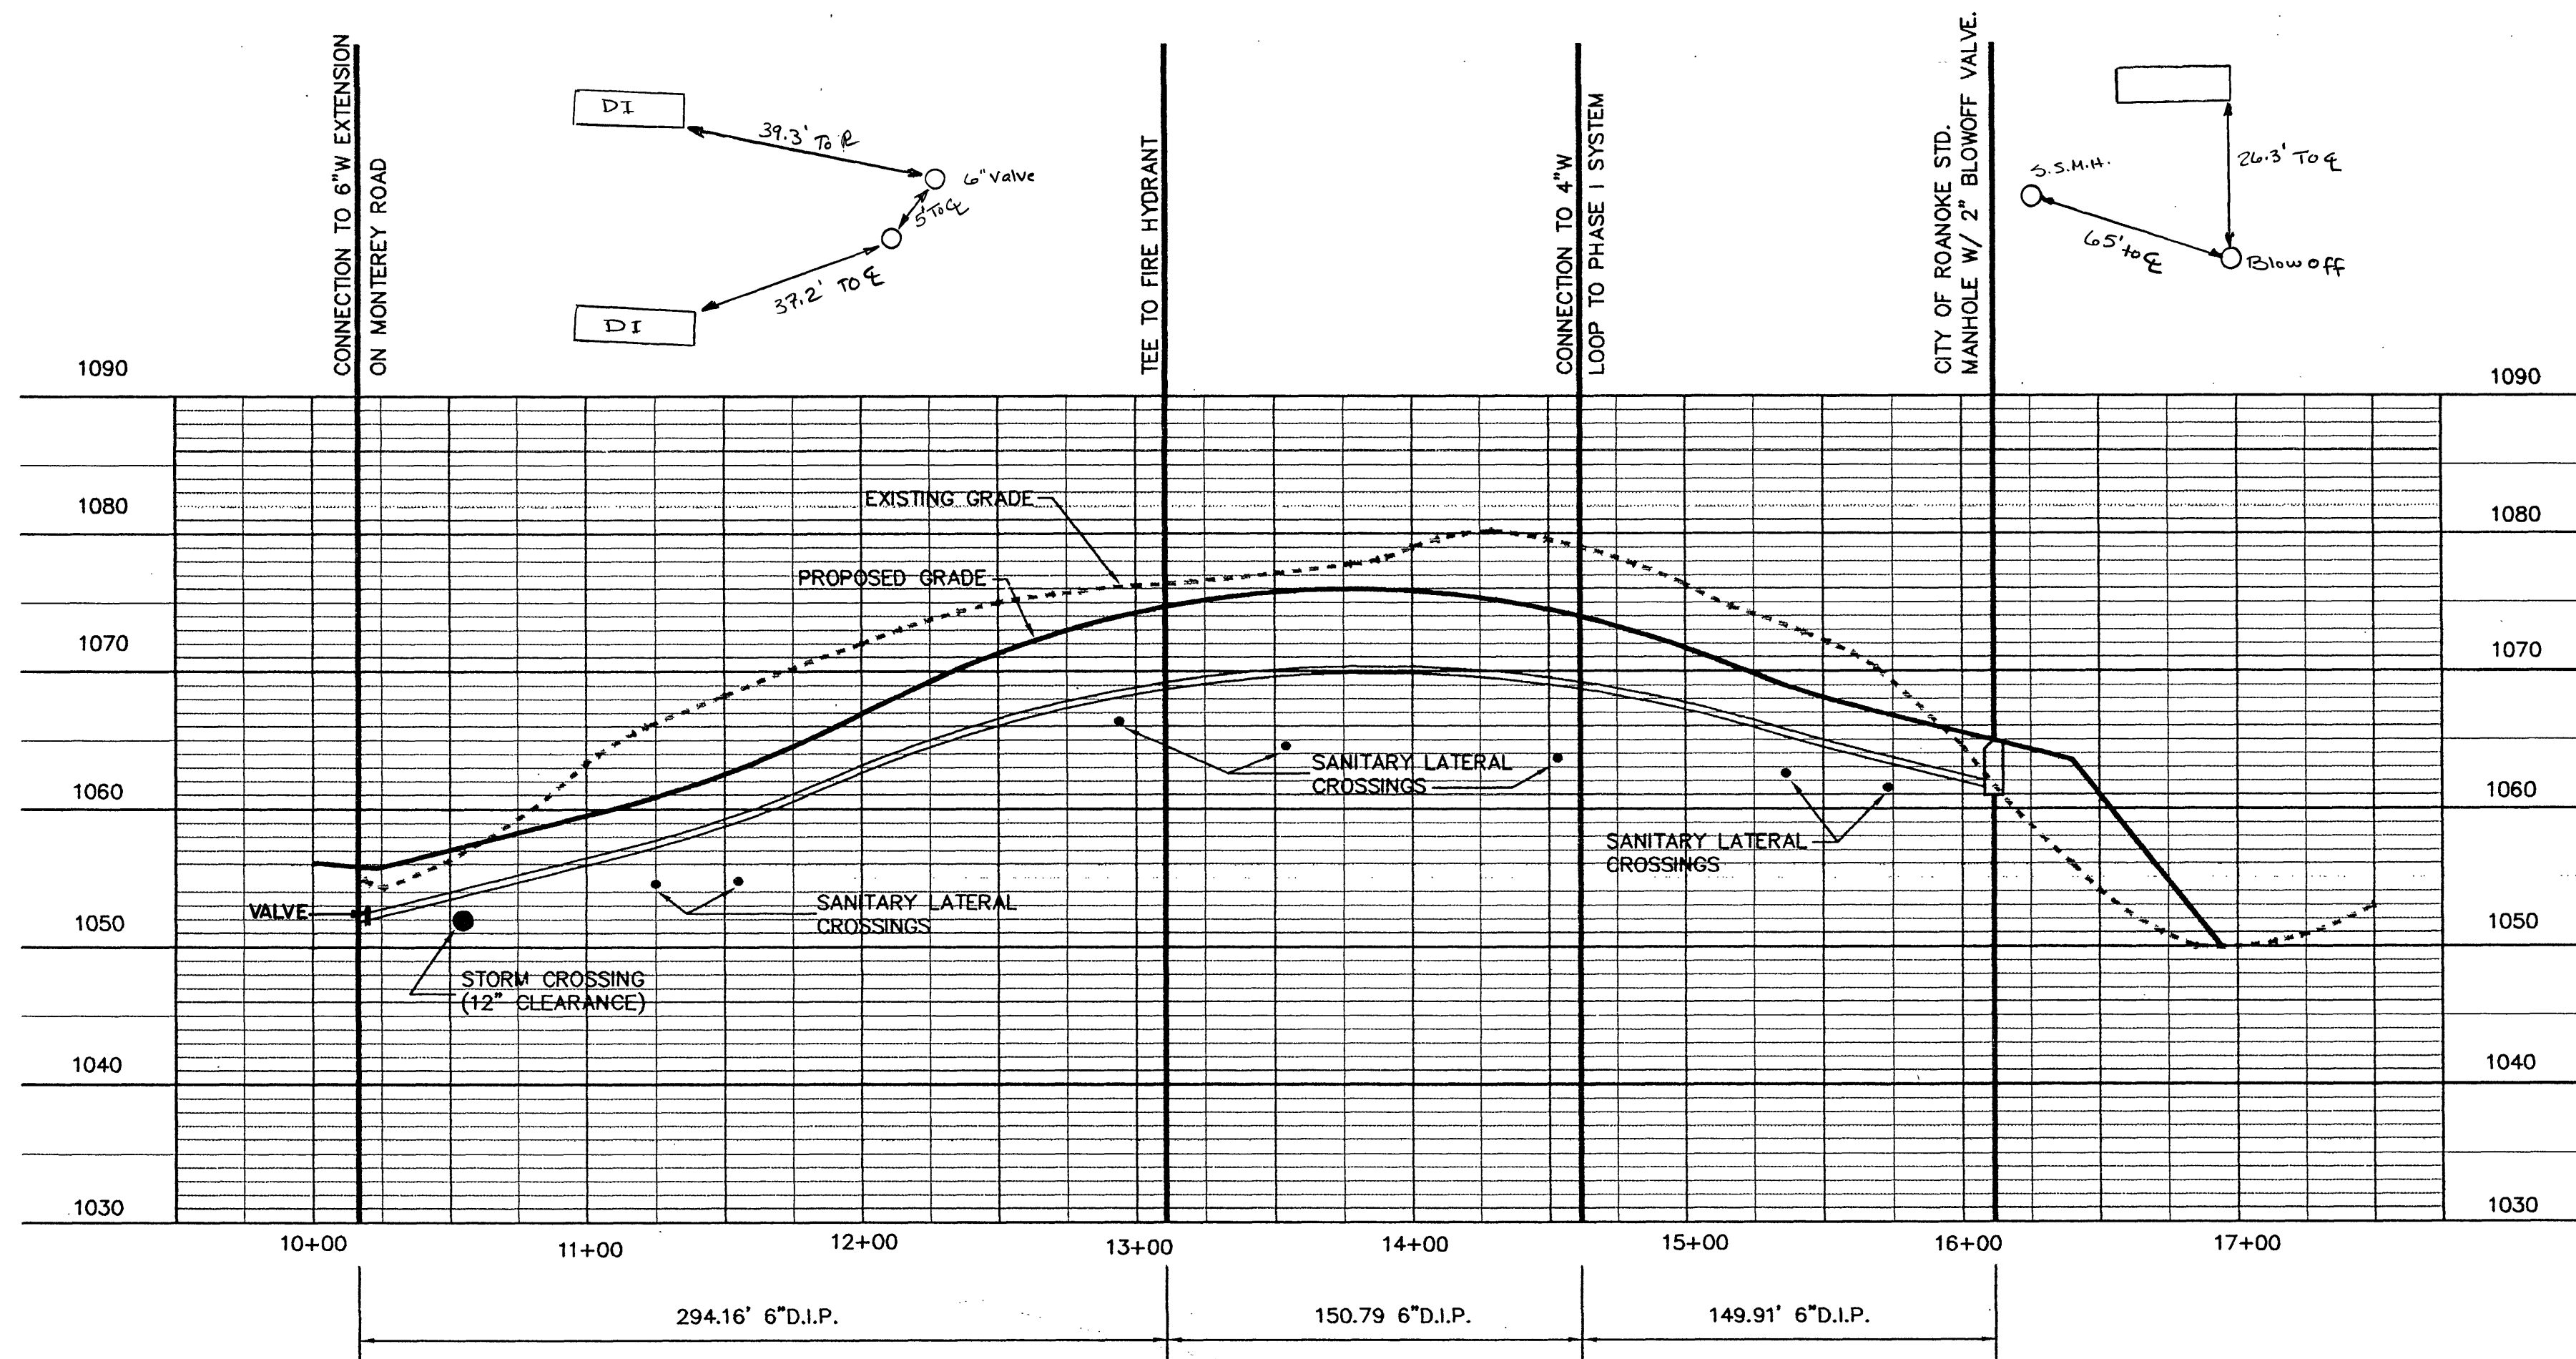


6" WATER MAIN PROFILE (JOHNSBURY COURT)
SCALE: HORZ: 1" = 50' VERT: 1" = 10'

WATER DEPARTMENT #96-11

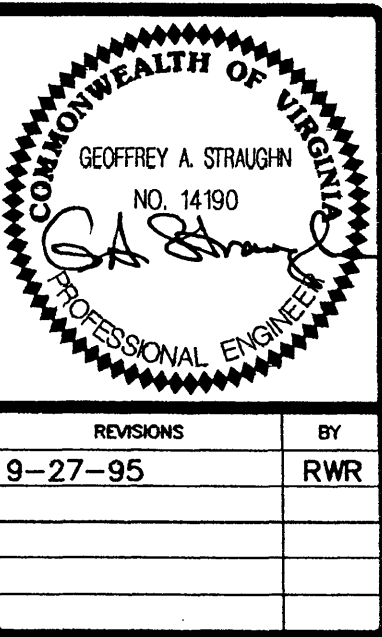

MONTEREY ESTATES PHASE II
Roanoke City, Virginia
WATER PROFILES

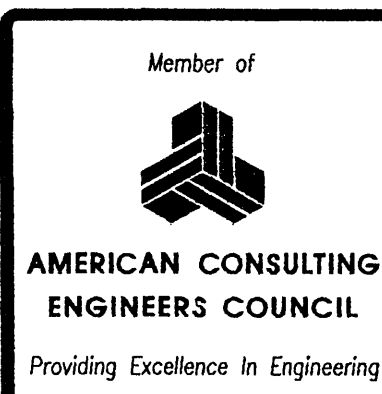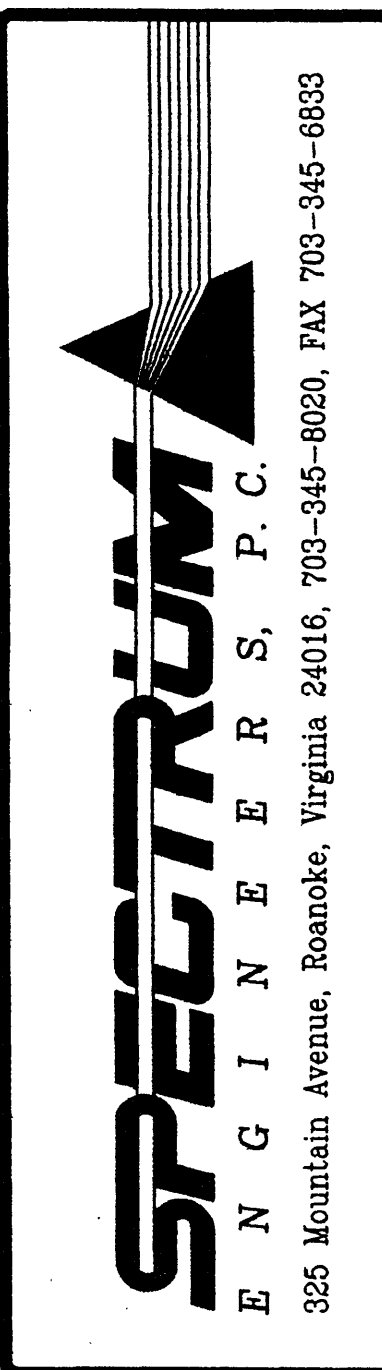

DESIGNED MAR	PROJECT 91043
DRAWN RWR	CHECKED [Signature]
DATE AUGUST 4, 1995	SHEET C-5
OF EIGHT	SHEETS