




1. APPROVED: [Signature] DATE: 01/20/95

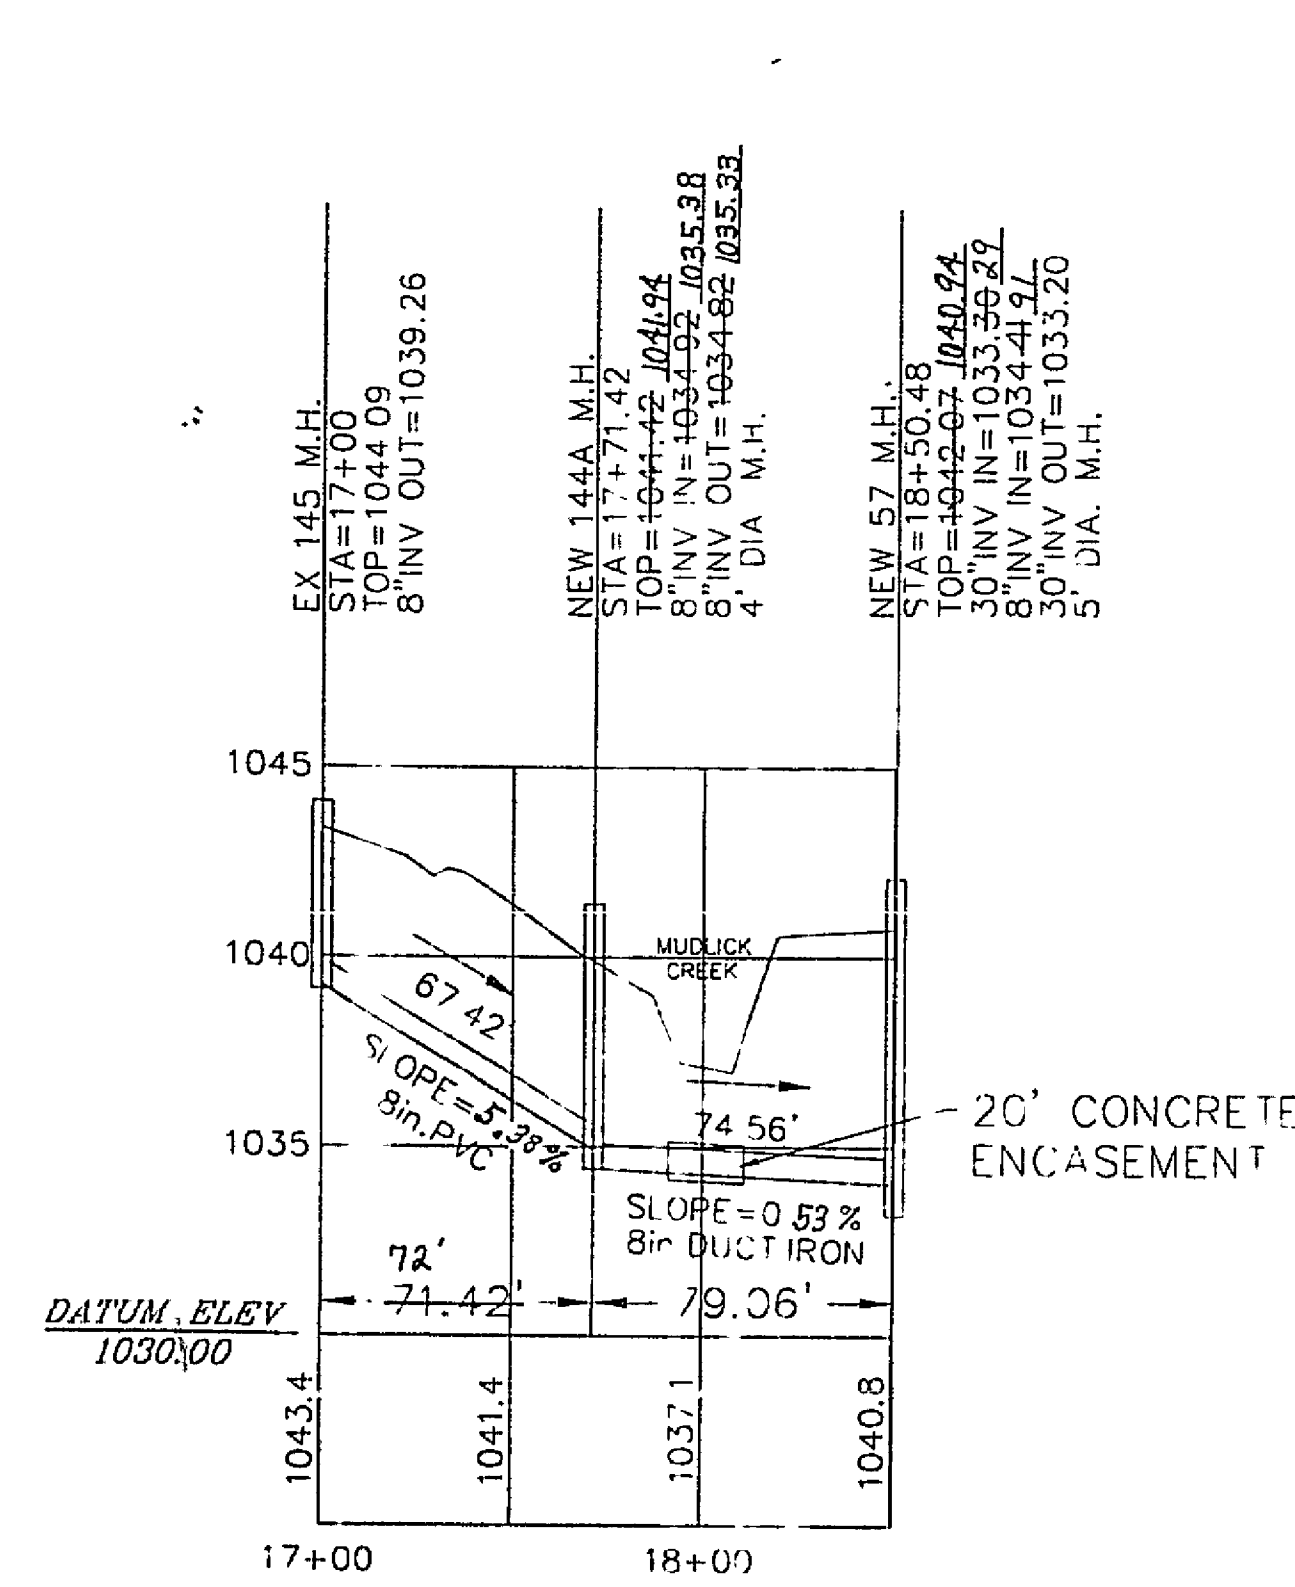


DETAIL 8A

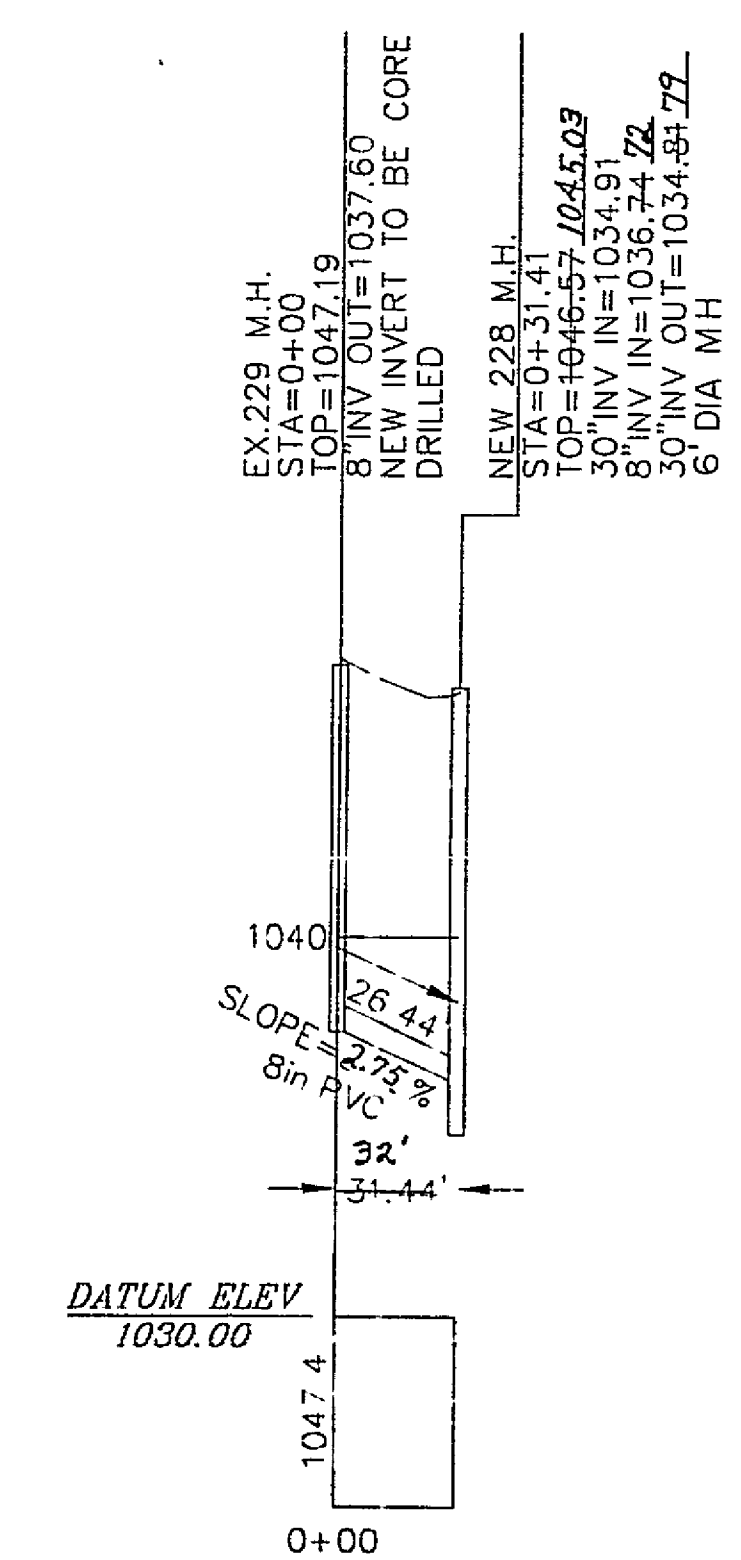


DETAIL 8B

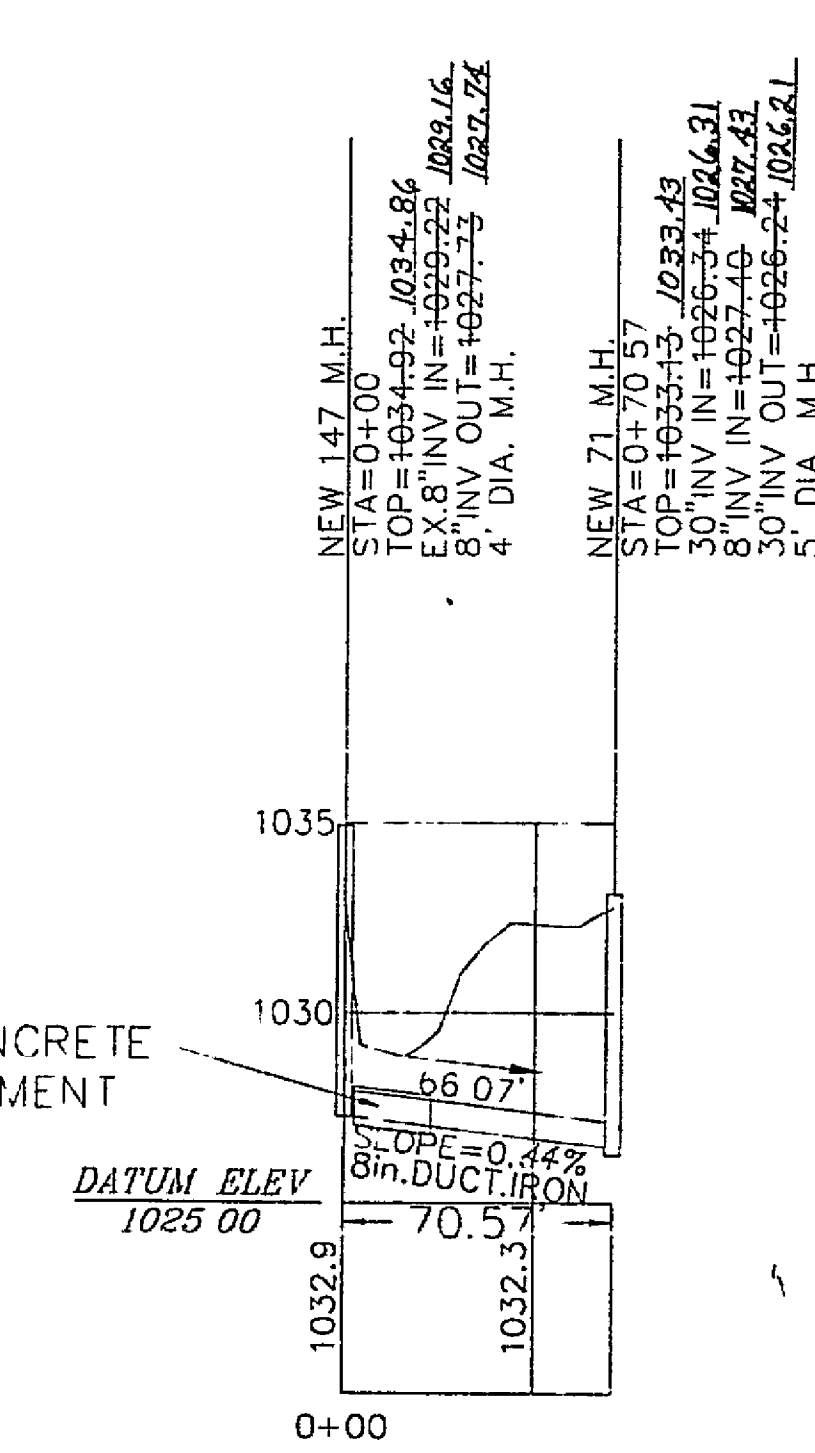


DETAIL 8C

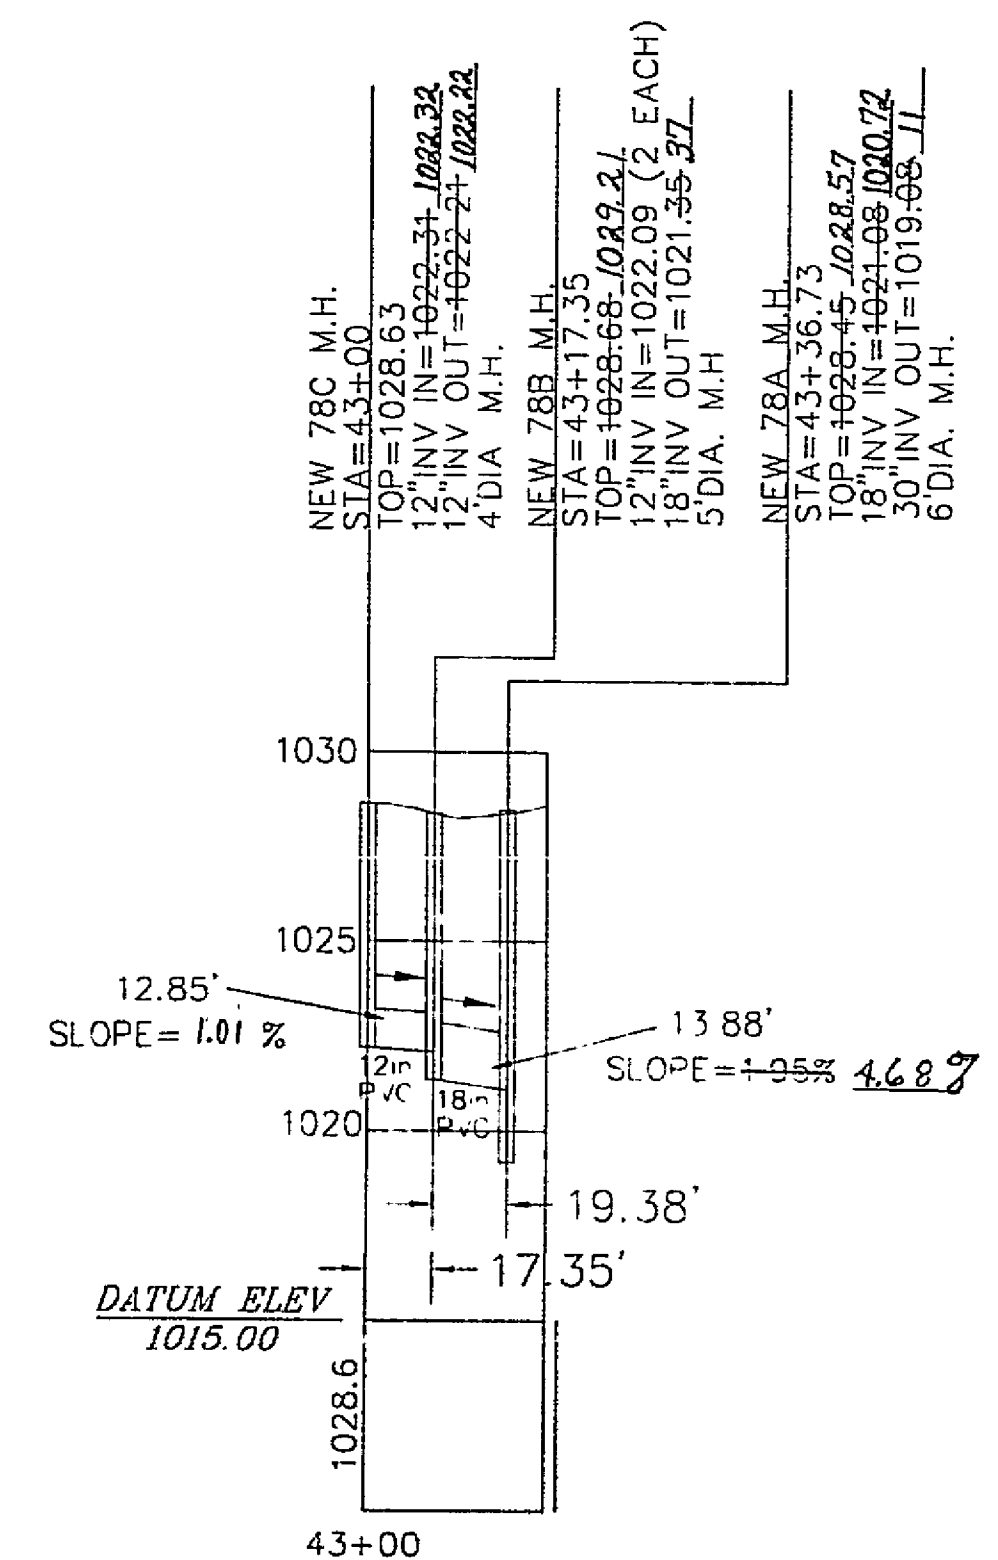


DETAIL 8D

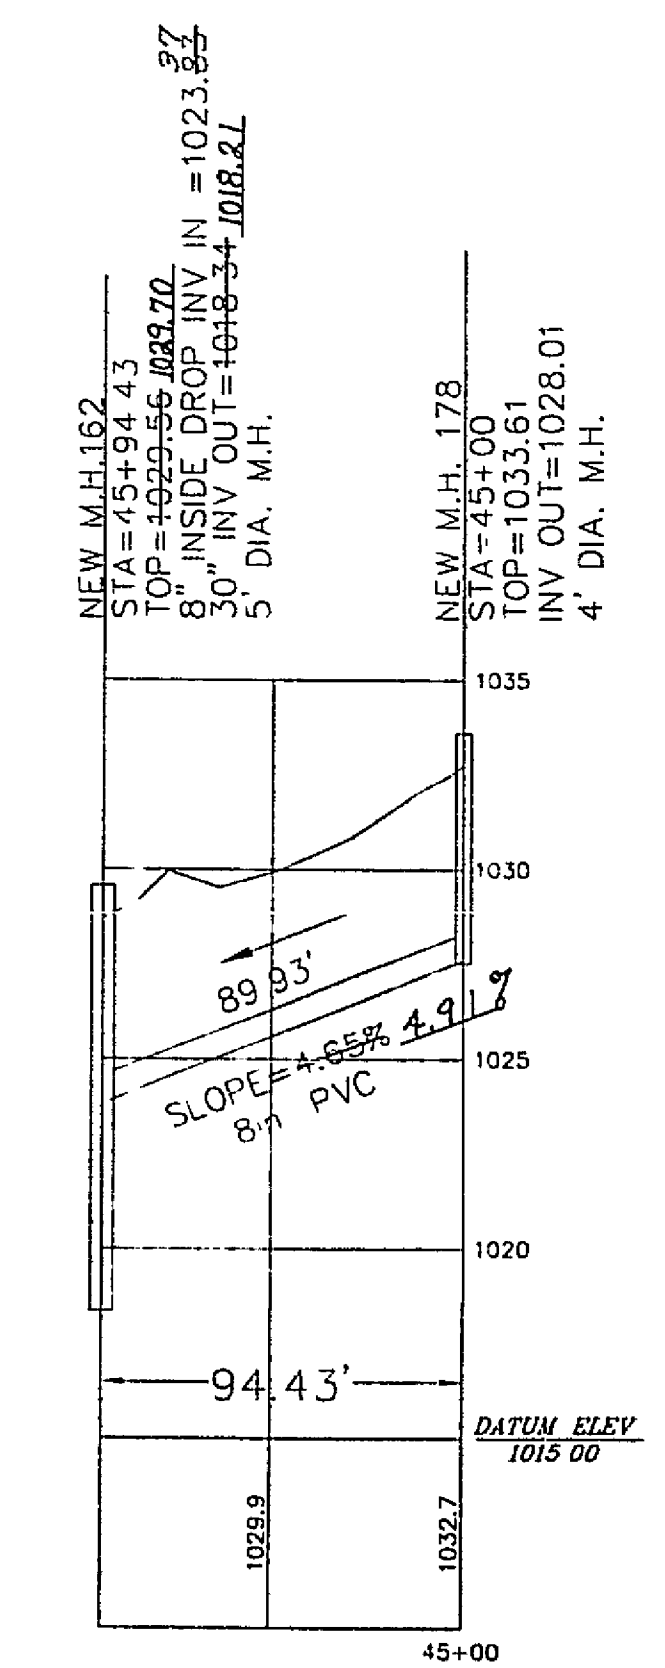

DETAIL 8E

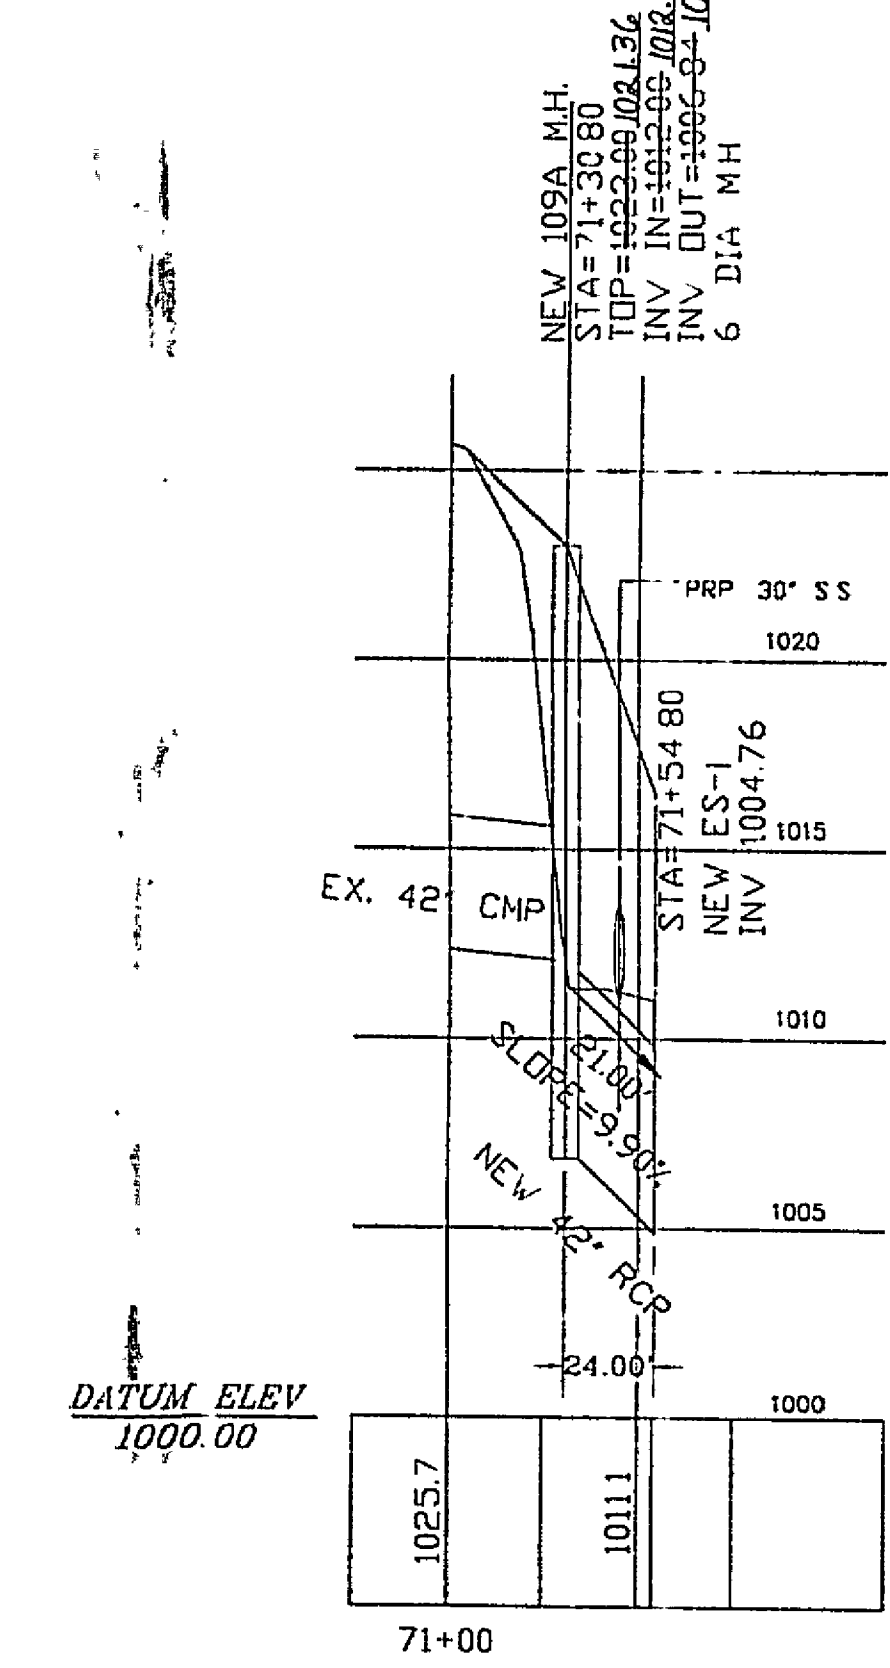


STORM SEWER
DETAIL 8F

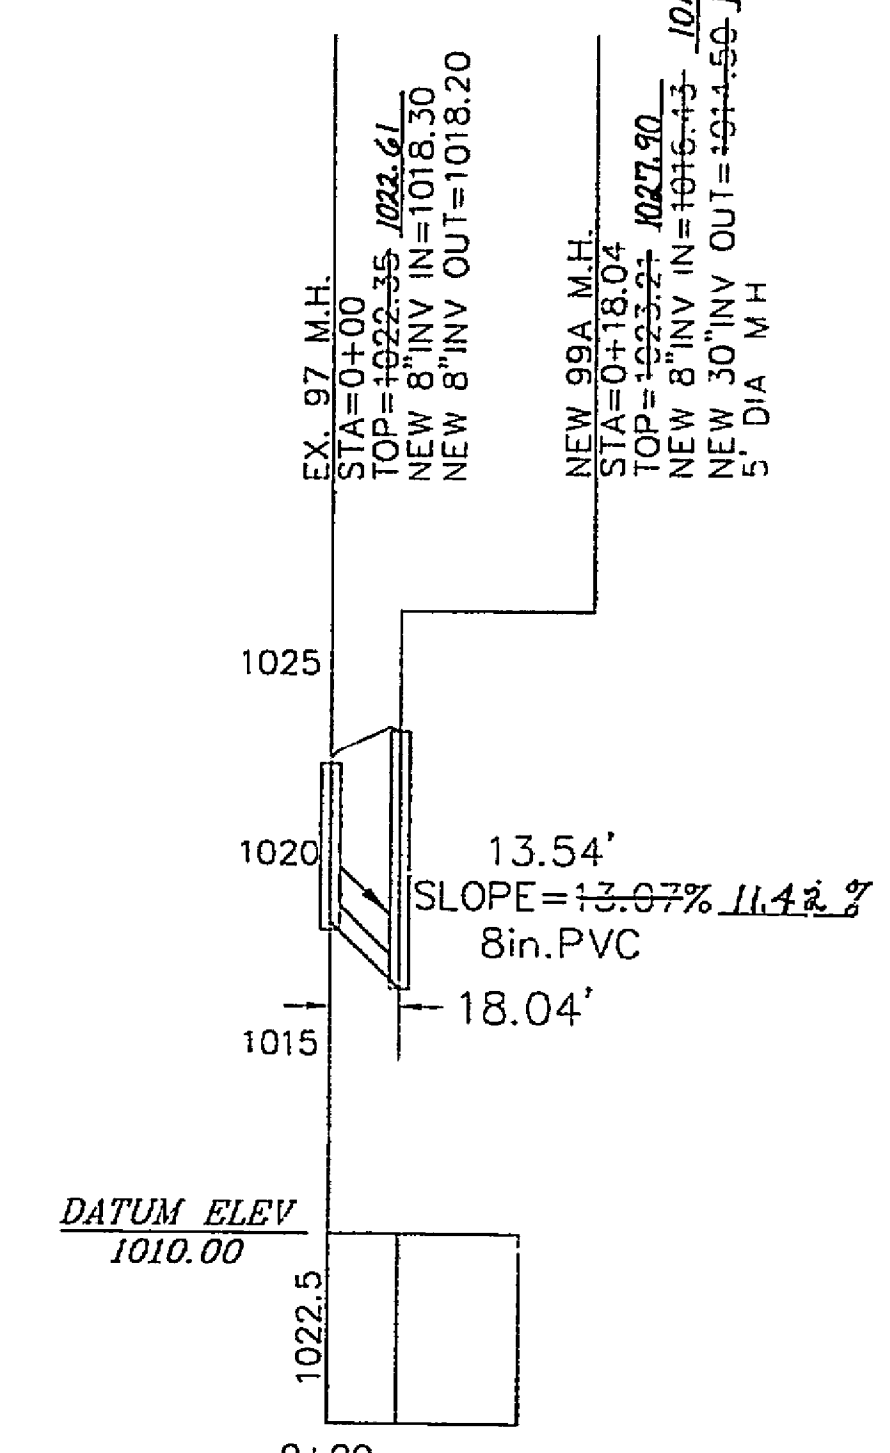

DETAIL 8G


PROFILES
SCALE: 1"=50' HORIZ.
1"=5' VERT.

Note: All sewer line
measurements were taken
from center to center
line of M.H. lids.

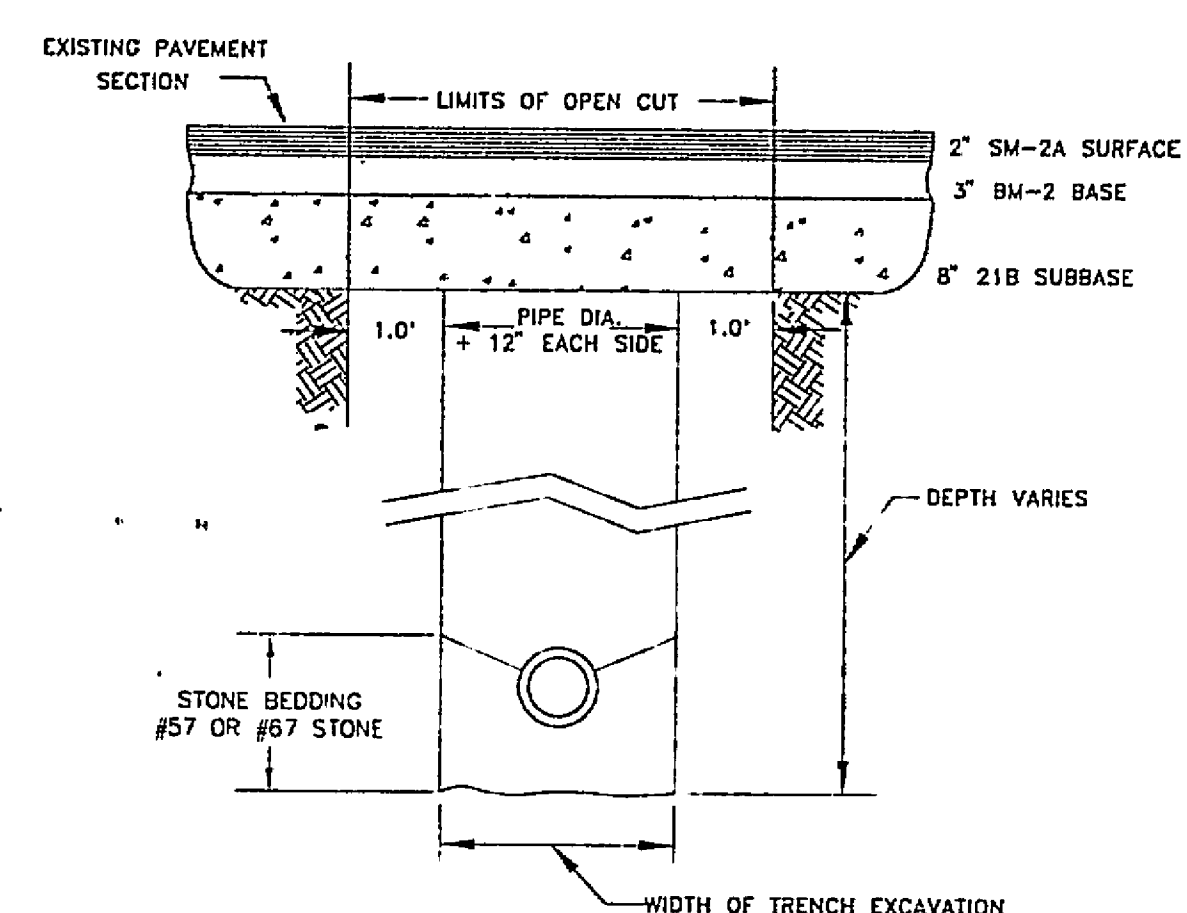


- A. THE CONTRACTOR SHALL REPLACE THE OPEN CUT WITH A MINIMUM TOP COURSE, 2" VDOT SM-2A, BASE COURSE, 5" VDOT BM-2, AND SUBBASE, 8" VDOT 21B, OR AS REQUIRED BY VDOT.
- B. ALL CONSTRUCTION WITHIN THE PUBLIC RIGHT-OF-WAY SHALL BE AS SPECIFIED BY VDOT.
- C. ALL EXPOSED EDGES OF EXISTING BITUMINOUS SURFACE COURSE SHALL BE PRIMED WITH A MATERIAL SATISFACTORY TO THE ENGINEER BEFORE THE BITUMINOUS MIXTURES ARE REPLACED. EDGES OF TRENCH SHALL BE CUT TO A STRAIGHT LINE PRIOR TO PAVING.
- D. THE BACKFILL IN THE TRENCH SHALL BE SUITABLE AND THOROUGHLY COMPACTED IN 6-INCH LAYERS BY TAMING OR BY OTHER APPROVED METHOD BEFORE THE OPENING IS PAVED. NO EXCAVATIONS UNDER THE EXISTING PAVEMENT WILL BE PERMITTED. SHEETING OR SHORING SHALL BE USED WHEN REQUIRED BY THE DEPTH OF THE TRENCH OR TYPE OF MATERIAL IN ACCORDANCE WITH VIRGINIA O.S.H.A. STANDARDS.

PAVEMENT
REPLACEMENT
OPEN CUT ROADWAY

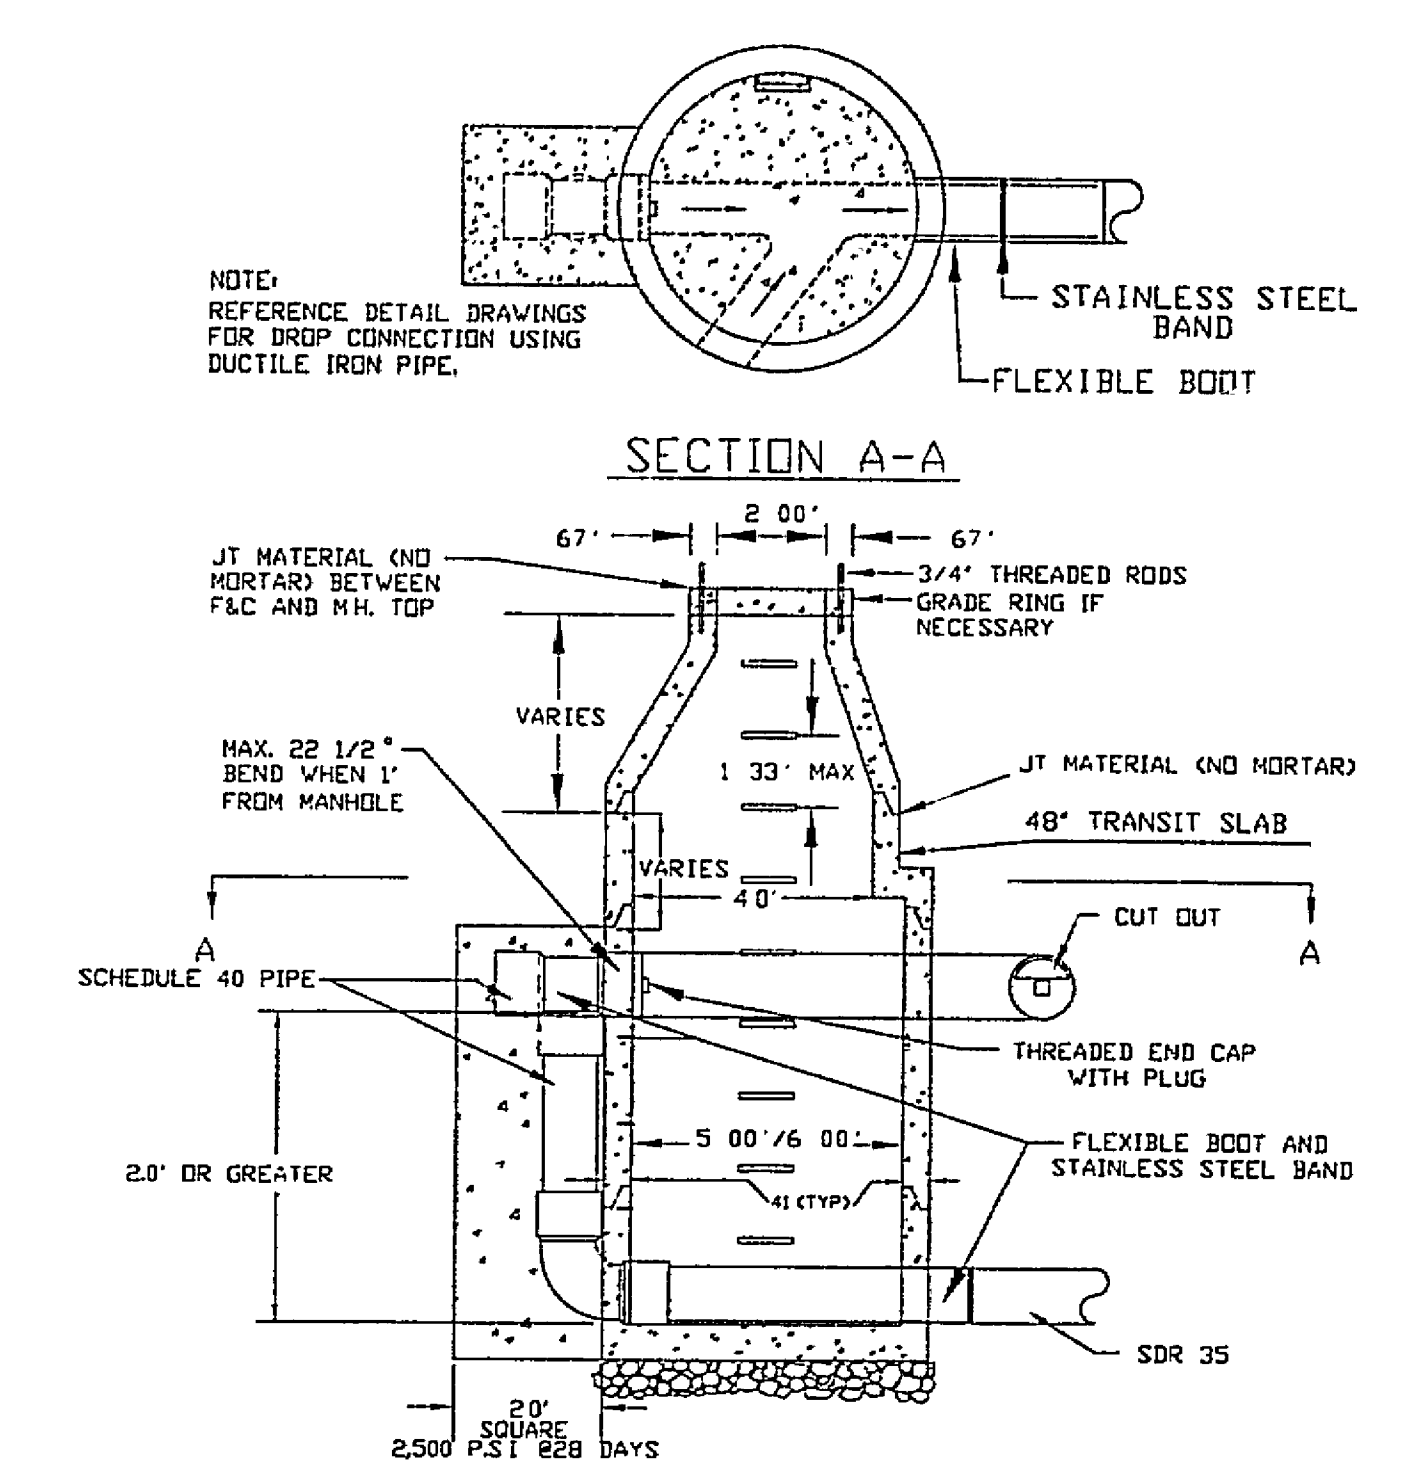

OUTSIDEDROP MANHOLE (FOR USE WITH PVC PIPE)



DEPARTMENT OF
ENGINEERING
AND INSPECTIONS

NO.	REVISIONS	DATE
1		
2		
3		
4		
5		
6		

MUDLICK INTERCEPTOR PHASE I
SEWER LINE REPLACEMENT

DATE: 01/20/95
SCALE: AS NOTED
DRAWING BY: CLN,MTB
DESIGNED BY: SRB
APPROVED BY: GWS,III

TRANSITION PROFILES
& DETAILS

SHEET
8
OF
10

SI-0729