


GENERAL NOTES

1. SEWER PIPE SHALL BE EXTRA STRENGHT PIPE UNLESS SHOWN OTHERWISE.
2. WHERE HORIZONTAL DEFLECTIONS IN SEWERS OCCUR BETWEEN MANHOLES, SEWERS SHALL BE LAID ON CHORGS AS DIRECTED. IN NO CASE SHALL THE DEFLECTION AT ANY SEWER JOINT EXCEED 3 DEGREES.
3. EXISTING GROUND SHOWN ON PROFILES IS AT CENTERLINE OF SEWER EXCEPT WHERE SHOWN OTHERWISE.
4. GAS, WATER, AND OTHER UTILITIES ARE SHOWN ACCORDING TO THE BEST INFORMATION AVAILABLE, BUT IT IS NOT WARRANTED THAT THE LOCATIONS SHOWN ARE EXACT, NOR THAT ALL UTILITIES ARE SHOWN. FOR ADDITIONAL INFORMATION ON LOCATION OF UTILITIES THE CONTRACTOR SHOULD CONSULT THE OWNERS OF UTILITIES IN THE PROJECT AREA.
5. VERTICAL CONTROL IS BASED ON U.S.C. & G.S. MEAN SEA LEVEL DATUM.

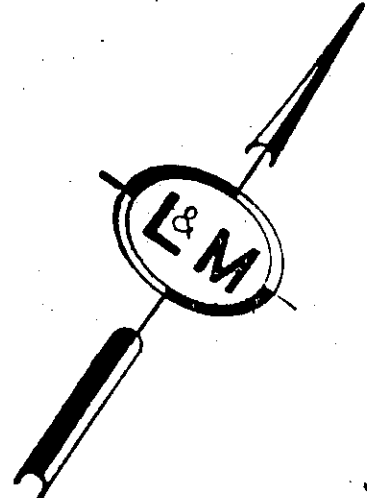

LEGEND

- PROPOSED SANITARY SEWER —PROJECT 63-1
- - - EXISTING SANITARY SEWER
- PROPOSED MANHOLE —PROJECT 63-1
- EXISTING MANHOLE
- PROPOSED CLEANOUT — PROJECT 63-1
- 4 — SHEET AND NUMBER

ROANOKE COUNTY SANITATION AUTHORITY
ROANOKE COUNTY, VIRGINIA

SANITARY SEWERAGE SYSTEM
PROJECT NO. 63-1
INDEX SHEET AND NOTES

| | | |
|------------------|----------------------|----------------------|
| DESIGNED: W.E.C. | LANGLEY & McDONALD | SCALE: 1" = 200' |
| PLOTTED: R.D.H. | CONSULTING ENGINEERS | DATE: APRIL 15, 1963 |
| DRAWN: R.D.H. | NORFOLK, VA. | SHEET 1 OF 15 |
| CHECKED: W.C.O. | | DWG. NO. 616101 |

