

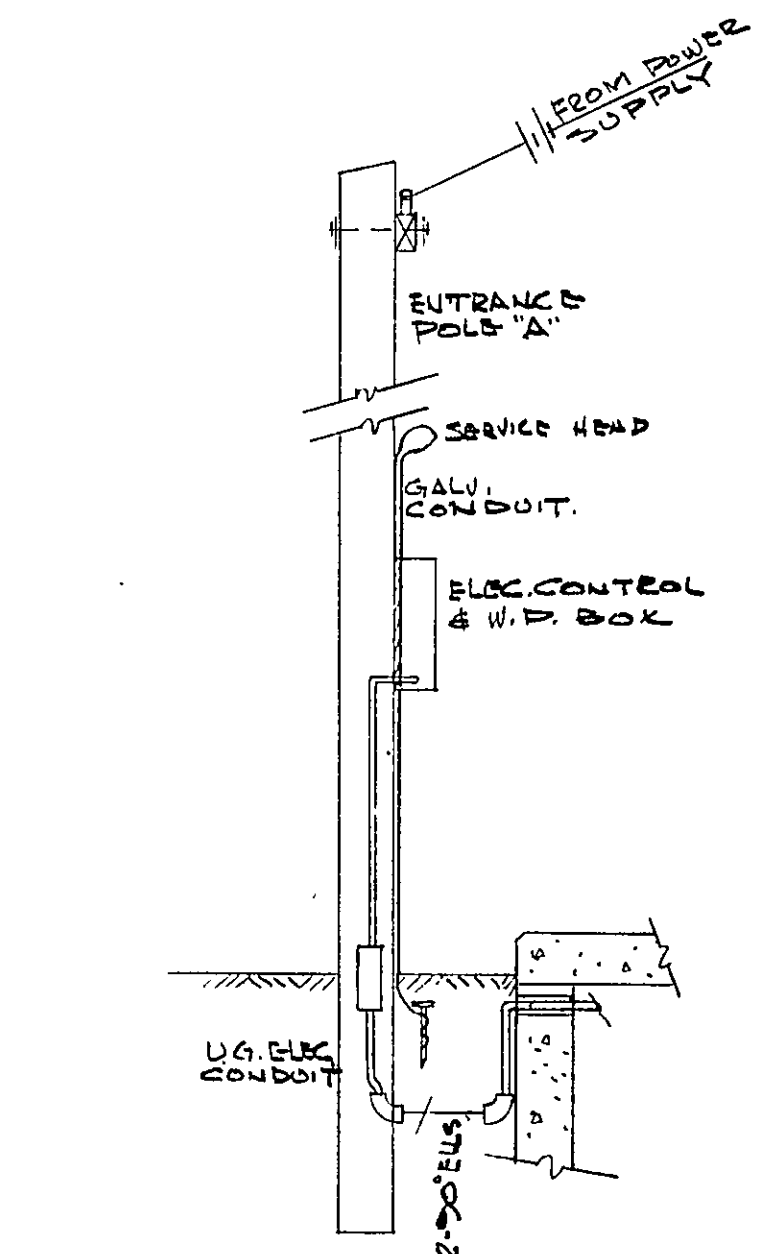
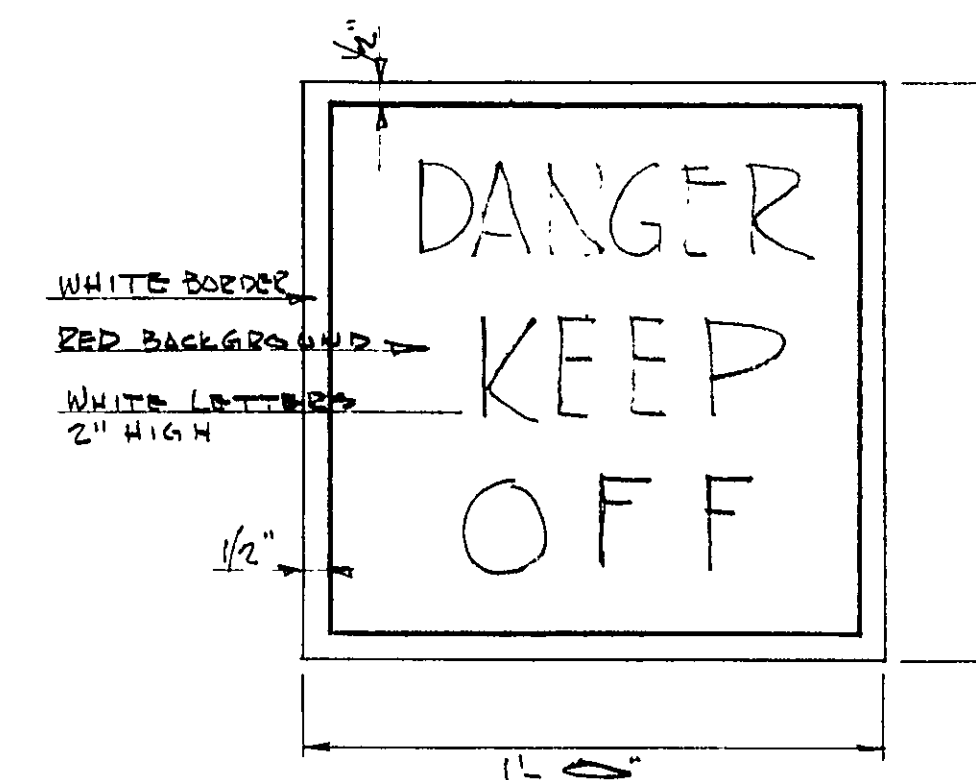
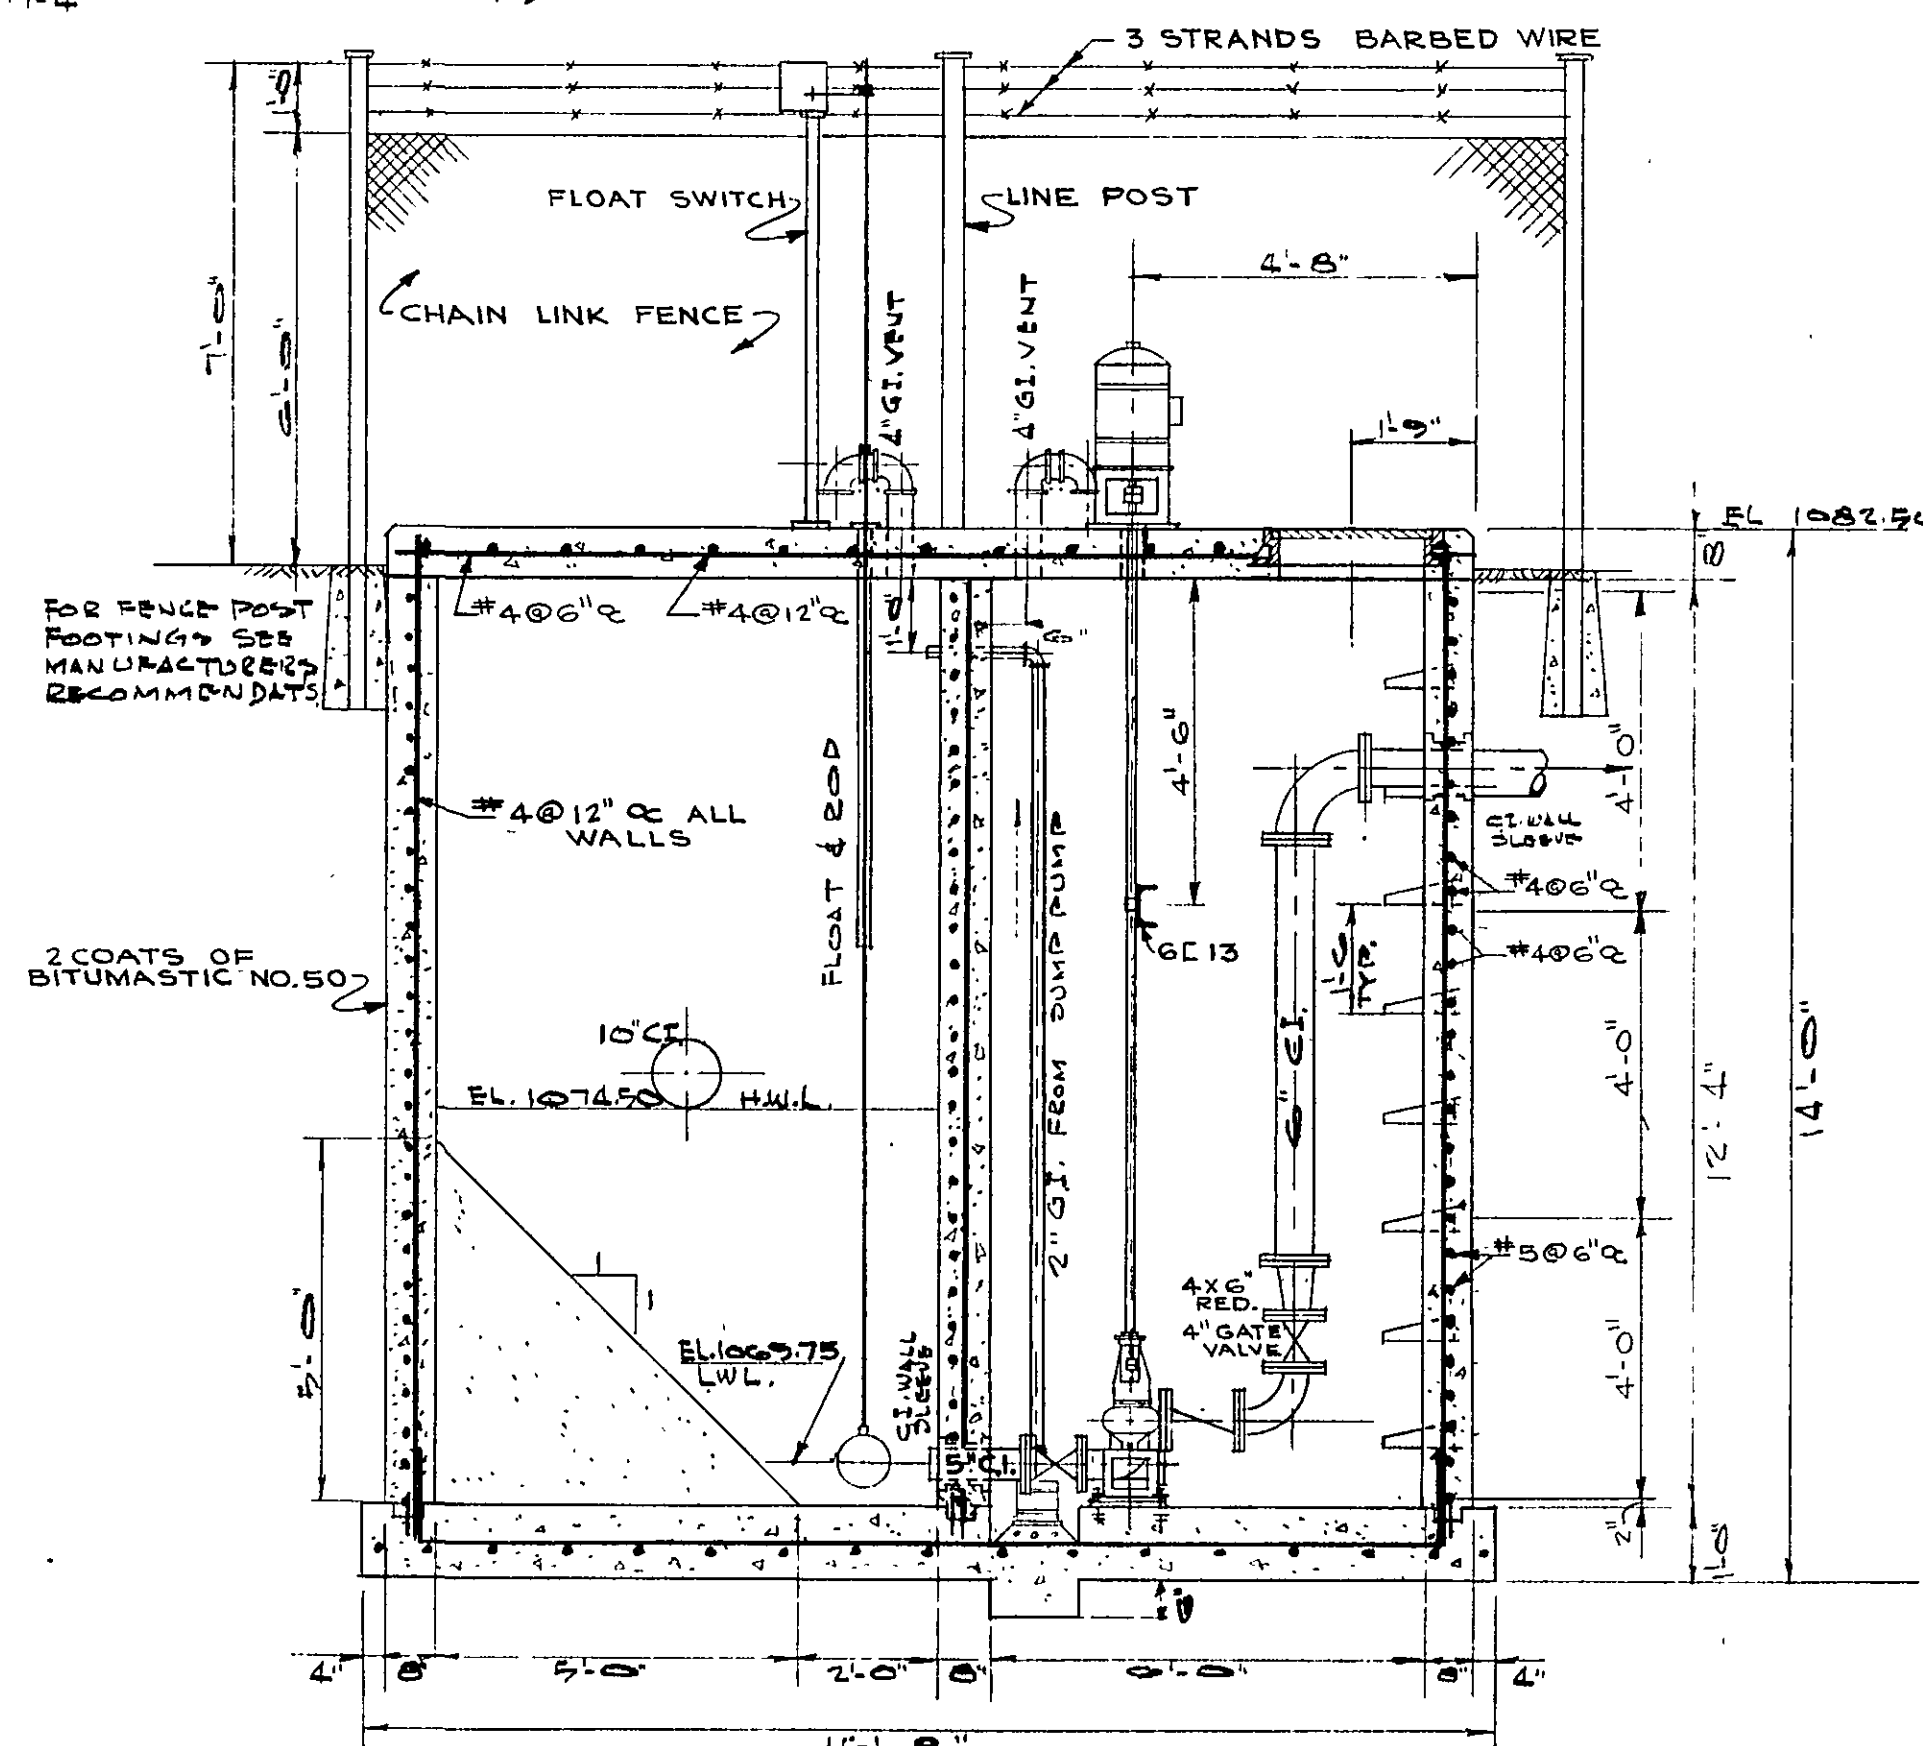
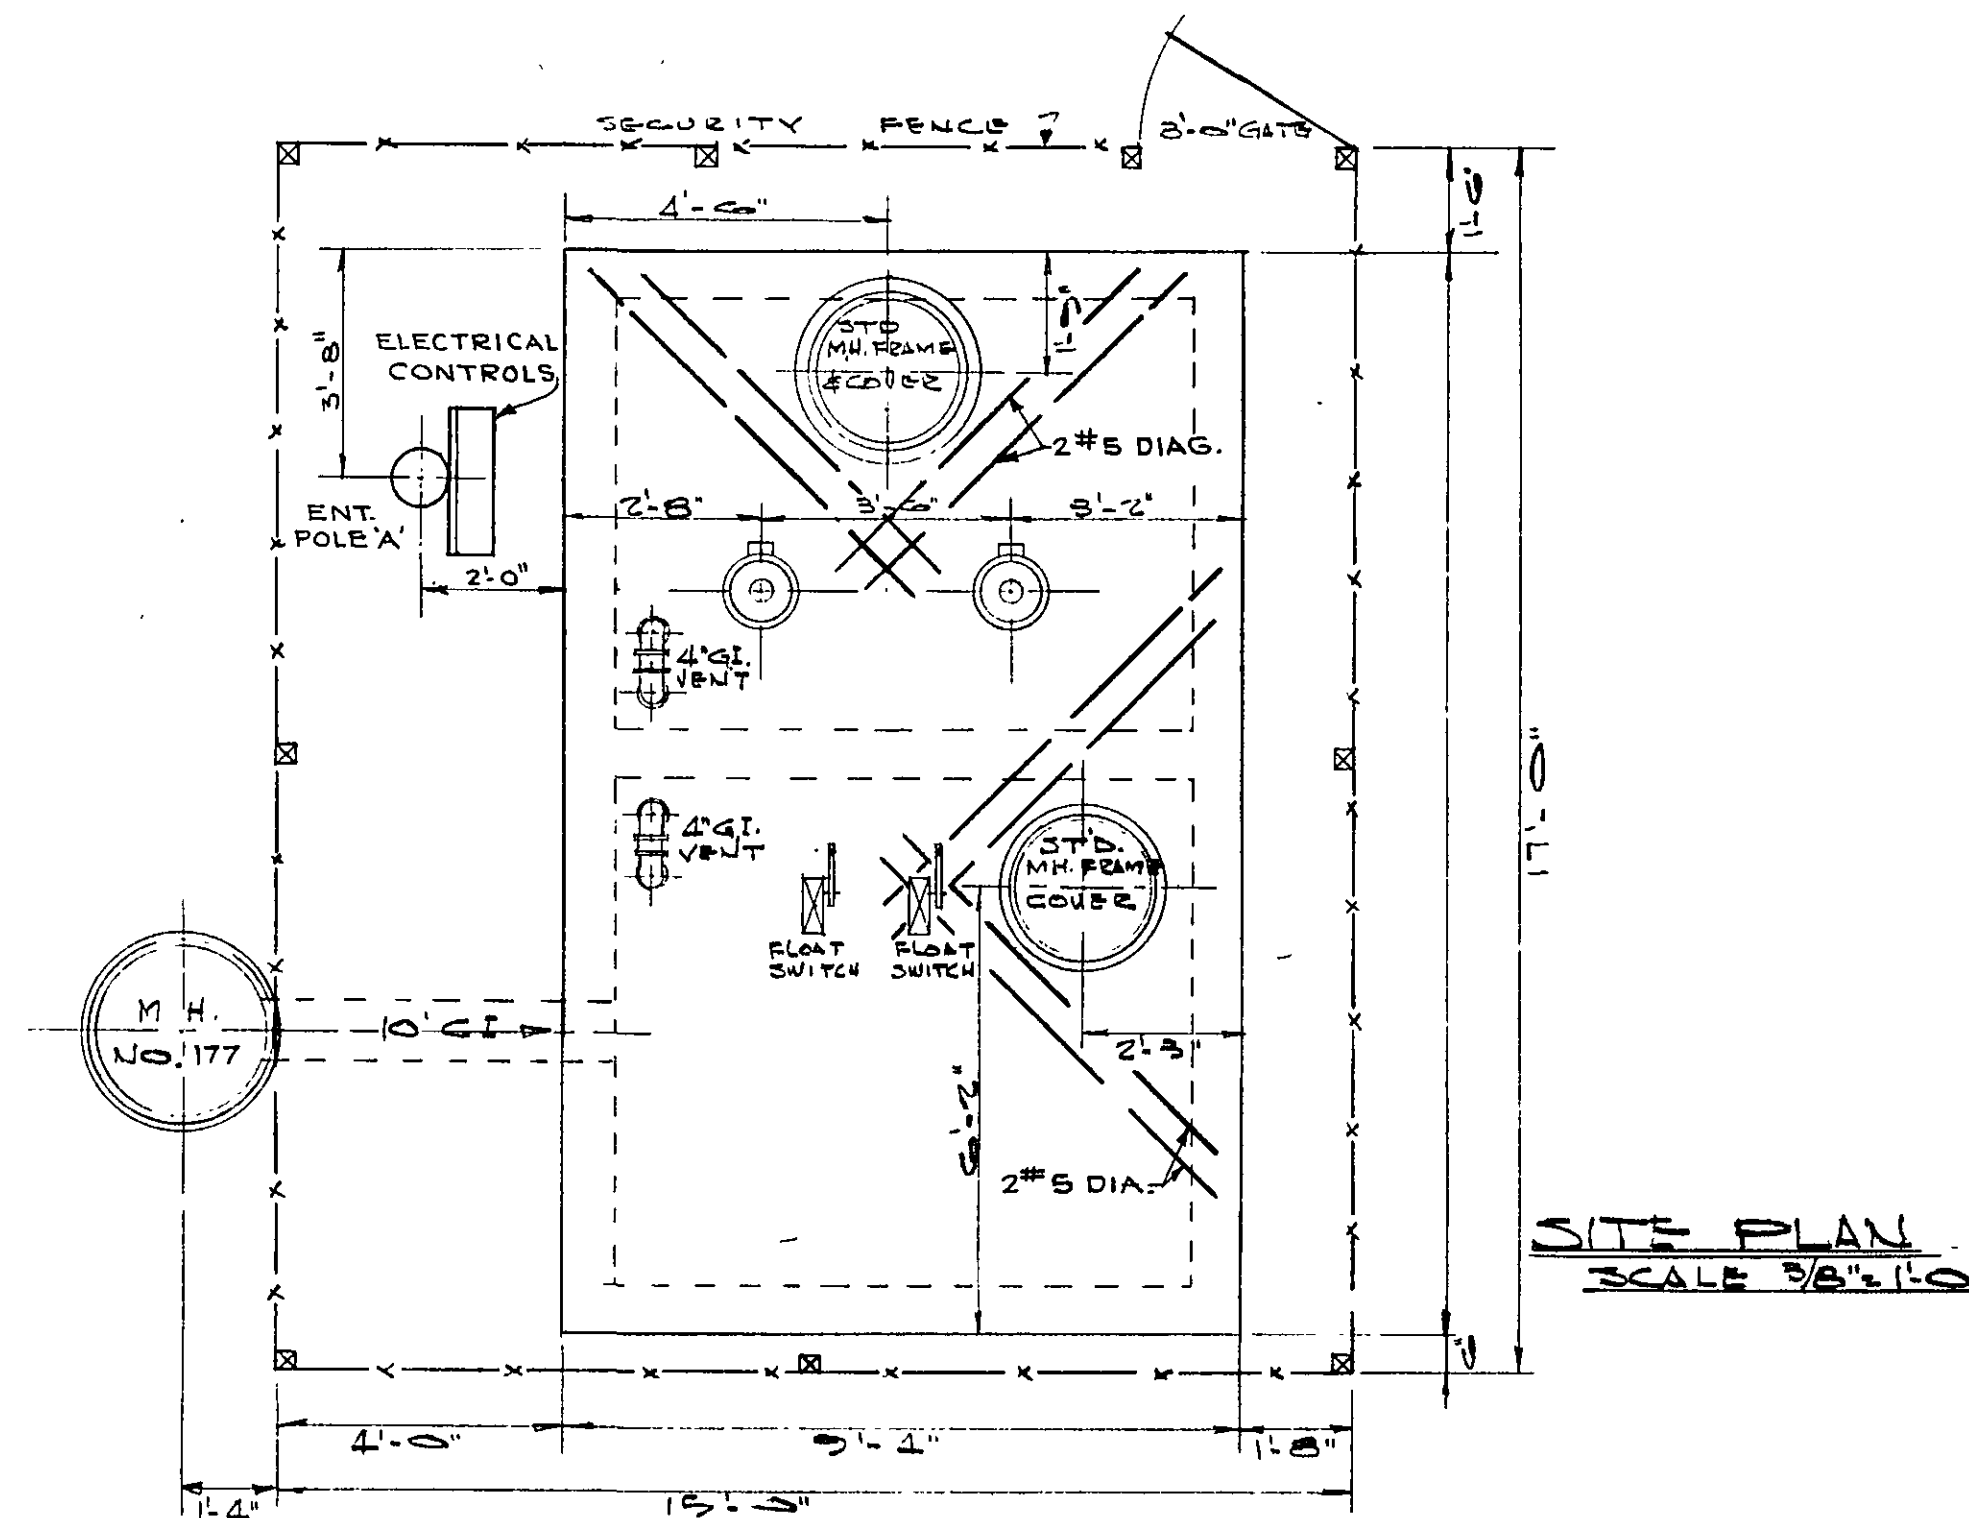


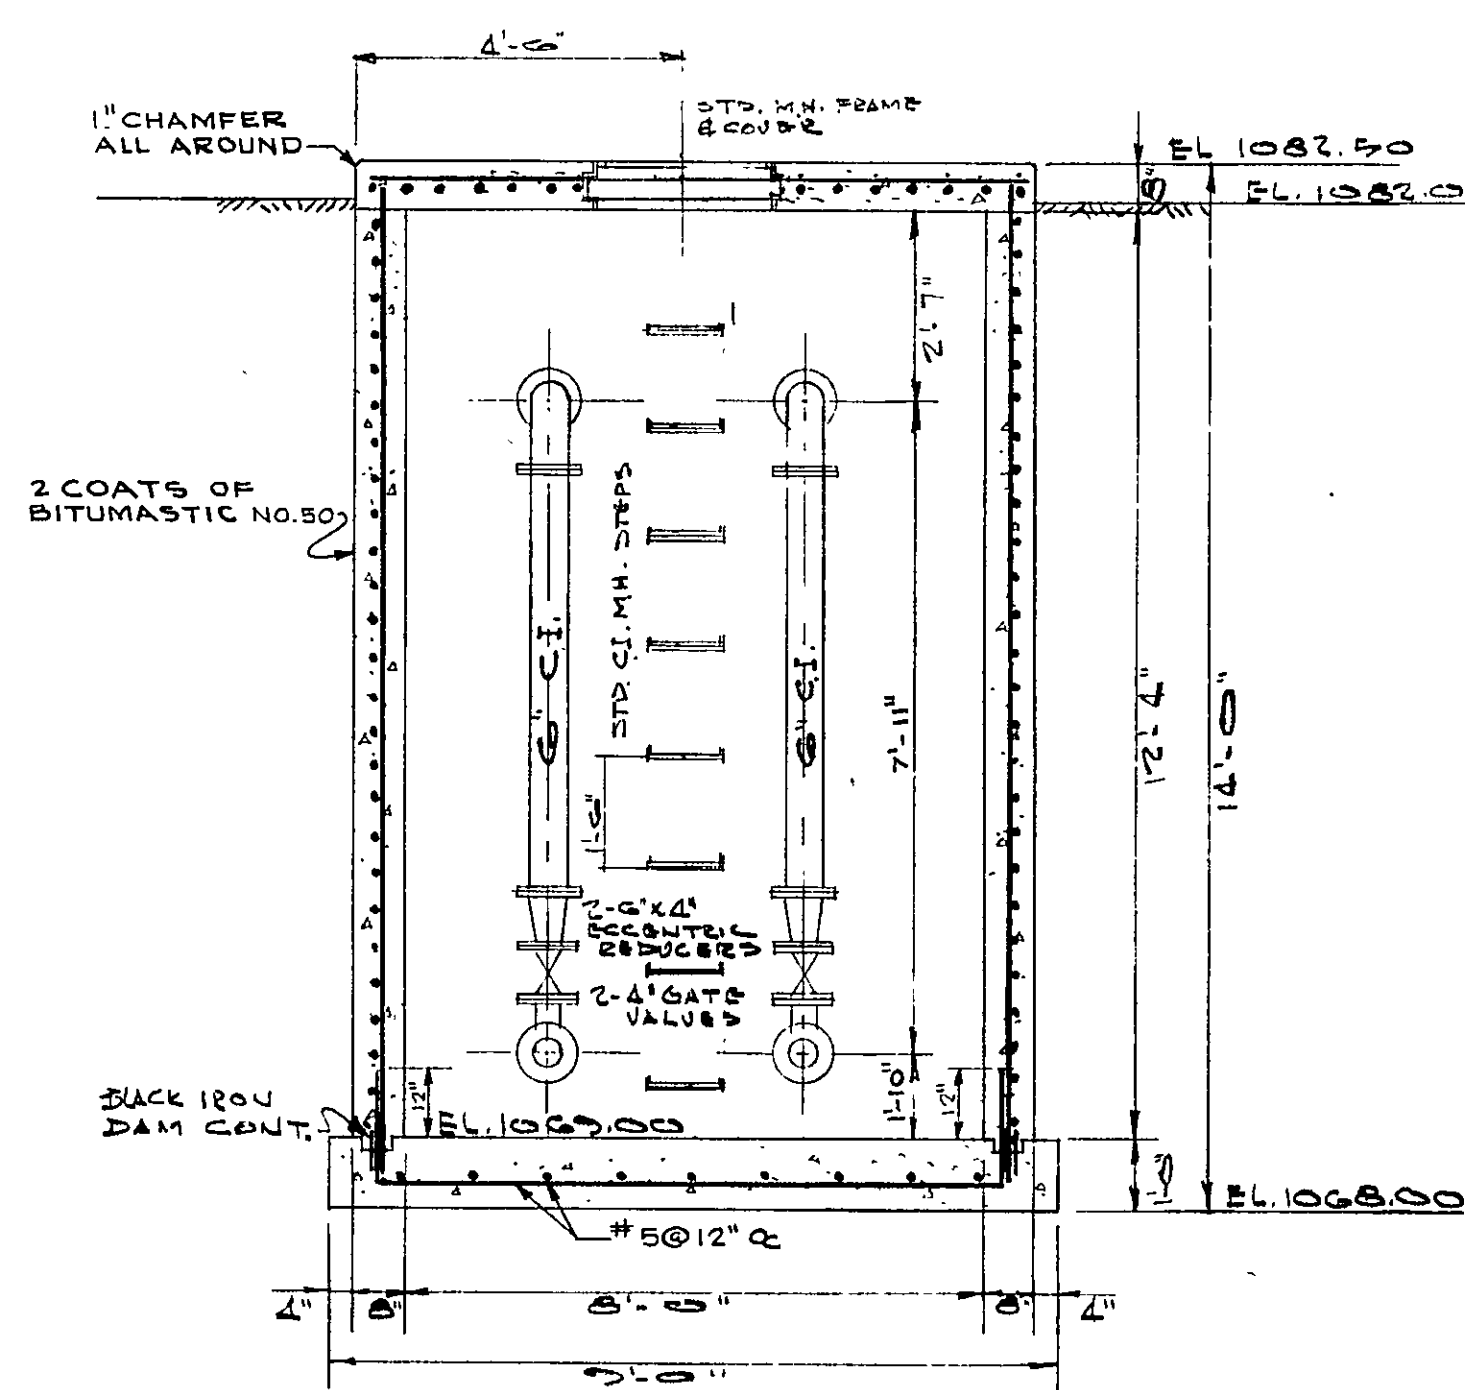

NOTES

1. FINAL SITE GRADING SHALL BE AS DIRECTED BY THE ENGINEER IN THE FIELD.
2. SLOPE TOP OF CONCRETE SLAB FROM CENTER TO ALL SIDES TO INSURE PROPER DRAINAGE.
3. FURNISH AND INSTALL ON THE FENCE TWO SIGNS NO. 32 PAINTED WITH 2 COATS OF PAINT AS SHOWN & MARKED CLEARLY WITH 2" HIGH WHITE LETTERS "DANGER KEEP OFF".
4. ALL PIPE, FITTINGS AND VALVES SHALL BE CLASS 150 CAST IRON WITH FLANGED FITTINGS AS SHOWN.
5. REFER TO SHEET NO. 13 FOR LOCATION OF PUMPING STATION.

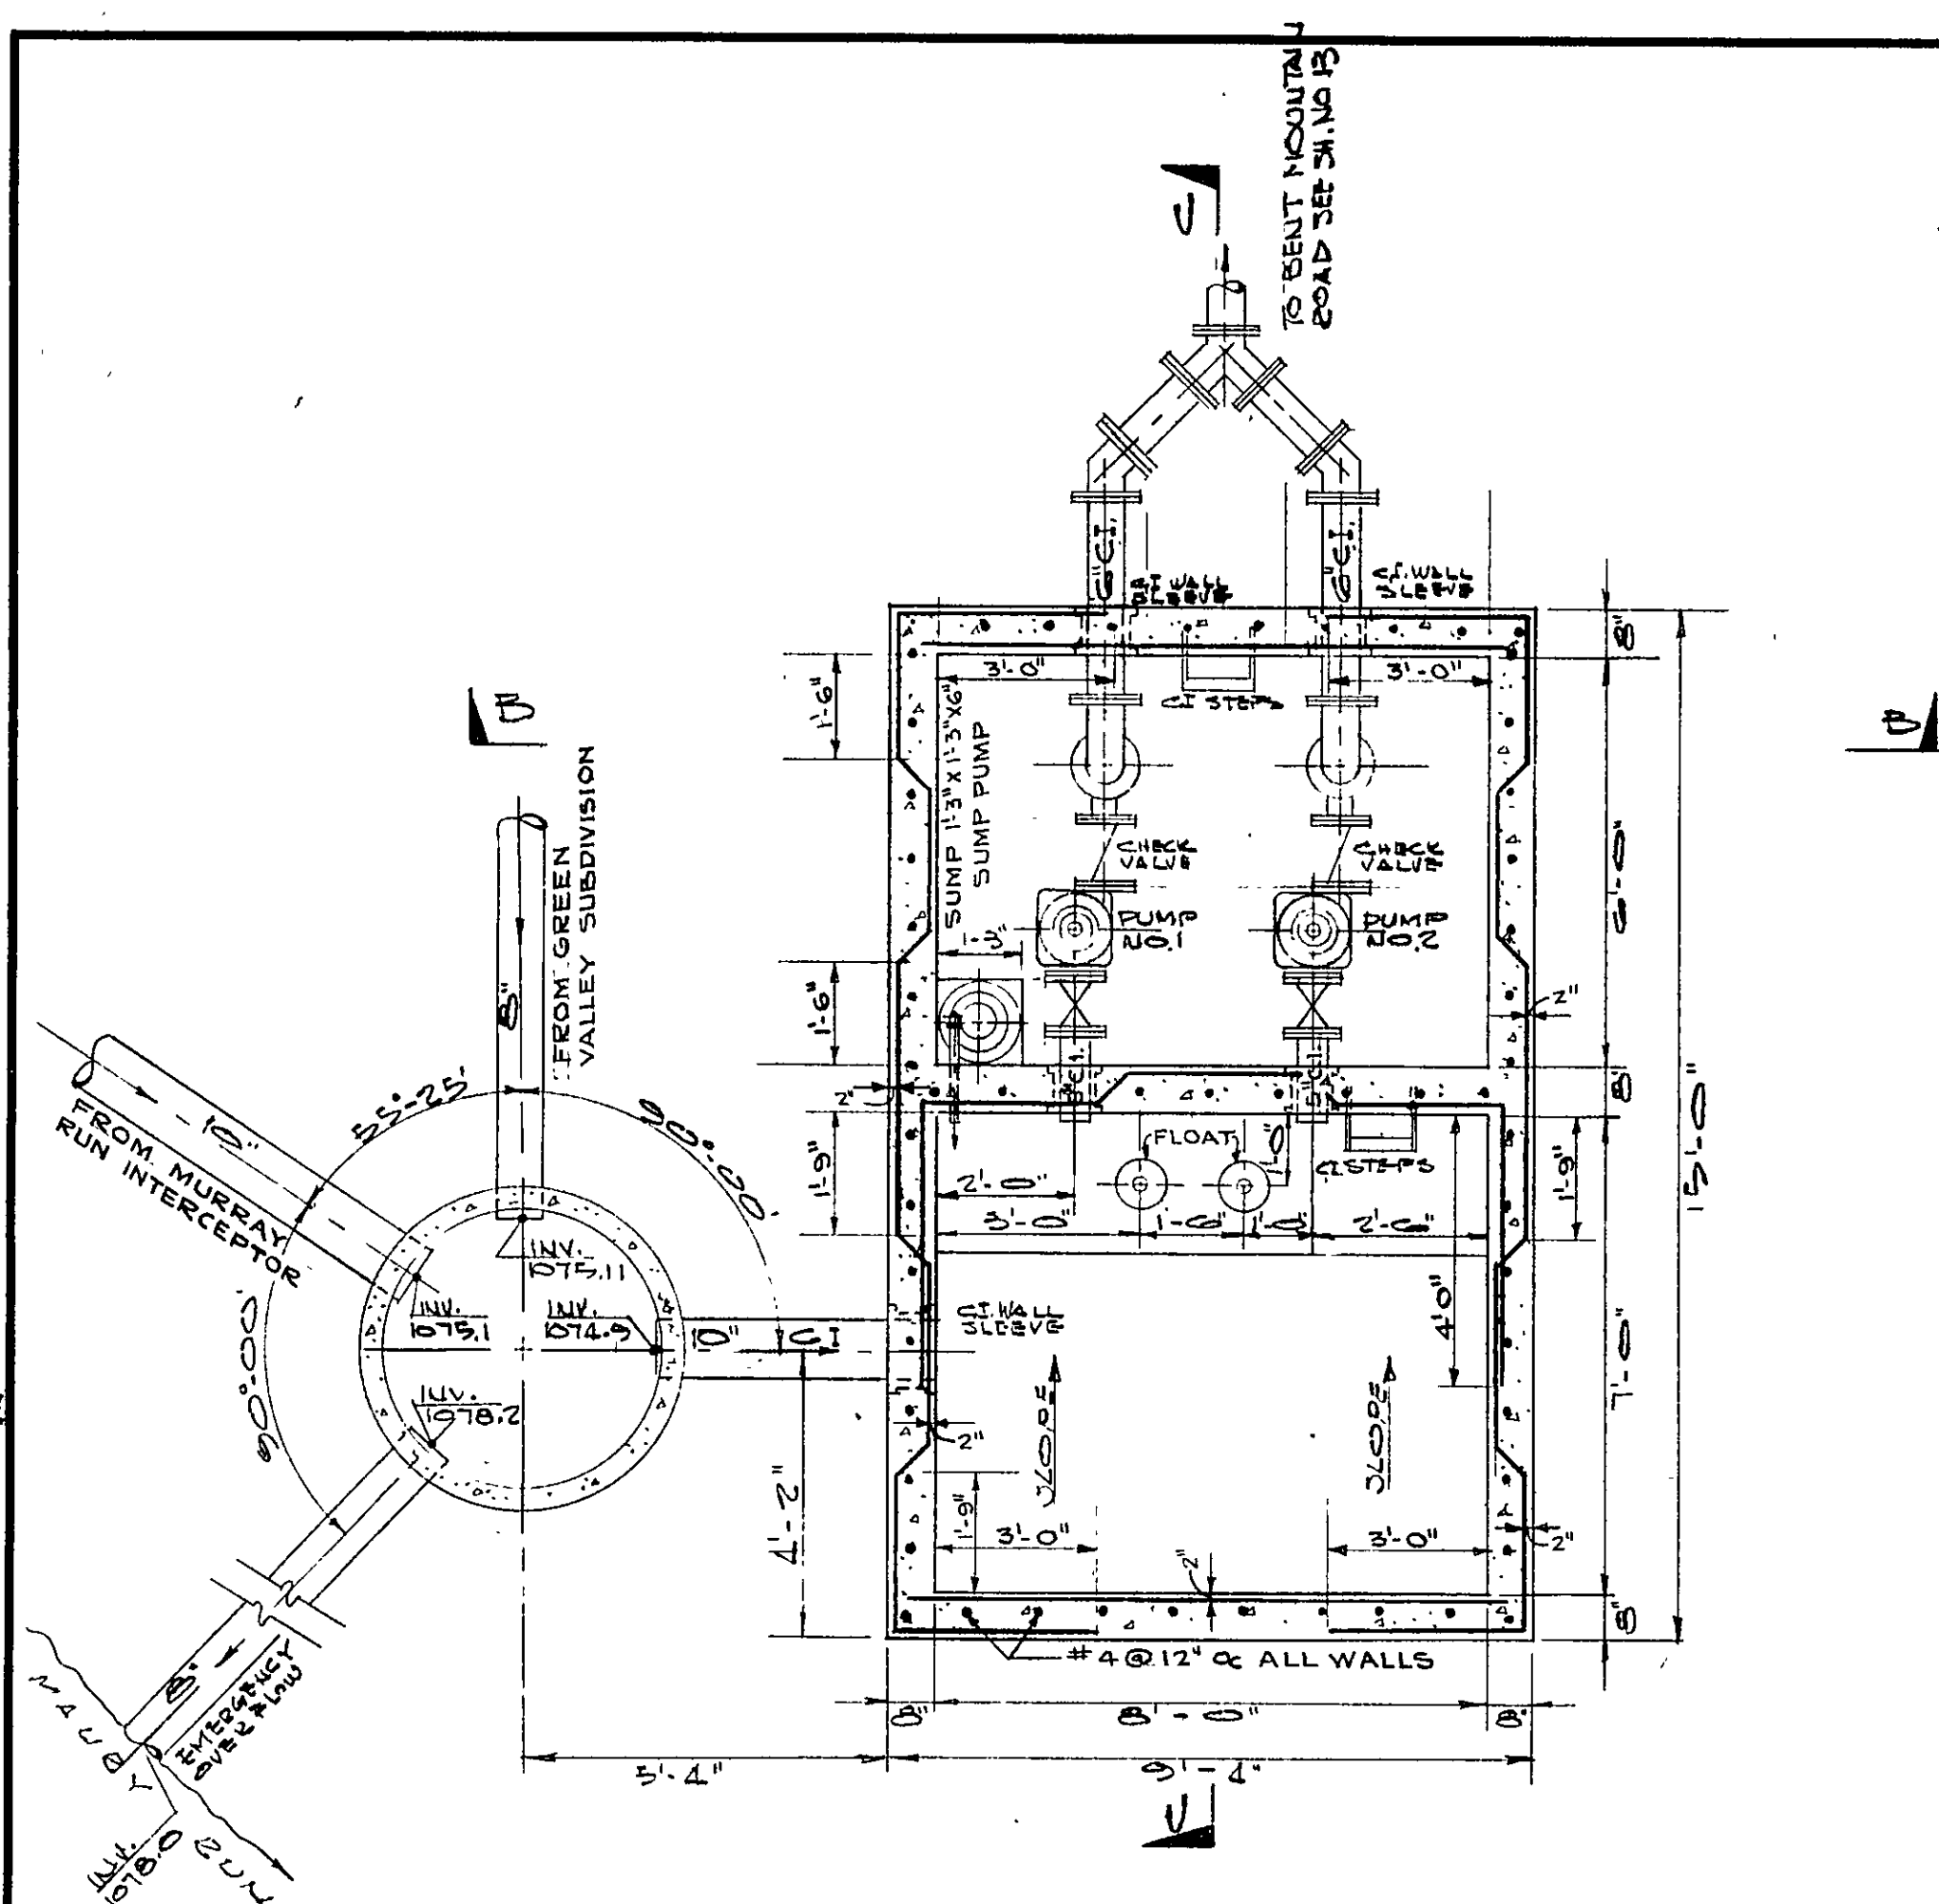

ROANOKE COUNTY SANITATION AUTHORITY
ROANOKE COUNTY, VIRGINIA

SANITARY SEWERAGE SYSTEM
PROJECT NO. 63-5

MURRAY RUN SEWAGE PUMPING STATION

DESIGNED: W.C.O.	LANGLEY & McDONALD	SCALE: AS SHOWN
PLOTTED: W.C.O.	CONSULTING ENGINEERS	DATE: FEB. 20, 1964
DRAWN: T.J.M.	NORFOLK, VA.	SHEET: 16 OF 17
CHECKED: T.J.M.		DWG. NO. 616180