
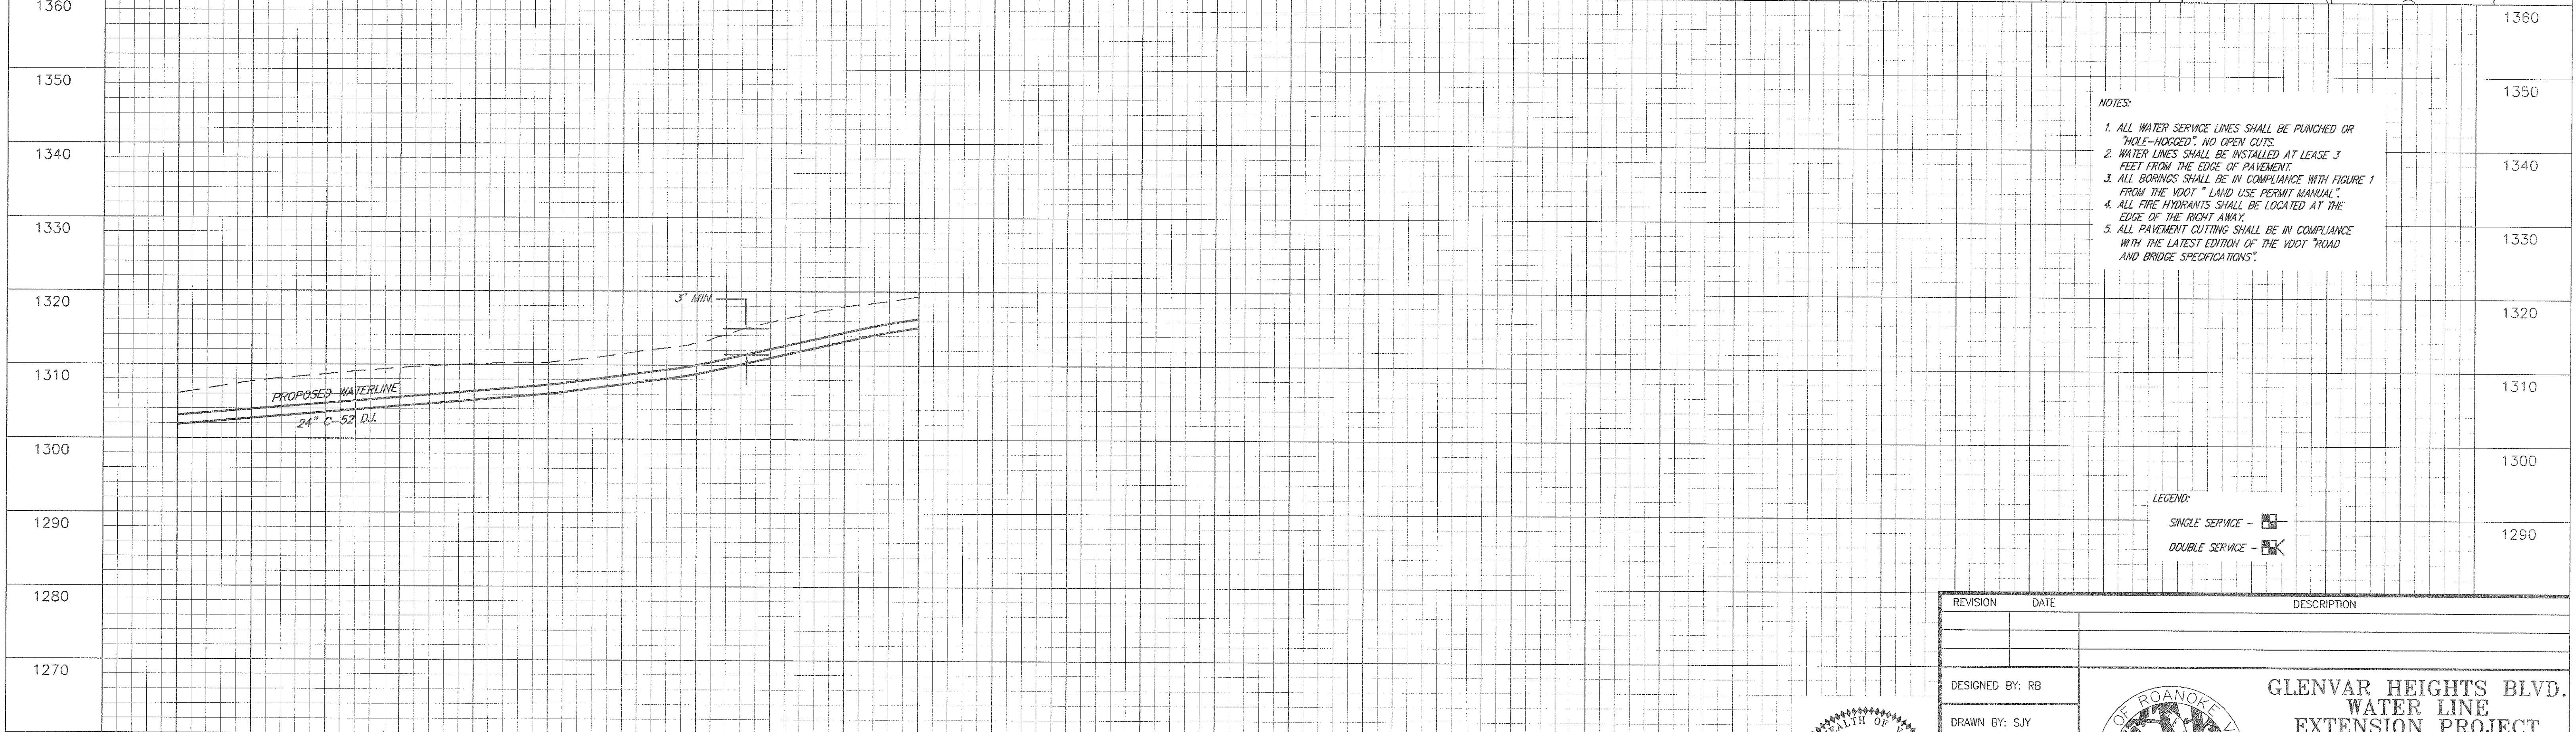


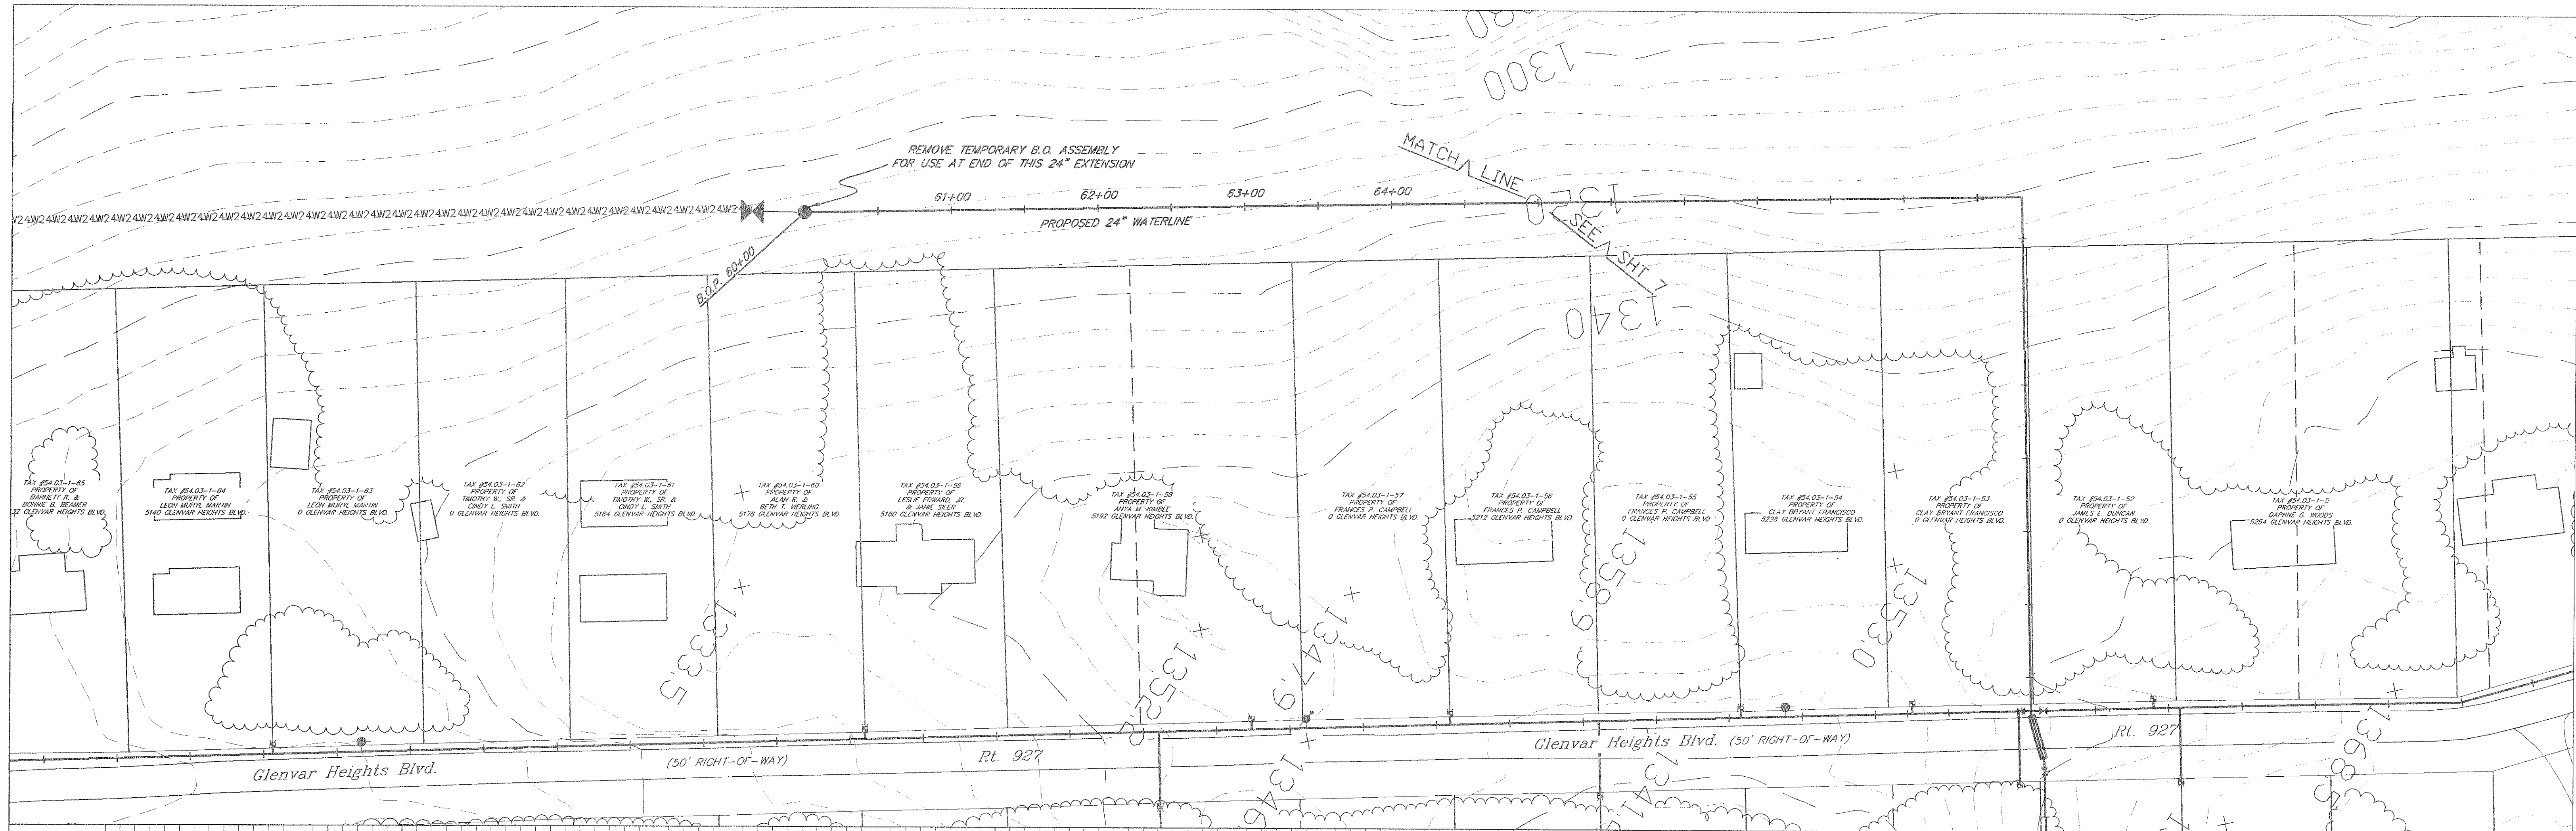

- NOTES:
1. ALL WATER SERVICE LINES SHALL BE PUNCHED OR "HOLE-HOGGED". NO OPEN CUTS.
 2. WATER LINES SHALL BE INSTALLED AT LEAST 3 FEET FROM THE EDGE OF PAVEMENT.
 3. ALL BORINGS SHALL BE IN COMPLIANCE WITH FIGURE 1 FROM THE VDOT "LAND USE PERMIT MANUAL".
 4. ALL FIRE HYDRANTS SHALL BE LOCATED AT THE EDGE OF THE RIGHT-OF-WAY.
 5. ALL PAVEMENT CUTTING SHALL BE IN COMPLIANCE WITH THE LATEST EDITION OF THE VDOT "ROAD AND BRIDGE SPECIFICATIONS".

- LEGEND:
- SINGLE SERVICE - [Symbol]
 - DOUBLE SERVICE - [Symbol]

REVISION	DATE	DESCRIPTION

DESIGNED BY: RB
DRAWN BY: SJY
CHECKED BY:
SCALE: 1"= 50' HOR.
1"= 10' VERT.
DATE: 18 OCT 2002

**GLENVAR HEIGHTS BLVD.
WATER LINE
EXTENSION PROJECT**
CATANBA MAGISTERIAL DISTRICT
ROANOKE COUNTY, VIRGINIA
ROANOKE COUNTY UTILITY DEPARTMENT
1206 KESSLER MILL ROAD
SALEM, VIRGINIA 24153

SHEET 6 OF 8