
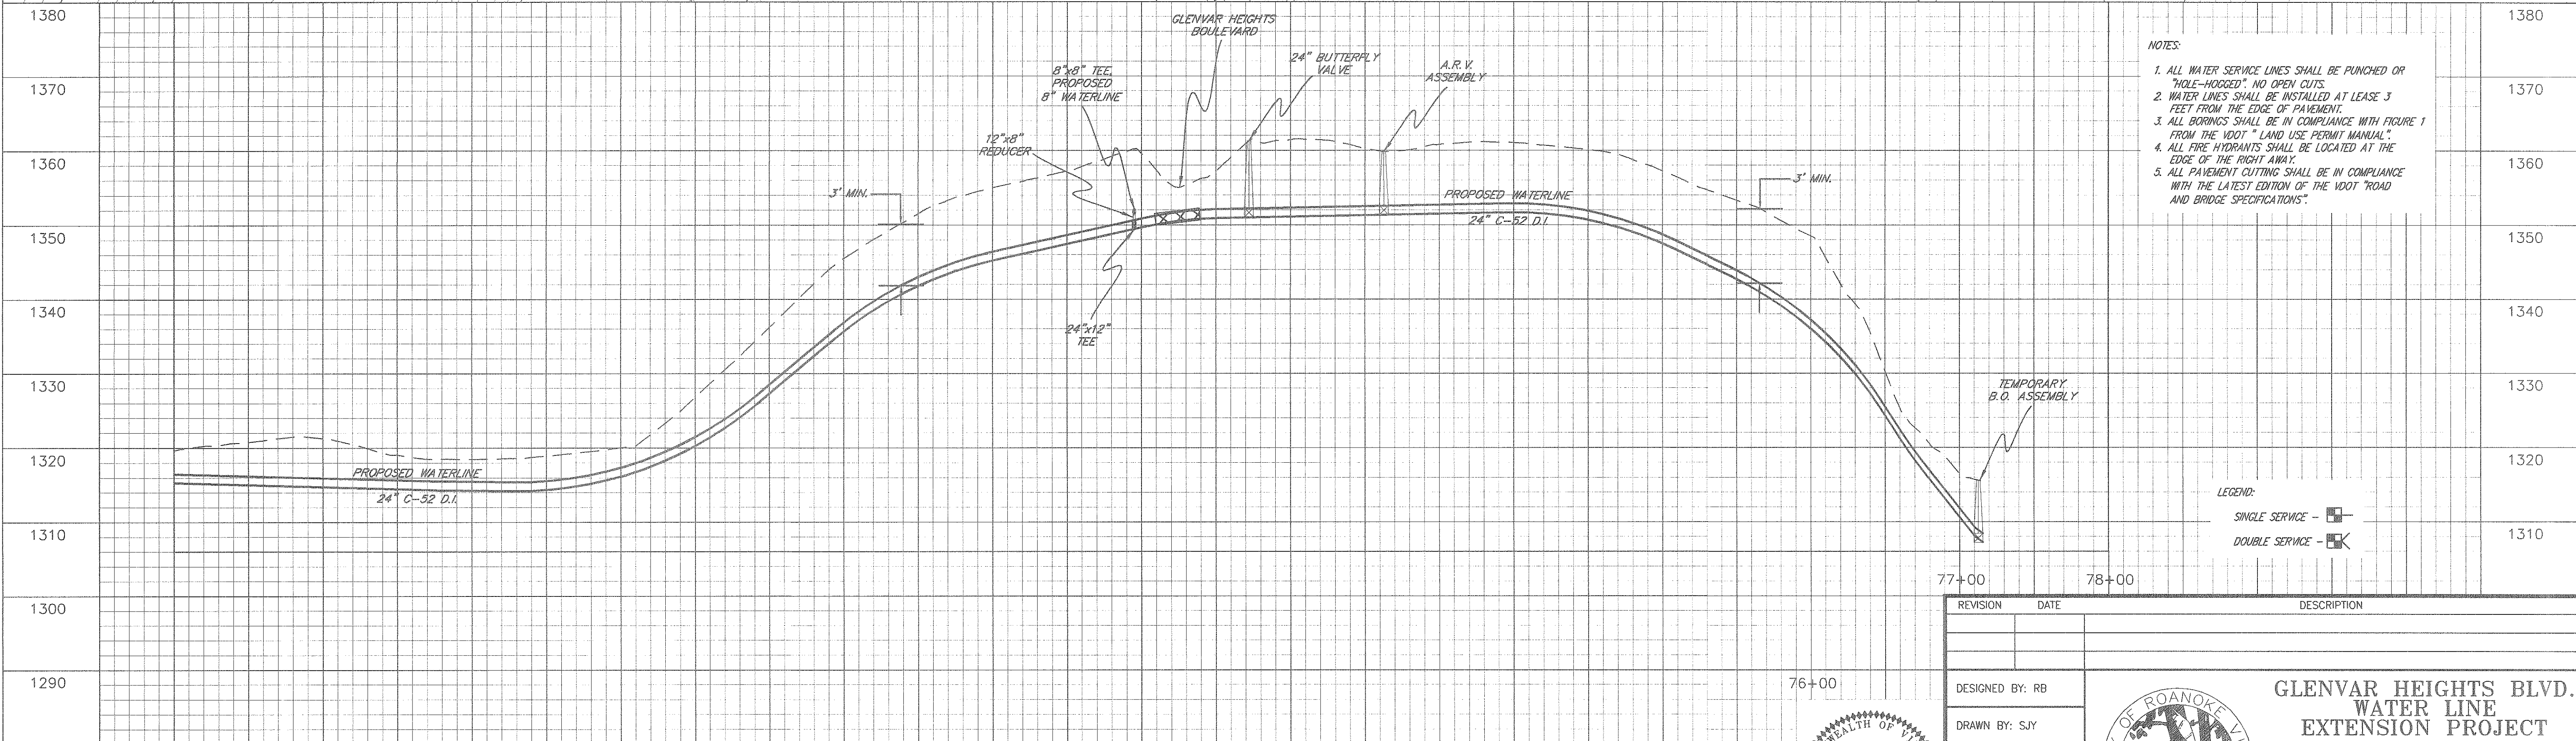


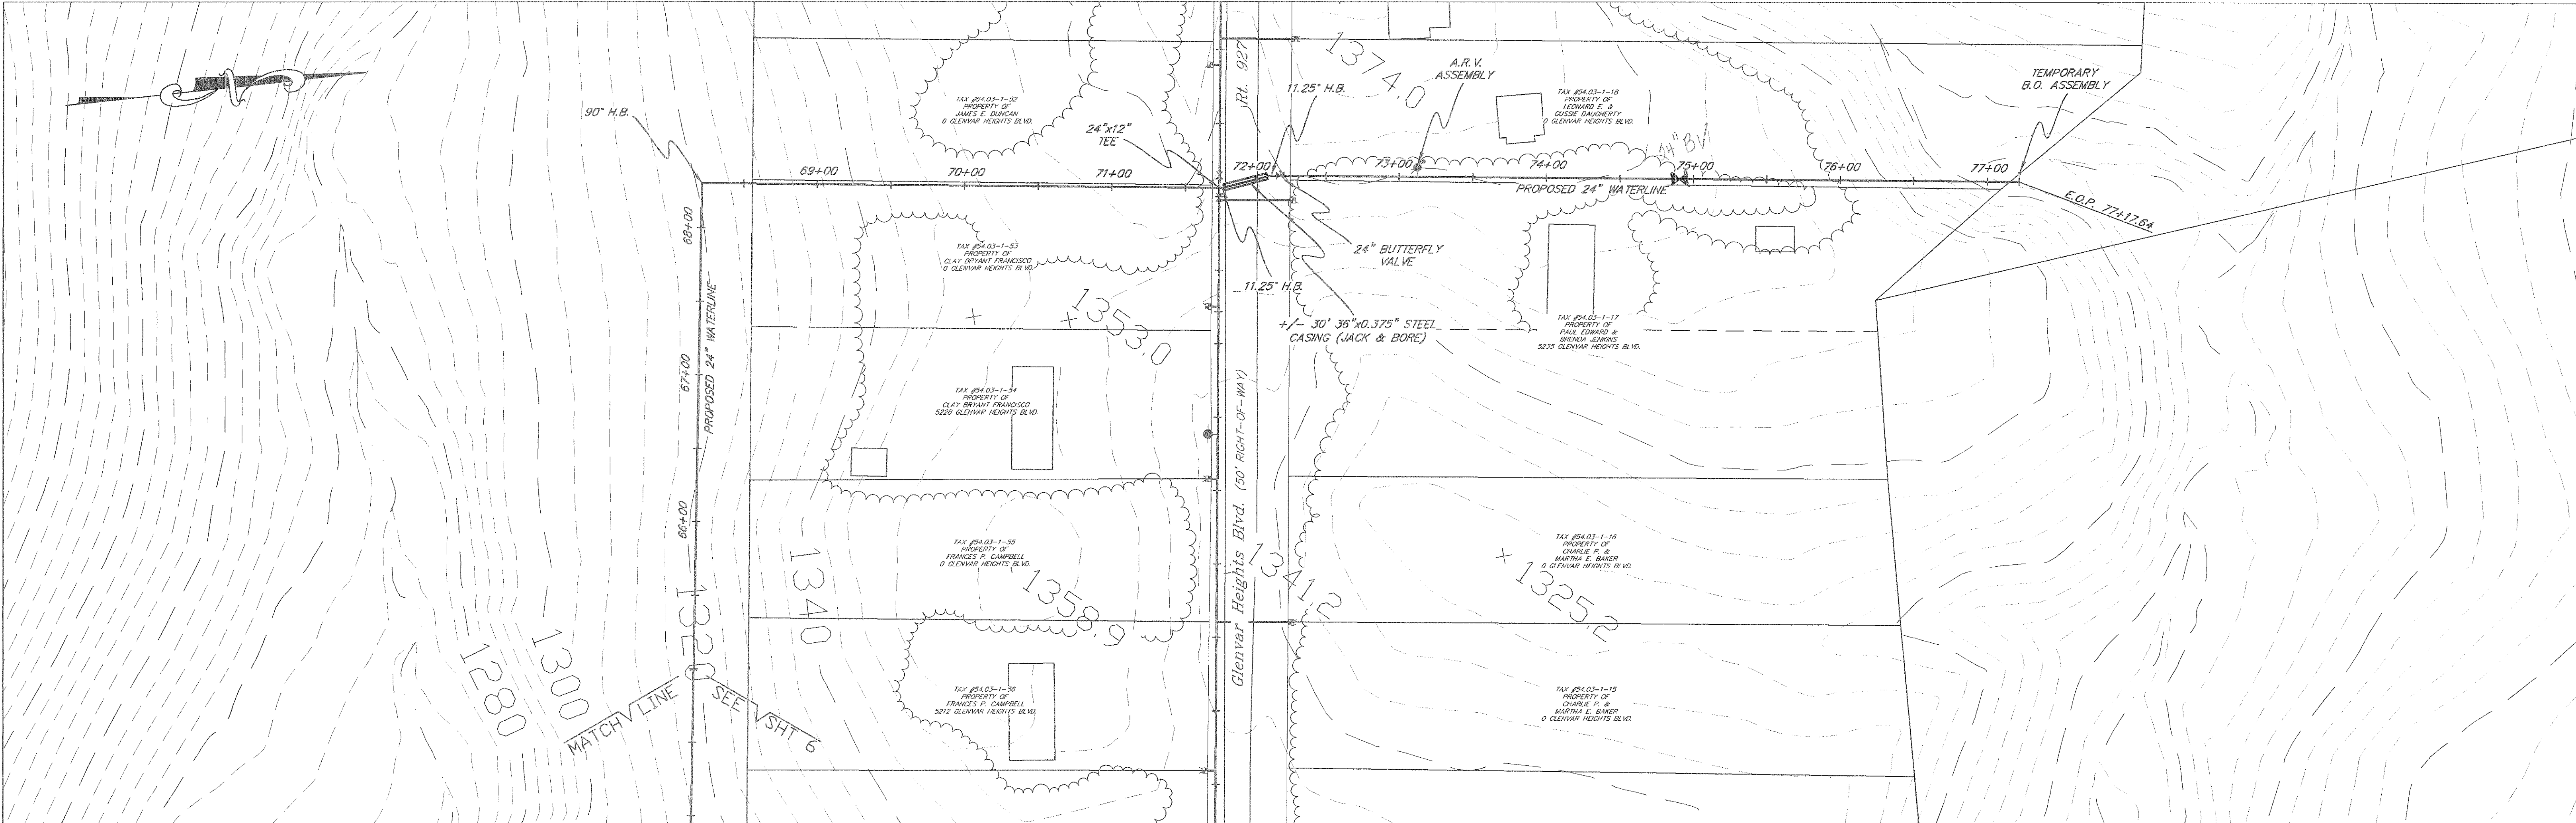


- NOTES:
1. ALL WATER SERVICE LINES SHALL BE PUNCHED OR "HOLE-HOGGED", NO OPEN CUTS.
 2. WATER LINES SHALL BE INSTALLED AT LEAST 3 FEET FROM THE EDGE OF PAVEMENT.
 3. ALL BORINGS SHALL BE IN COMPLIANCE WITH FIGURE 1 FROM THE VDOT "LAND USE PERMIT MANUAL".
 4. ALL FIRE HYDRANTS SHALL BE LOCATED AT THE EDGE OF THE RIGHT AWAY.
 5. ALL PAVEMENT CUTTING SHALL BE IN COMPLIANCE WITH THE LATEST EDITION OF THE VDOT "ROAD AND BRIDGE SPECIFICATIONS".

LEGEND:

SINGLE SERVICE - [Symbol]

DOUBLE SERVICE - [Symbol]

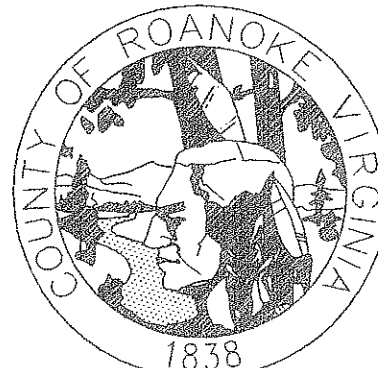REVISION	DATE	DESCRIPTION
DESIGNED BY: RB	 GLENVAR HEIGHTS BLVD. WATER LINE EXTENSION PROJECT CATAMBA MAGISTERIAL DISTRICT ROANOKE COUNTY, VIRGINIA ROANOKE COUNTY UTILITY DEPARTMENT 1206 KESSLER MILL ROAD SALEM, VIRGINIA 24153	
DRAWN BY: SJY		
CHECKED BY:		
SCALE: 1"= 50' HOR. 1"= 10' VERT.		
DATE: 18 OCT 2002	SHEET 7 OF 8	

ROBERT W. BENNINGER
No. 10252
PROFESSIONAL ENGINEER