


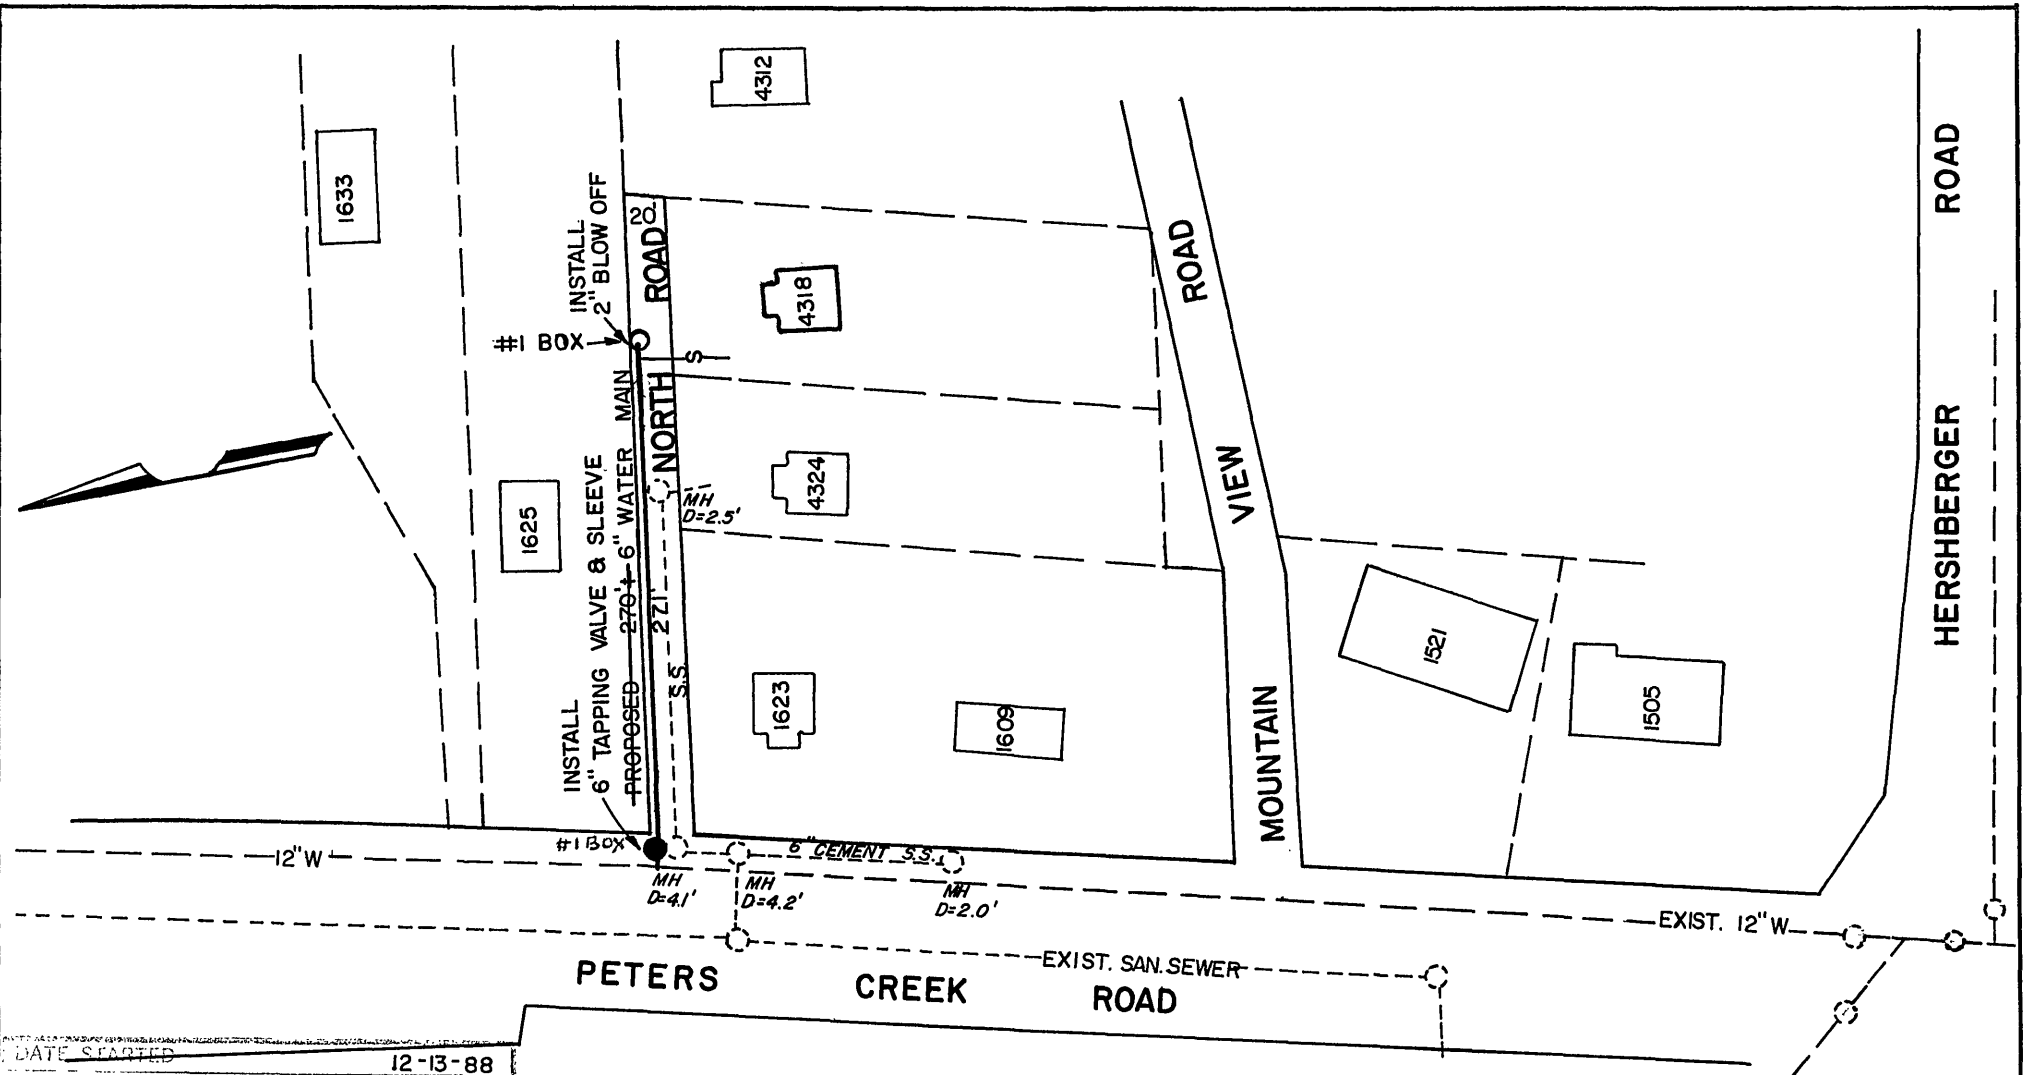

DATE STARTED 12-13-88				
DATE COMP. 12-20-88				
FEET MAIN	SIZE	VALVE	VAULT	BOX
271'	6	1		#1
F.H. COMP. $\oplus$				
F.H. STUB ONLY $\oplus$				
SERV. INS. BY:				
MAIN INS. BY: CALVIN O. DAME				
NO. 3/4" SERV. INS.				
CITY OR CO.		CITY		
DEPT. INSP.		ULS.		

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

WATER DEPARTMENT	
ROANOKE	VIRGINIA
NORTH ROAD, N.W.	
SCALE: 1"=100'	11/30/88
DATE: 11/23/88	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 638	11-30-88
PLAN NO.: 88-15	DIRECTOR OF PUBLIC WORKS DATE

James H. Pinkney
MANAGER UTILITY LINE SERVICES