


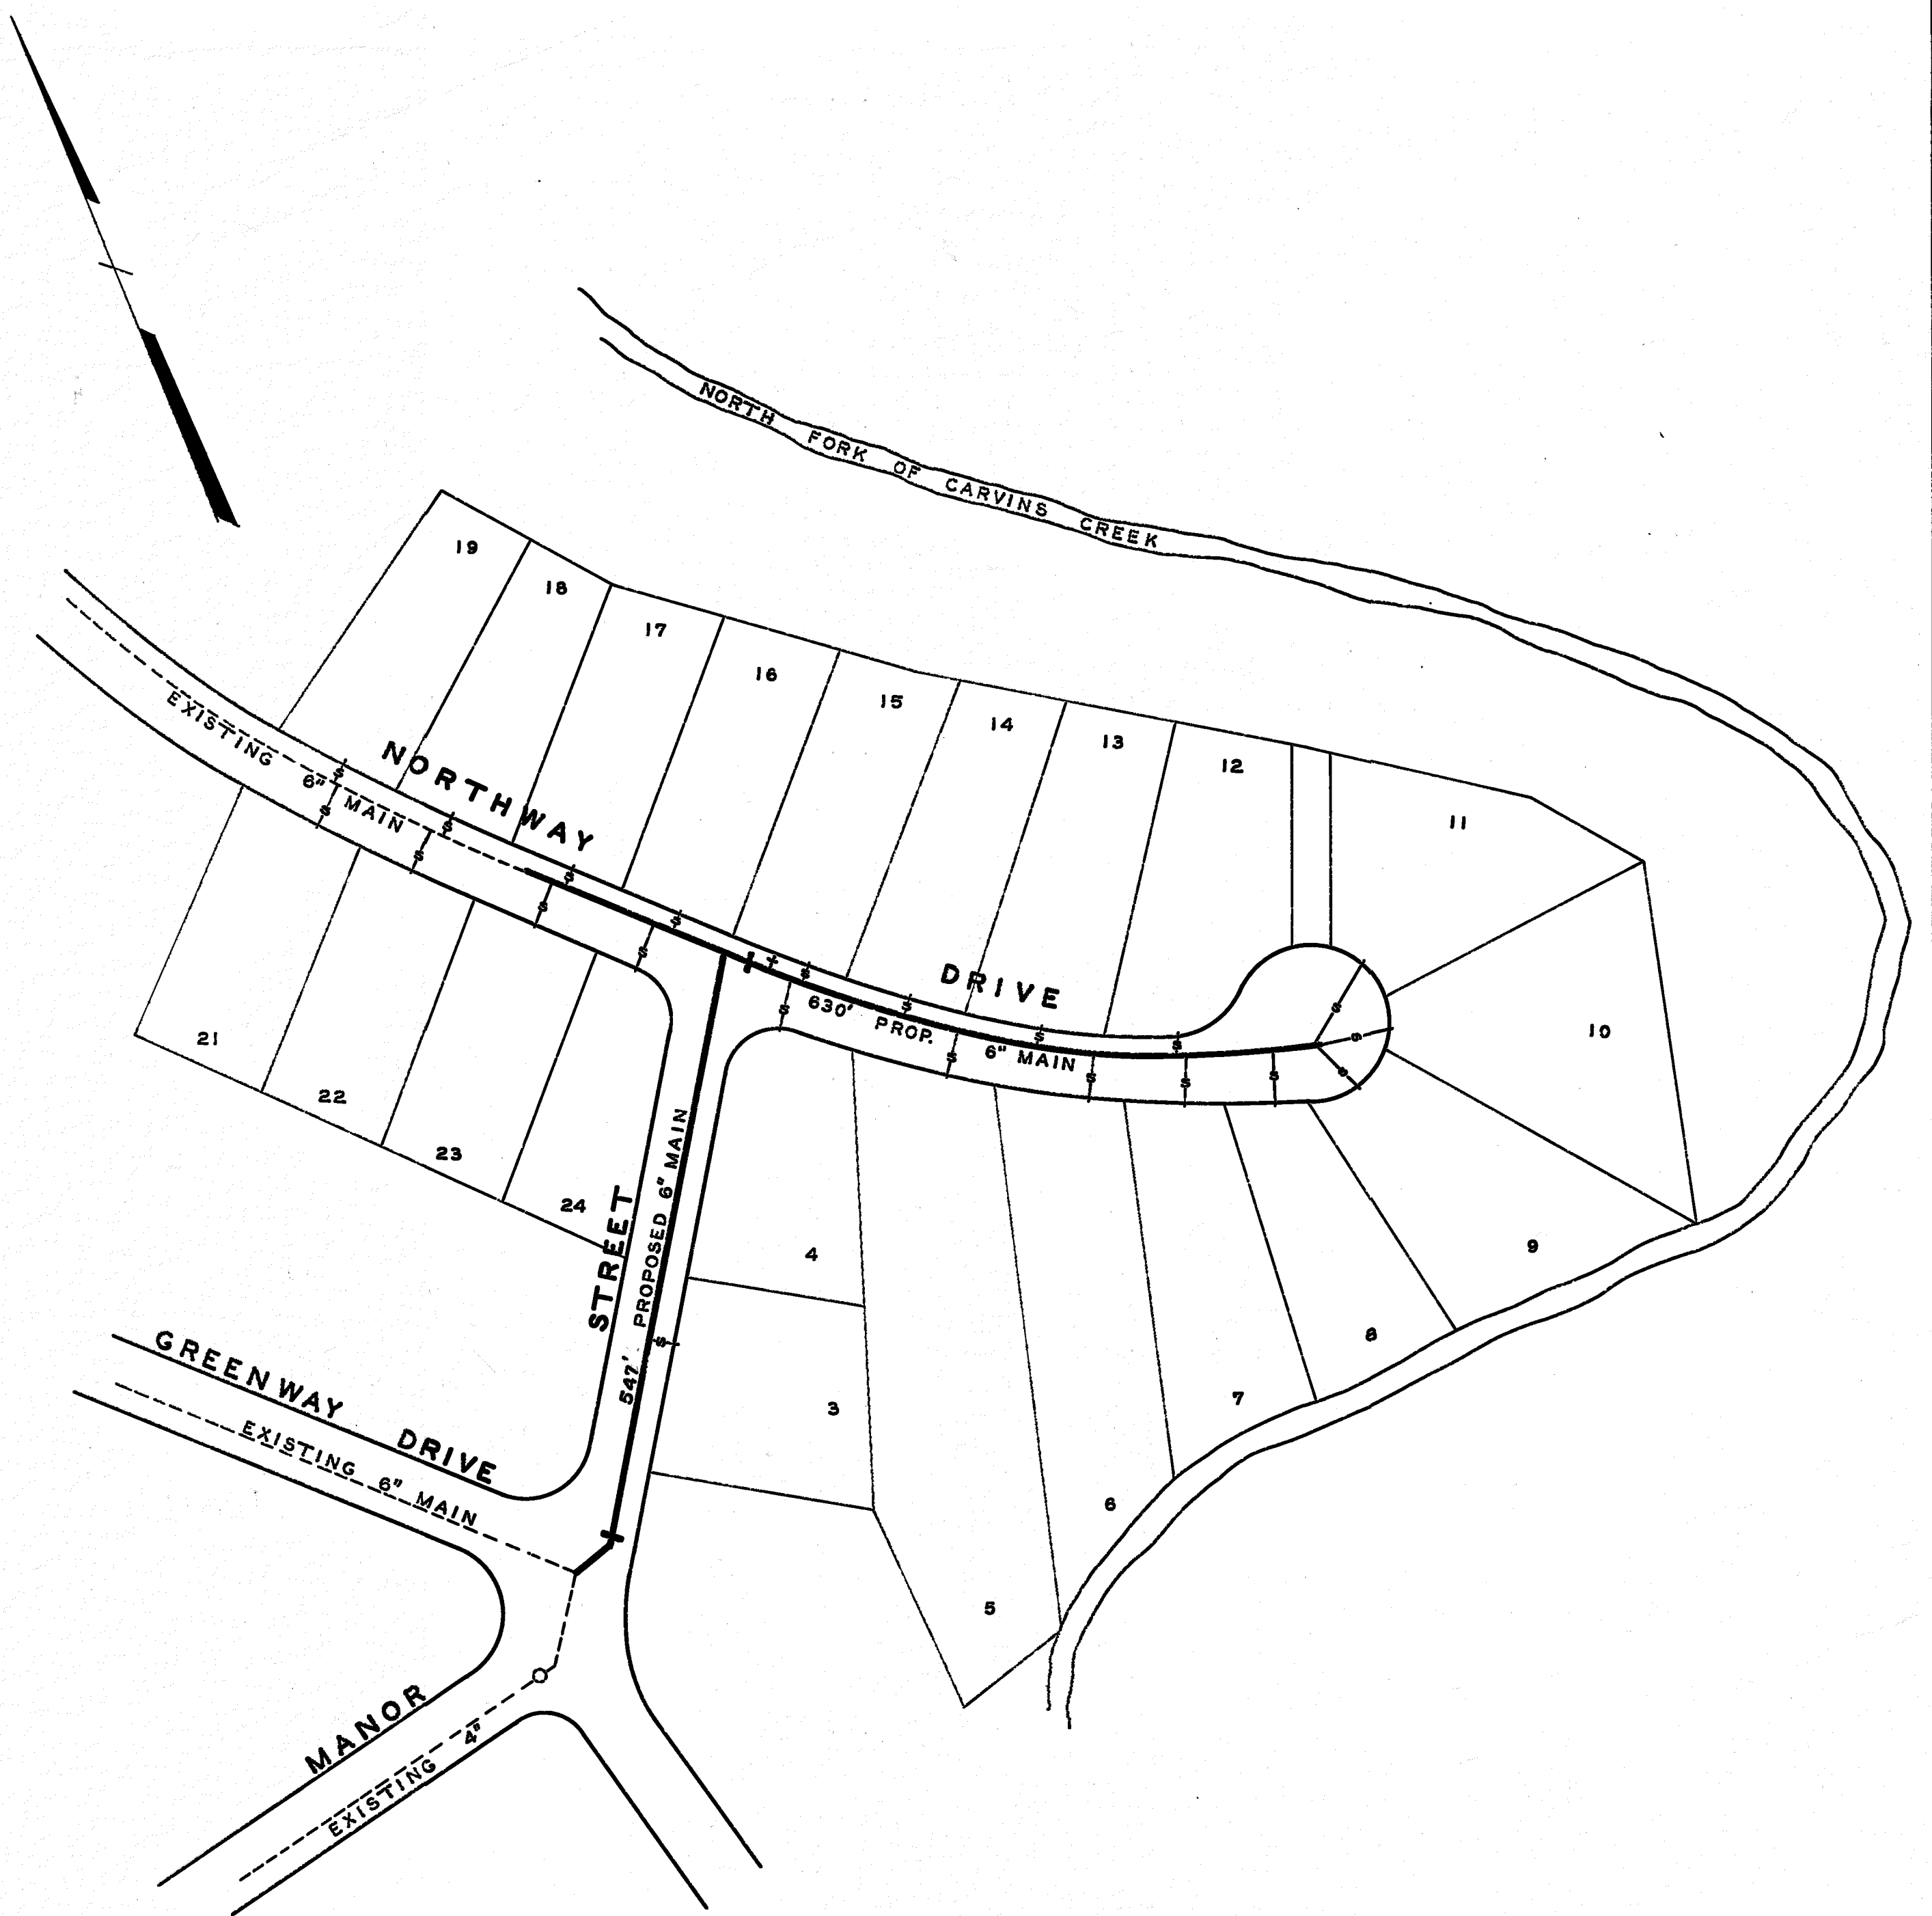

DATE STARTED		DEC 6 1962		
DATE COMP.		JAN 22 1963		
FEET MAIN	SIZE	VALVE	VAULT	BOX
1177	6"	2	2	
F. H. COMP.				
F. H. STUB ONLY	1	6"	1	1
SERV. INS. BY: J. P. TURNER & BROS.				
MAINS INS. BY: J. P. TURNER & BROS.				
NO. 3/4" SERV. INS.		17		
CITY OR CO.		COUNTY		
DEPT. INSP.		L. E. T. & D. T. M.		

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 NORTHWAY DR. & MANOR ST.
 SCALE - 1" = 100'
 DRAWN BY N.H.C. SEPT. 11, 1962