


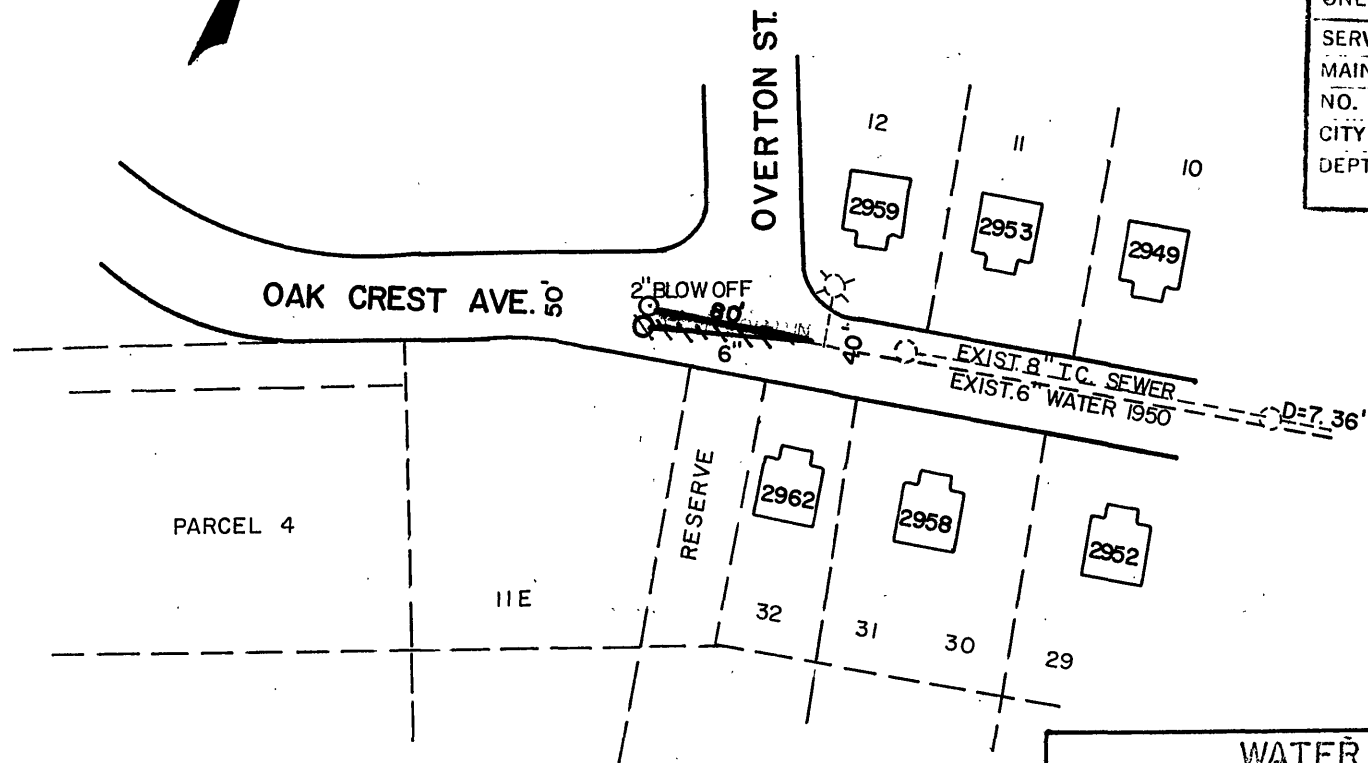

DATE STARTED 2-25-87				
DATE COMP. 3-4-87				
FEET MAIN	SIZE	VALVE	VAULT	BOX
80'	6"			
BLOW OFF	2"			1
F. H. COMP. 0				
F. H. STUB ONLY 0				
SERV. INS. BY: C. DAME				
MAIN INS. BY: C. DAME				
NO. 3/4" SERV. INS. ONE (1)				
CITY OR CO. CITY				
DEPT. INSP. U.L.S.				

NOTE: ALL EXIST. UTILITIES TO BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

[Signature]
MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT	
ROANOKE	VIRGINIA
OAK CREST AVENUE, S.W.	
SCALE: 1" = 100'	<i>[Signature]</i> 1/24/87
DATE: 12/2/86	DIRECTOR UTILITIES & OPERATIONS' DATE
DIST. MAP: 165	<i>[Signature]</i> 1/12/87
PLAN NO.: 86-17	DIRECTOR OF PUBLIC WORKS DATE