
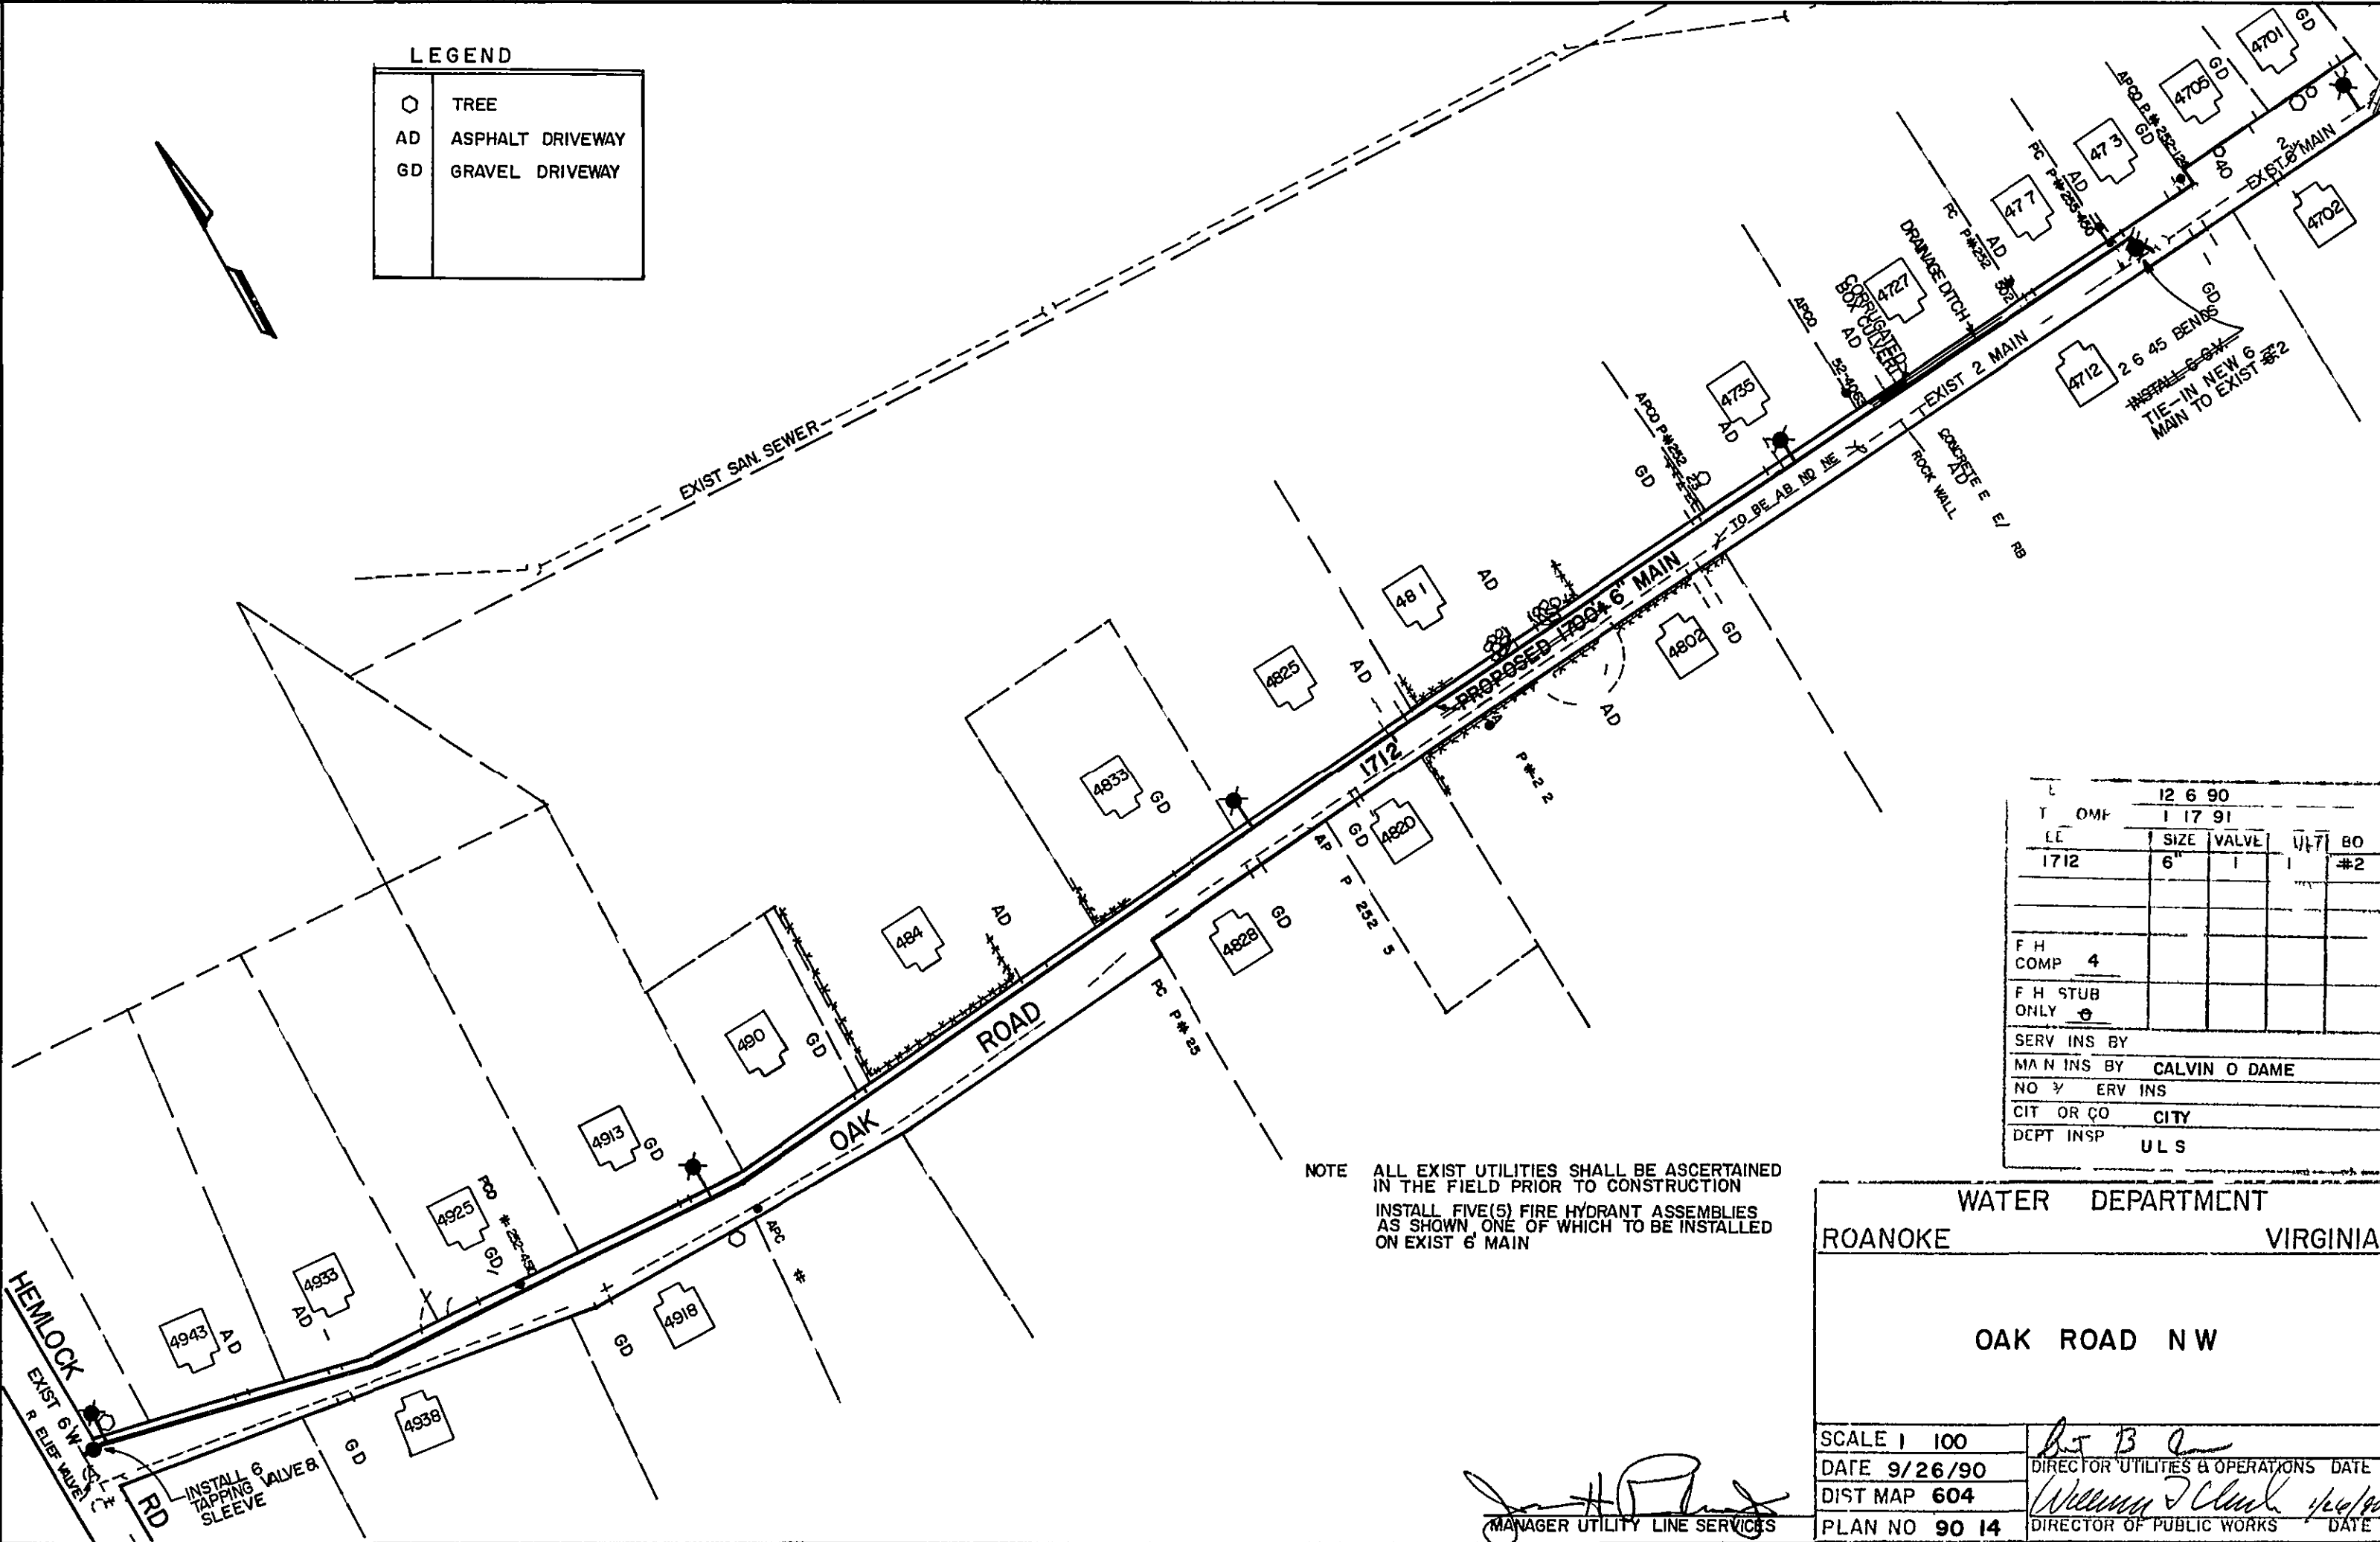


LEGEND

○ TREE
AD ASPHALT DRIVEWAY
GD GRAVEL DRIVEWAY



NOTE ALL EXIST UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION
INSTALL FIVE(5) FIRE HYDRANT ASSEMBLIES AS SHOWN ONE OF WHICH TO BE INSTALLED ON EXIST 6" MAIN

L	12 6 90			
T OMF	1 17 91			
LE	SIZE	VALVE	UT	BO
1712	6"	1	1	#2
F H COMP	4			
F H STUB ONLY	⊕			
SERV INS BY				
MA N INS BY	CALVIN O DAME			
NO Y ERV INS				
CIT OR CO	CITY			
DCPT INSP	ULS			

WATER DEPARTMENT
ROANOKE VIRGINIA

OAK ROAD NW

SCALE 1 100	DATE 9/26/90	DIRECTOR UTILITIES & OPERATIONS DATE
DIST MAP 604	PLAN NO 90 14	DATE

MANAGER UTILITY LINE SERVICES