



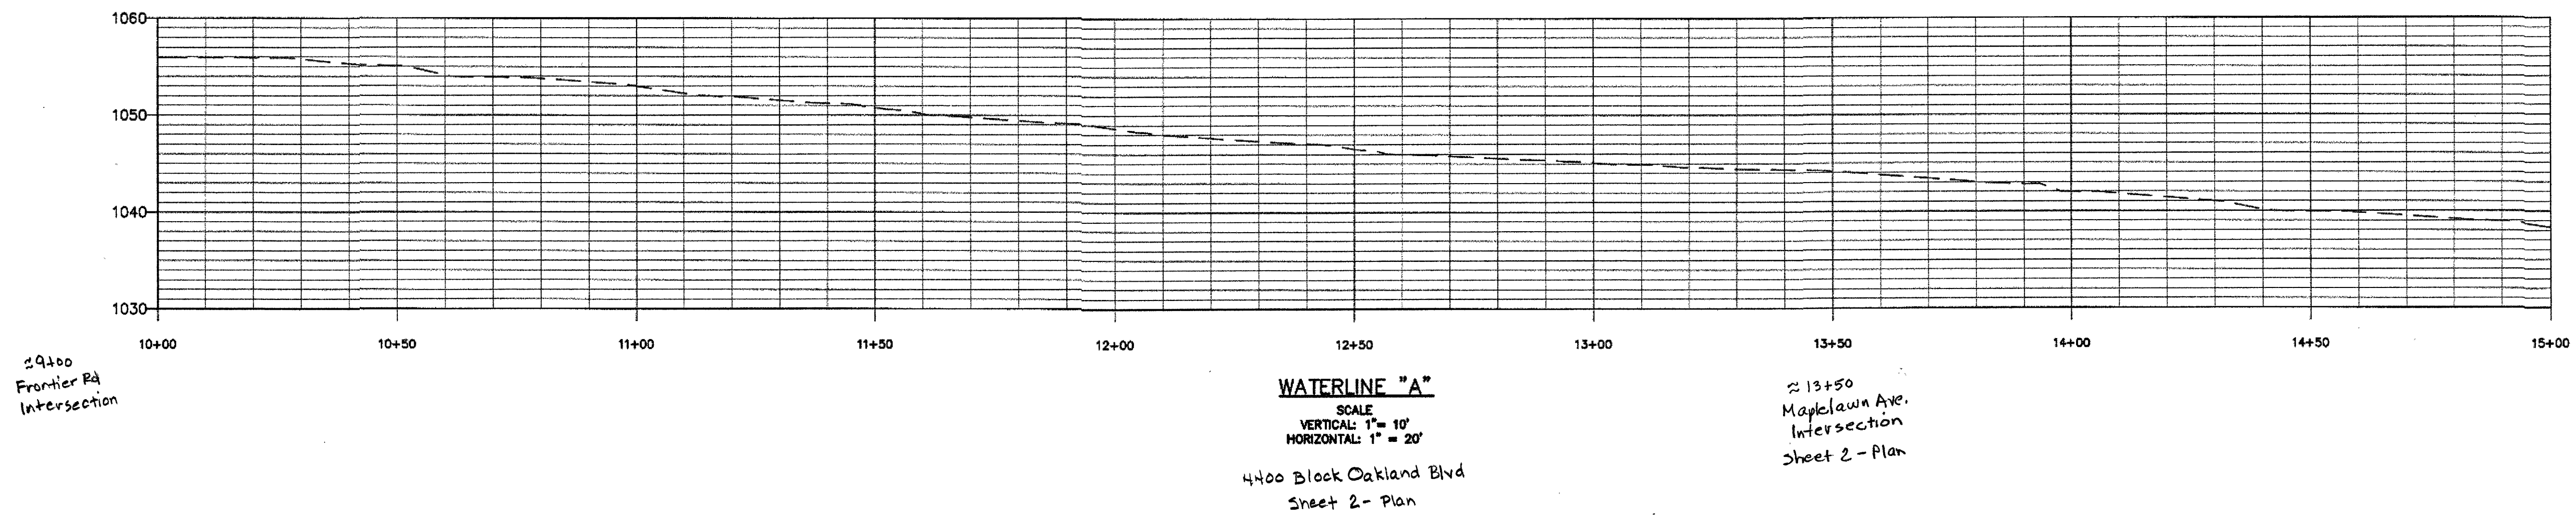

GENERAL NOTES:
 1. CONTRACTOR SHALL RECORD VERTICAL AS-BUILT DATA TO INCLUDE DEPTHS OF WATER MAIN, WATER MAIN FEATURES & ALL UTILITY CROSSINGS.

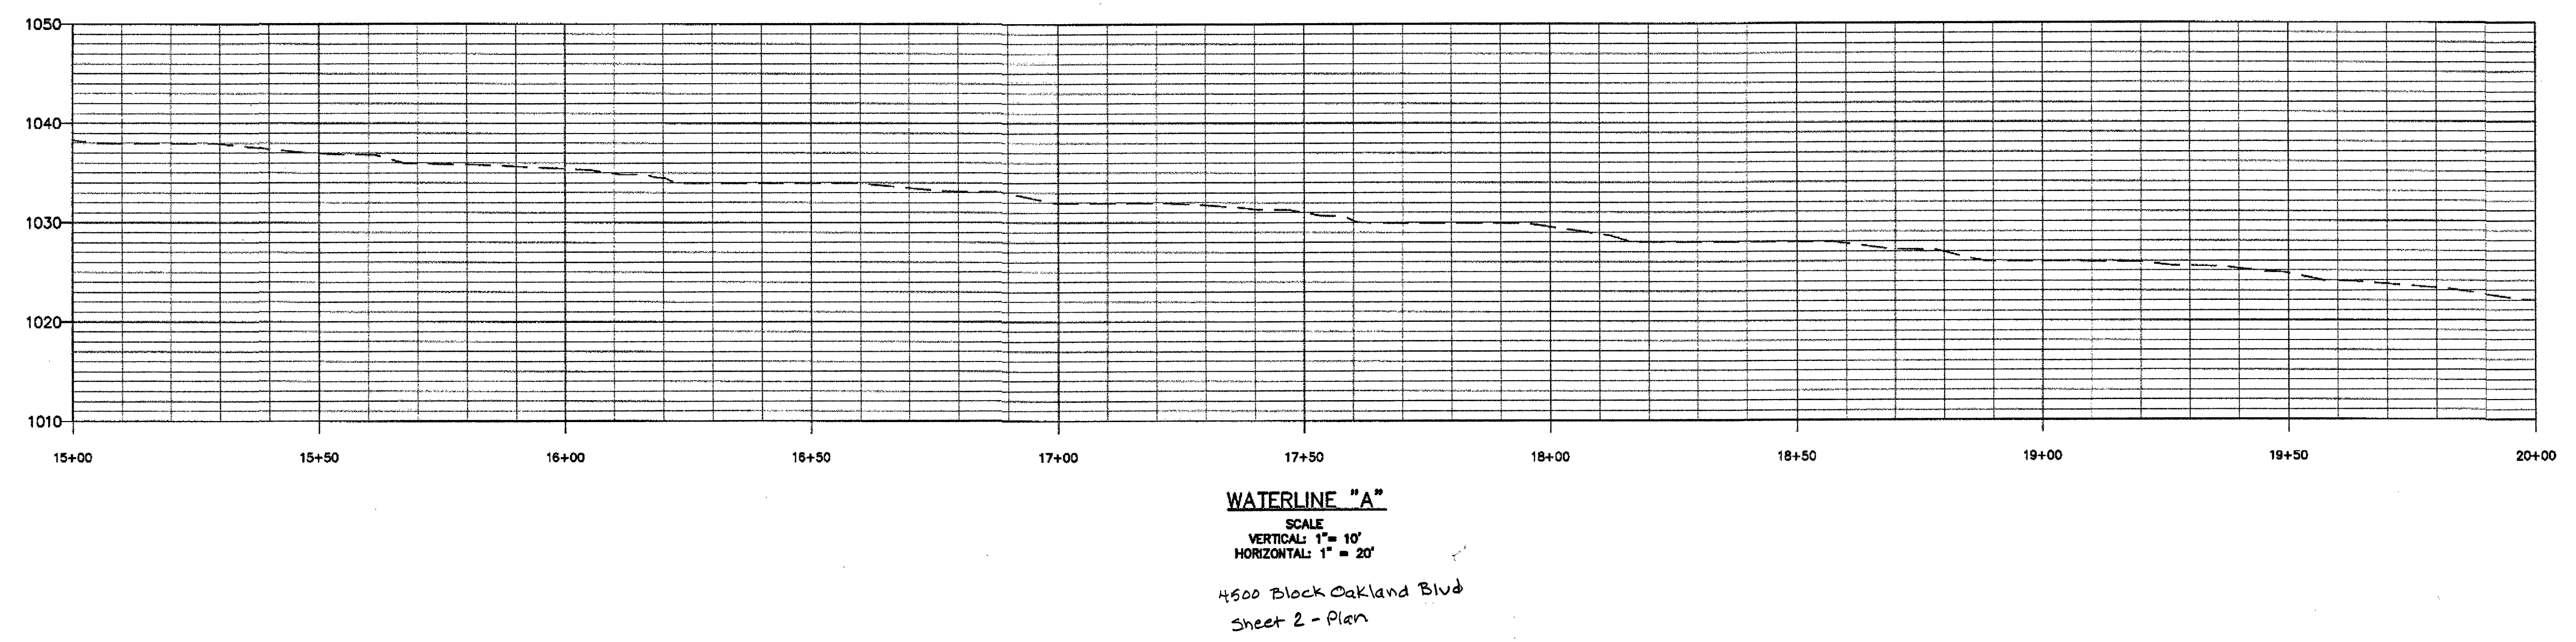

WESTERN VIRGINIA

WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

OAKLAND II WATERLINE REPLACEMENT

PROFILES

Rev	Description	Date	By

Designed: DRJ

Drawn: DRJ

Checked: WCB

Approved: WCB

Date: MAR. 2019

Project: WCIP-337

5

Sheet 5 of 8