

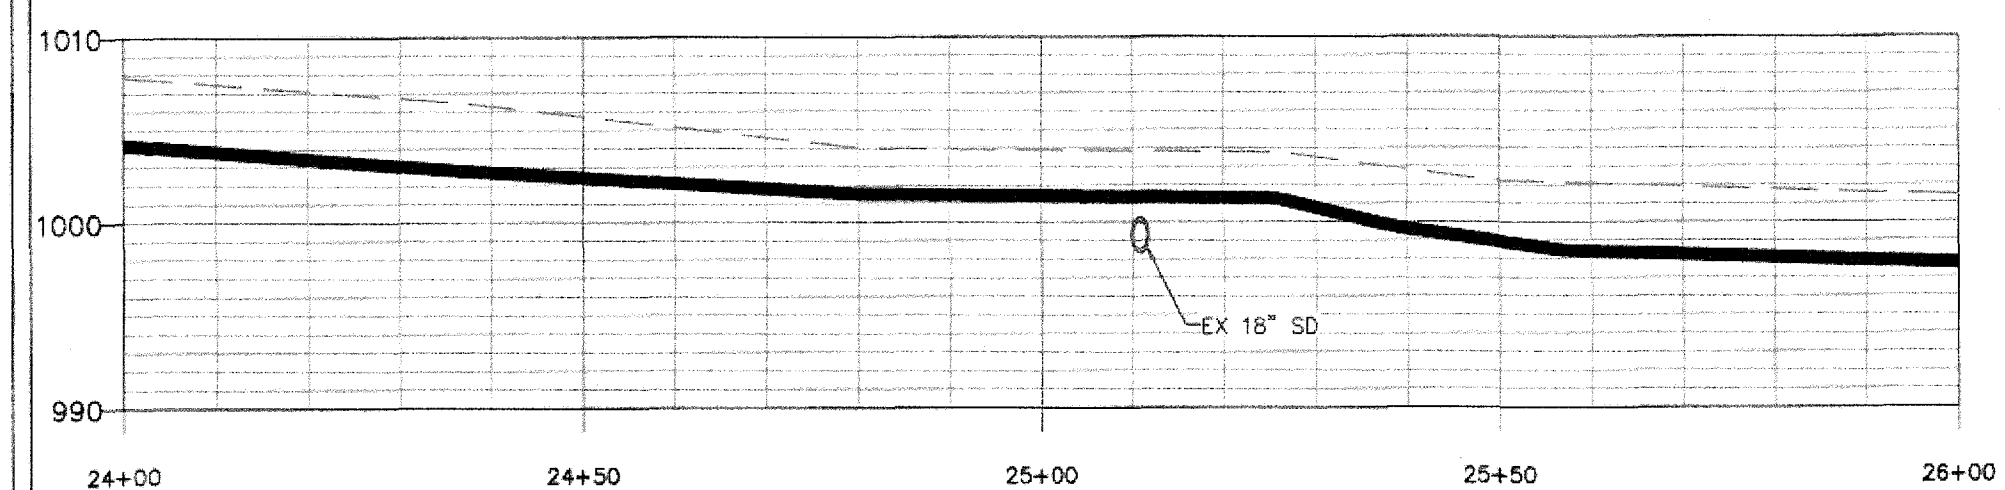


GENERAL NOTES:
1. CONTRACTOR SHALL RECORD VERTICAL AS-BUILT DATA TO INCLUDE DEPTHS OF WATER MAIN, WATER MAIN FEATURES & ALL UTILITY CROSSINGS.

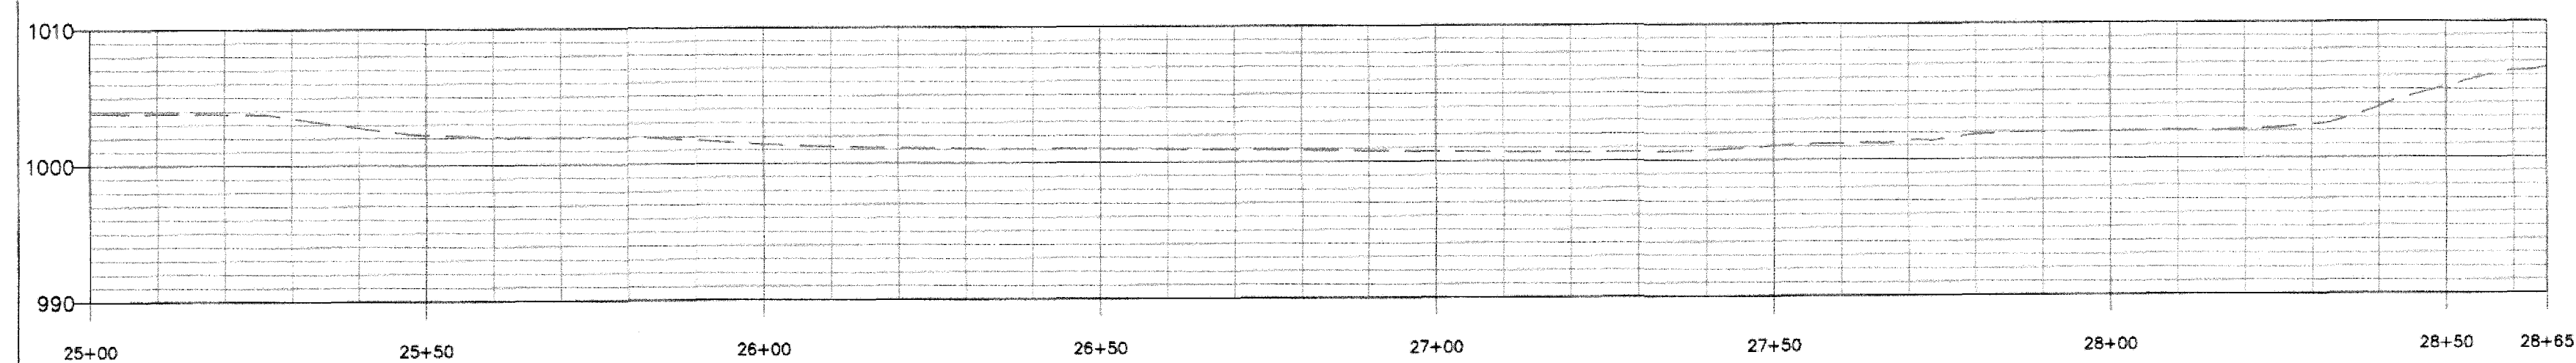

W E S T E R N V I R G I N I A
WATER AUTHORITY
ENGINEERING SERVICES
JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

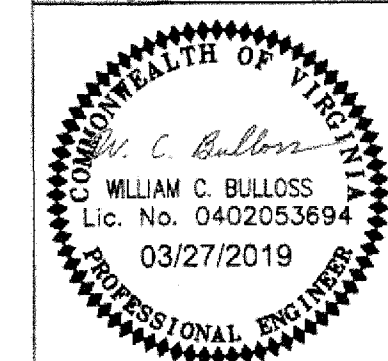

OAKLAND II WATERLINE REPLACEMENT

PROFILES

Rev	Description	Date	By
	Designed: DRJ		
	Drawn: DRJ		
	Checked: WCB		
	Approved: WCB		
	Date: MAR 2019		
	Project: WCIP-337		

6

Sheet 6 of 8