



- NOTES:
1. CONTRACTOR SHALL POTHOLE AND LOCATE ALL CROSSING UTILITIES ALONG NEW STORM PIPE ALIGNMENTS AND MAKE ADJUSTMENTS TO STORM SYSTEM AS NECESSARY WITH CITY OF ROANOKE ENGINEERING APPROVAL. PROVIDE MIN. SEPARATION OF 18" BETWEEN STORM SYSTEM AND WATER/SEWER UTILITIES.
  2. CONTRACTOR SHALL ENSURE THERE IS NO MORE THAN 100 FEET OF DISTURBED, UNSTABILIZED LAND UPSTREAM OF SILT FENCE PLACEMENTS.

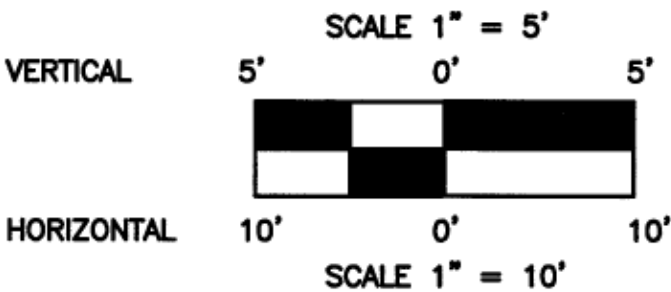

OFFICE OF THE  
CITY ENGINEER  
215 CHURCH AVENUE, S.W.  
ROOM 350  
PHONE: (540) 853-2731  
FAX: (540) 853-1364  
WWW.ROANOKEVA.GOV

DESIGNED: ARG  
DRAWN: ARG  
CHECKED: PMC

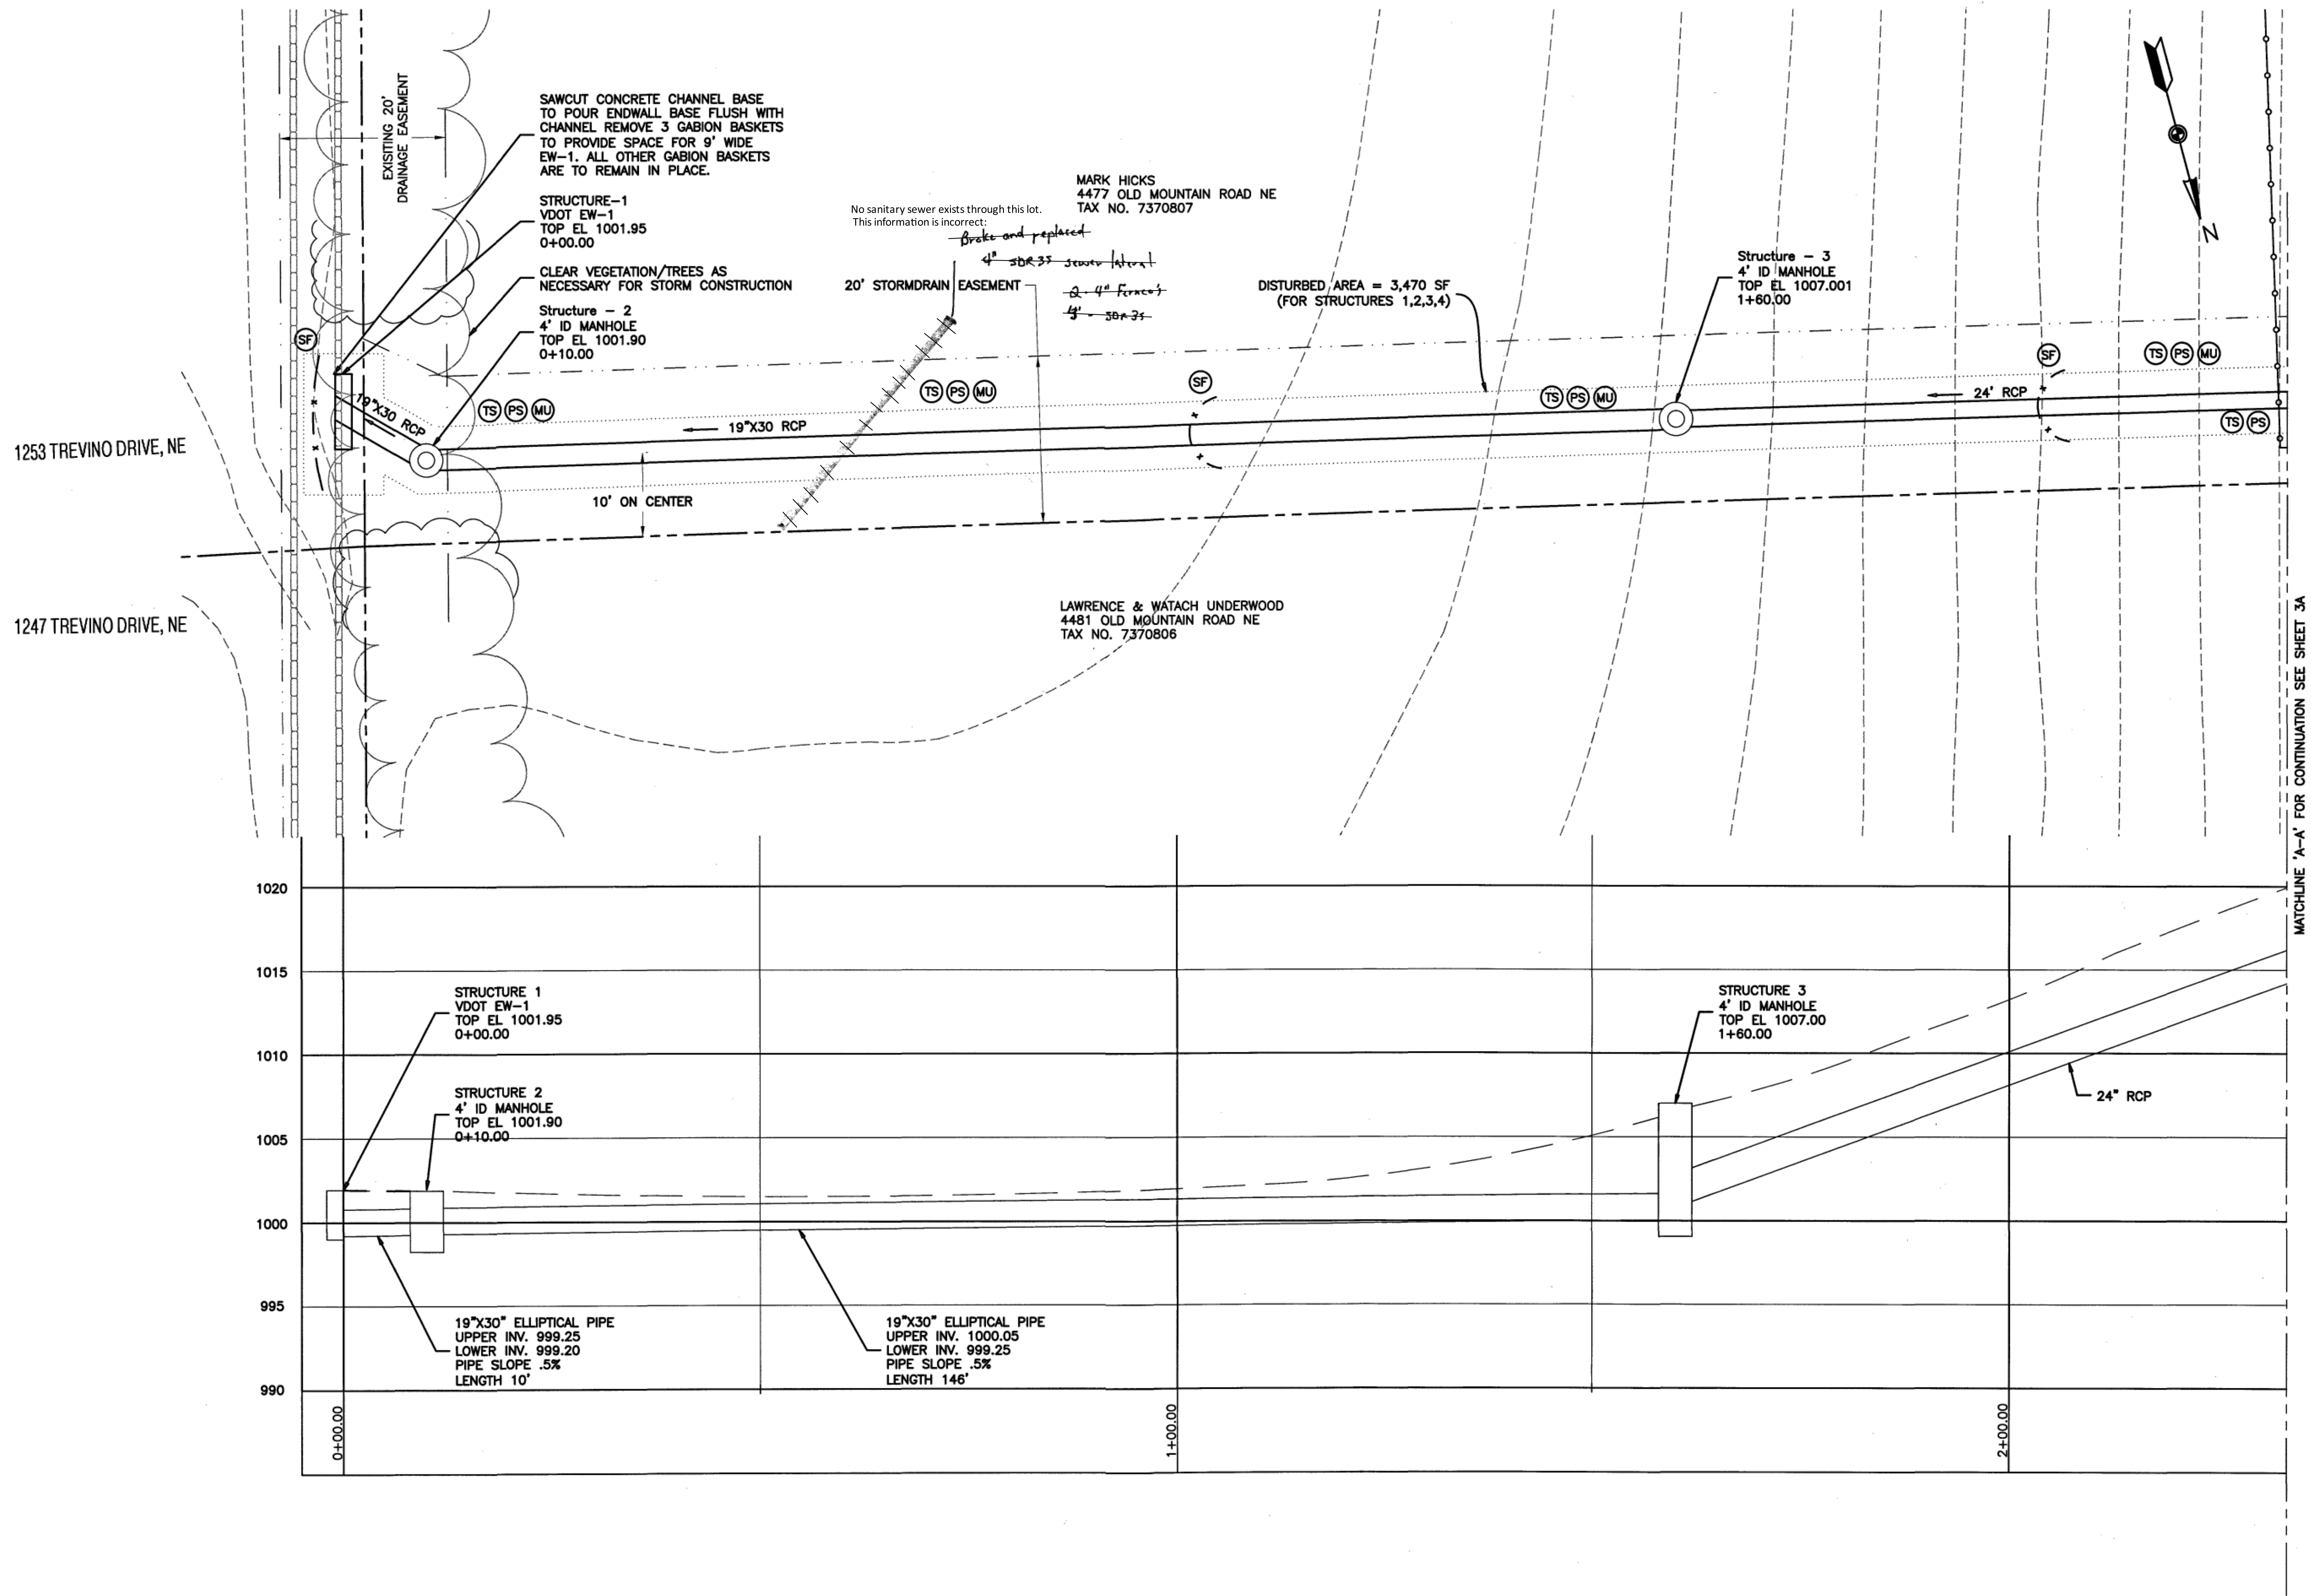

| REV. | DATE     | DESCRIPTION                 |
|------|----------|-----------------------------|
| 1    | 02/26/14 | PER CITY OF ROANOKE REQUEST |

DATE:  
08/21/2013  
SCALE:  
1"=10'-0"  
24"x36" SHEET

OHIO ST NE DRAINAGE IMPROVEMENTS  
PROJECT  
CITY OF ROANOKE, VIRGINIA

SHEET  
3 OF 8  
PLAN NO.  
3