

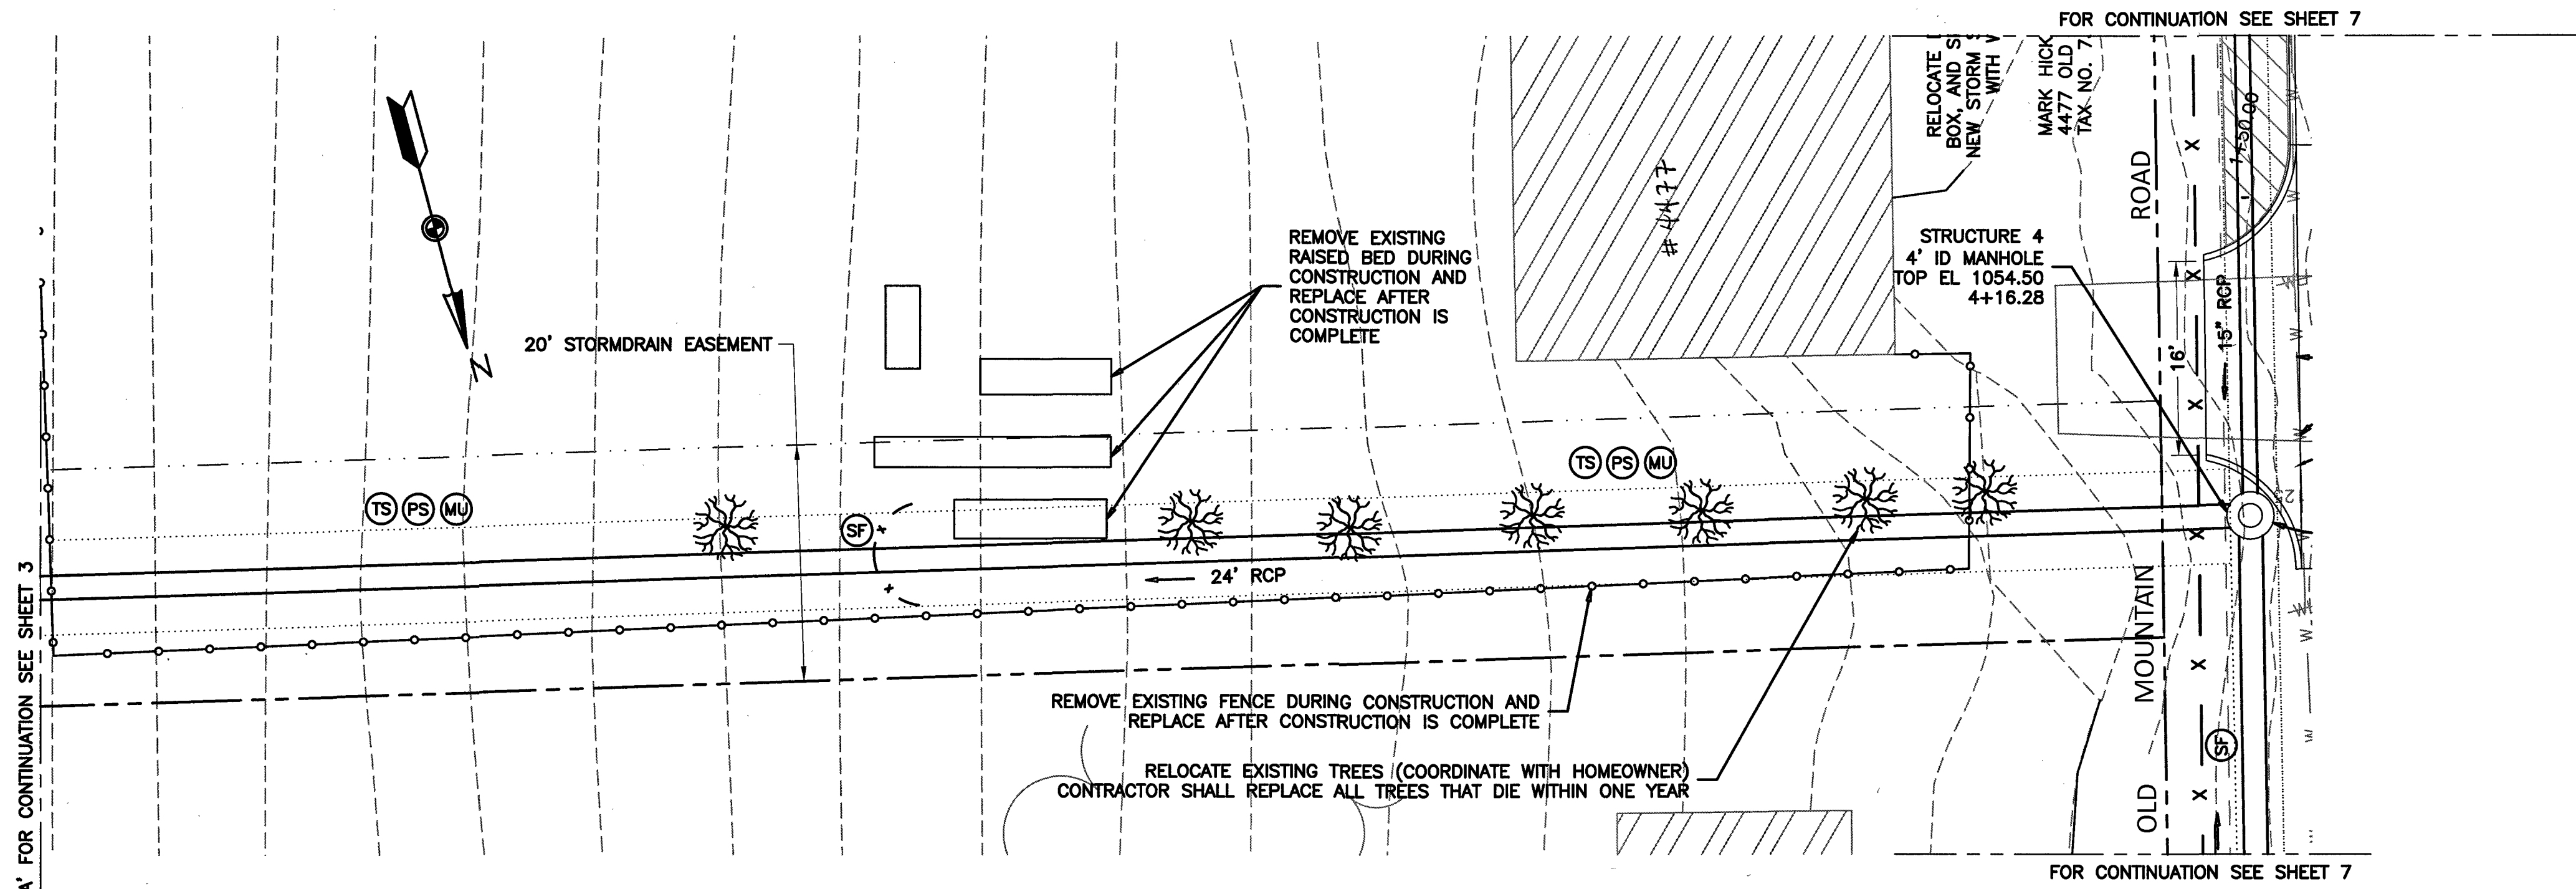


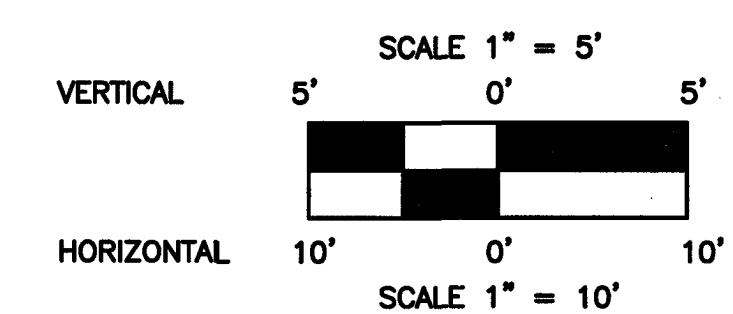

NOTES:

1. CONTRACTOR SHALL POTHOLE AND LOCATE ALL CROSSING UTILITIES ALONG NEW STORM PIPE ALIGNMENTS AND MAKE ADJUSTMENTS TO STORM SYSTEM AS NECESSARY WITH CITY OF ROANOKE ENGINEERING APPROVAL. PROVIDE MIN. SEPARATION OF 18" BETWEEN STORM SYSTEM AND WATER/SEWER UTILITIES.
2. CONTRACTOR SHALL ENSURE THERE IS NO MORE THAN 100 FEET OF DISTURBED, UNSTABILIZED LAND UPSTREAM OF SILT FENCE PLACEMENTS.

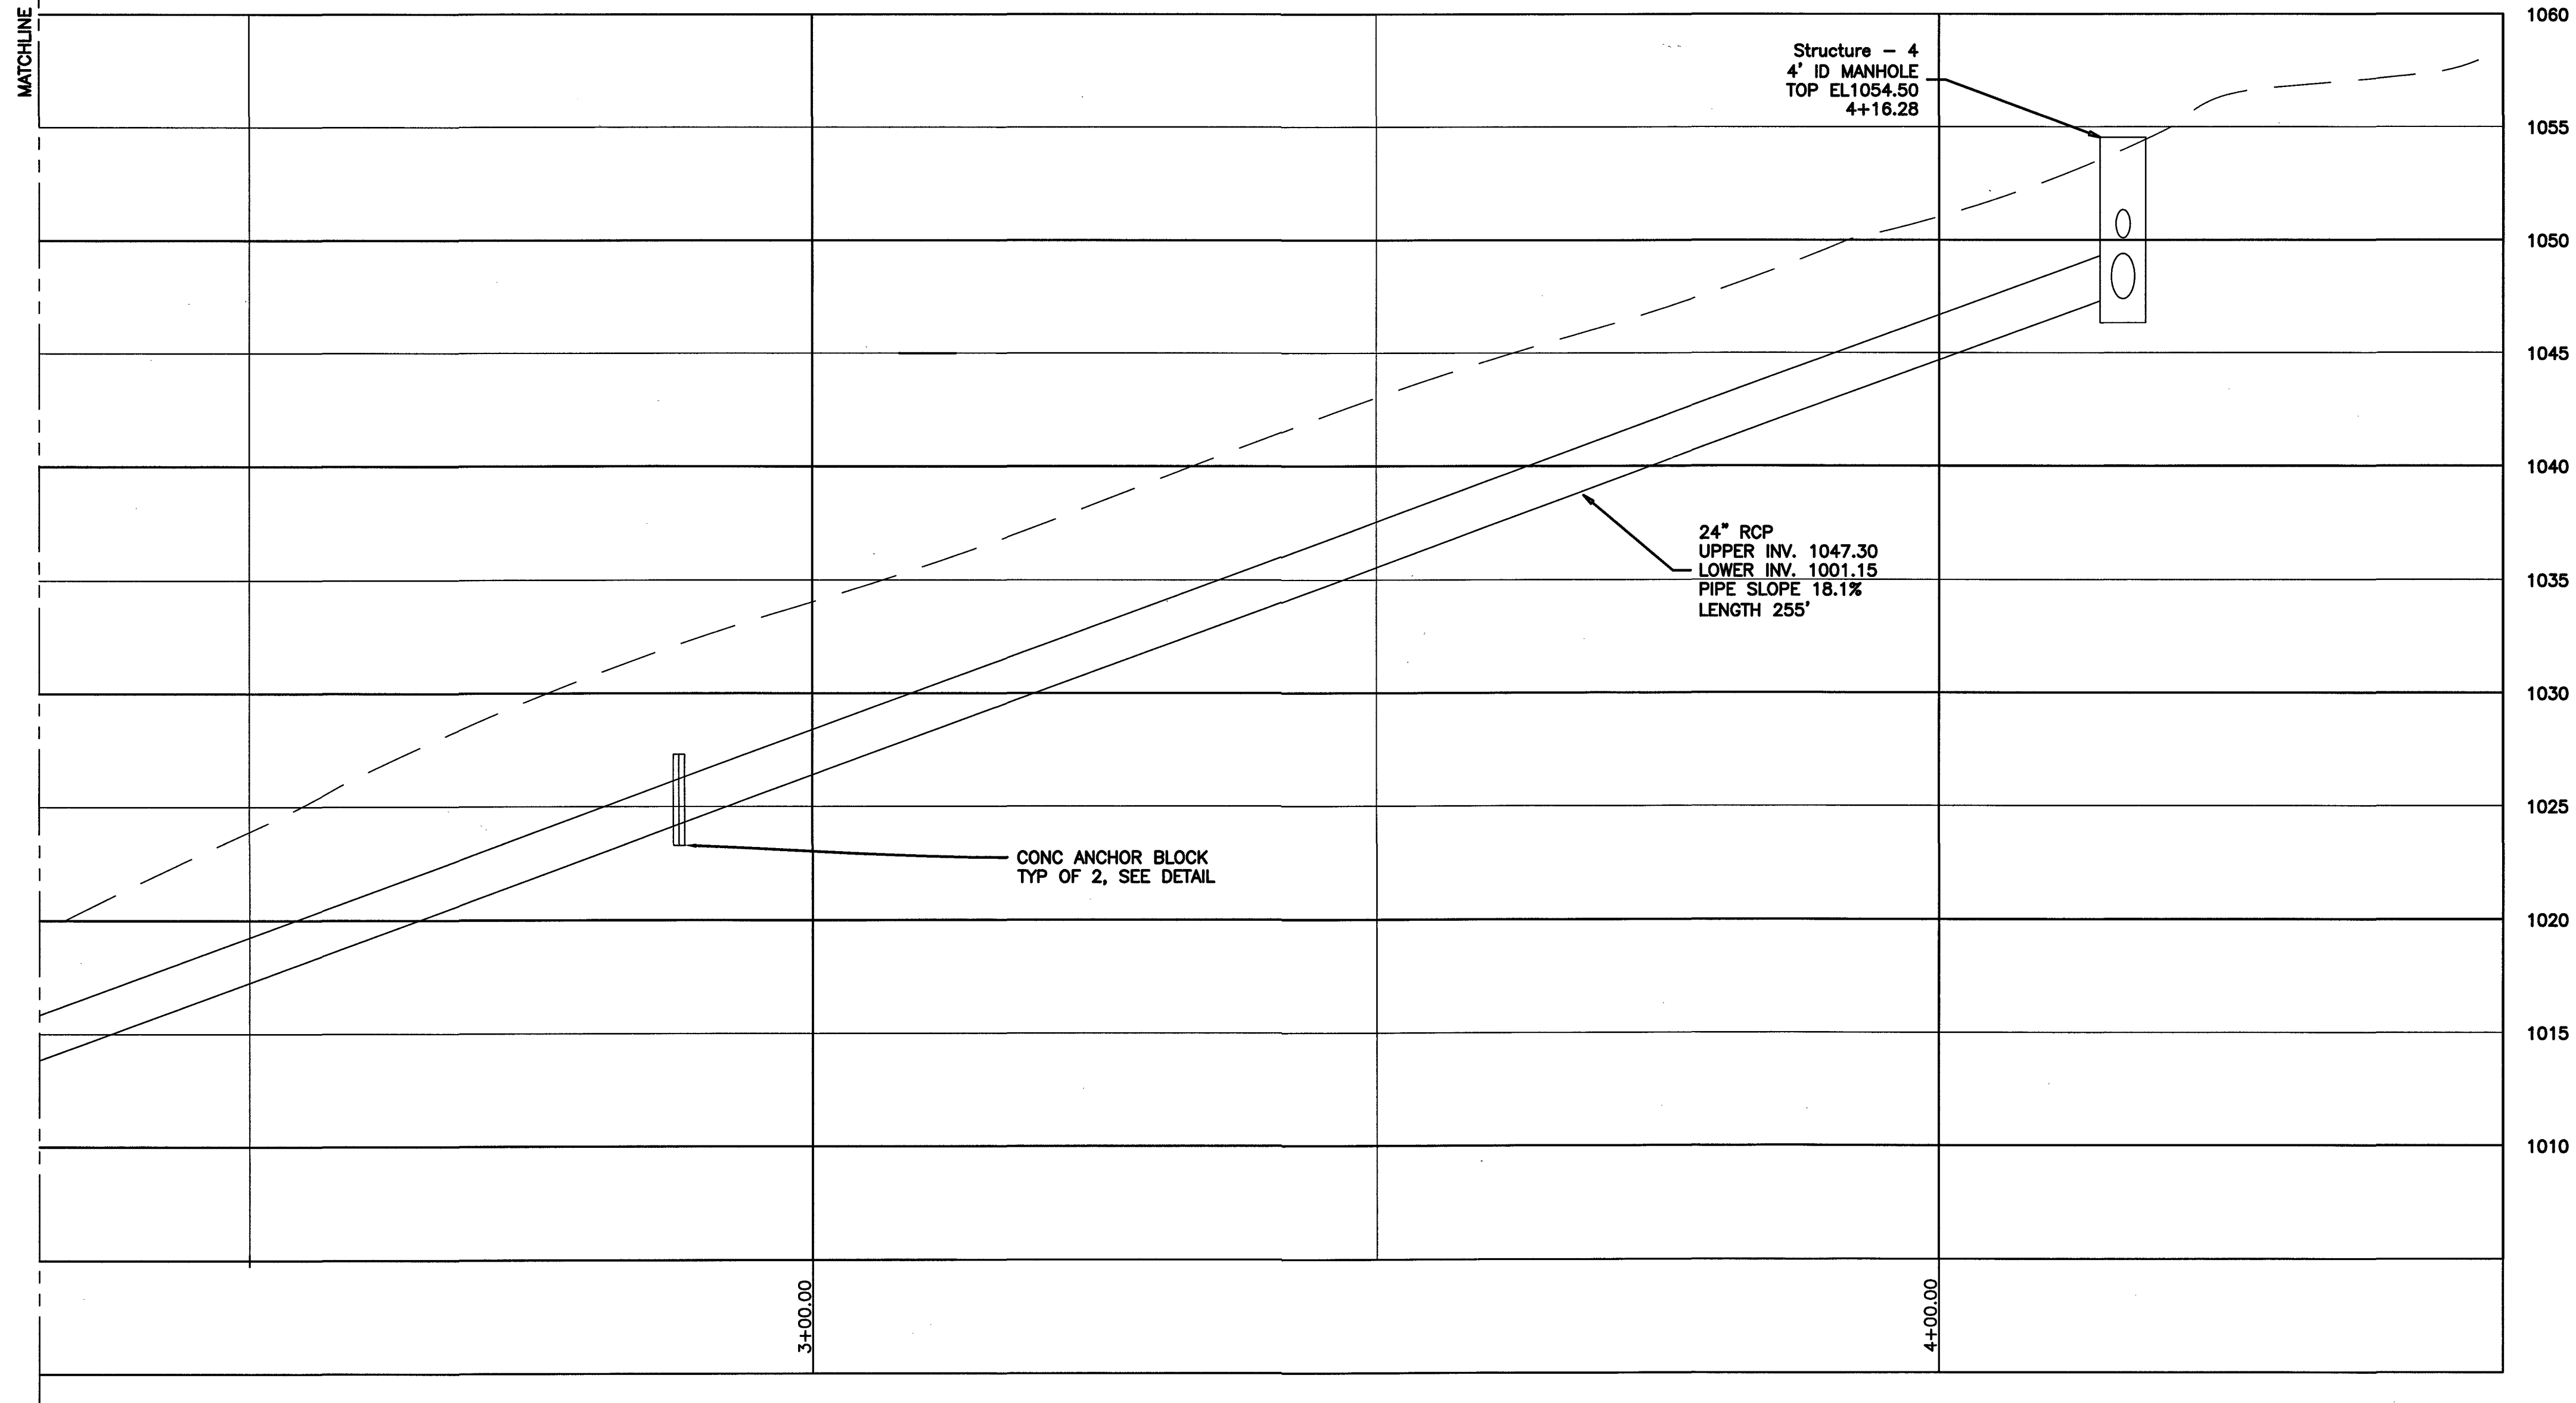


OFFICE OF THE
CITY ENGINEER

215 CHURCH AVENUE, S.W.
ROOM 350
PHONE: (540) 853-2731
FAX: (540) 853-1364
WWW.ROANOKEVA.GOV

DESIGNED: ARG

DRAWN: ARG

CHECKED: PMC

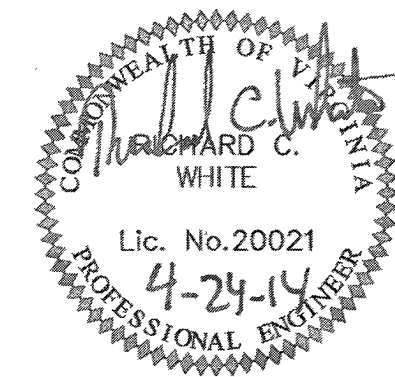

REV.	DATE	DESCRIPTION
1	02/26/14	PER CITY OF ROANOKE REQUEST

DATE:
08/21/2013

SCALE:
1"=10'-0"
24"x36" SHEET

OHIO ST NE DRAINAGE IMPROVEMENTS
PROJECT
CITY OF ROANOKE, VIRGINIA

SHEET

PLAN NO.
3A