


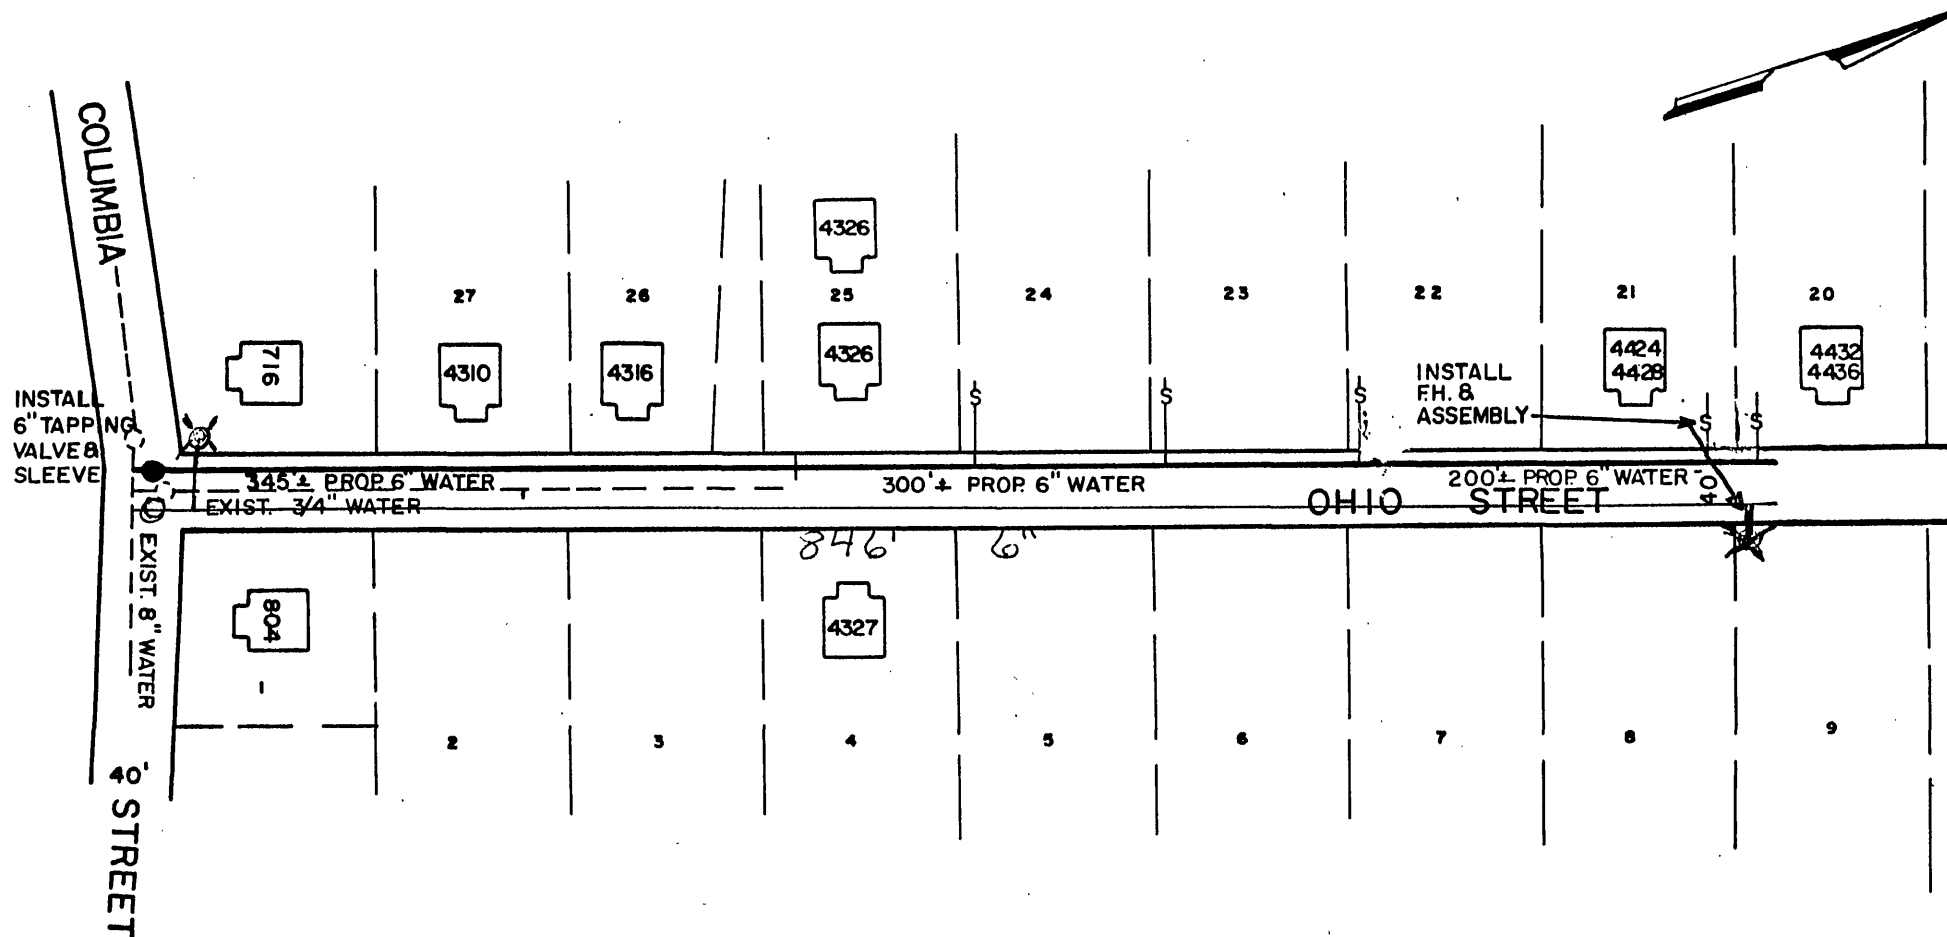

DATE STARTED 11-2-94				
DATE COMP. 11-7-94				
FEET MAIN	SIZE	VALVE	VAULT	BOX
846'	6"	1	1	
F.H. COMP. 2				
F.H. STUB ONLY 0				
SERV. INS. HY:				
MAIN INS. BY: C.O. Dame				
NO. 1/2" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP.				

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

WATER DEPARTMENT	
CANOE	VIRGINIA
OHIO STREET AT COLUMBIA STREET, N.E.	
SCALE 1" = 100'	DATE 9/14/94
DATE 9/7/94	BY William F. Clack
DATE 736	DATE 9/14/94
DATE 94-12	

[Signature]
MANAGER UTILITY LINE SERVICES