


1. THE CONTRACTOR SHALL REFER TO THE ROADWAY PLANS FOR ROADWAY AND DRAINAGE DESIGN.

1. CONTRACTOR SHALL INSTALL HYDRANT SO THAT CENTER OF PUMPER NOZZLE IS EVEN WITH OR ABOVE TOP OF PROP. GUARDRAIL.



- CONTRACTOR TO EXPOSE
& CLEAN PIPE IN
ACCORDANCE WITH
MANUFACTURERS
RECOMMENDATIONS



TAPPING SLEEVE AND VALVE

01/01/12

- TRAFFIC BEARING LOCATION



COMMERCIAL
WATER SERVICE
METER SIZES 5/8" - 2"

01/01/12





**SINGLE RESIDENTIAL
WATER SERVICE**
(REPLACEMENT OF EXISTING SERVICE)

01/01/23

- WESTERN VIRGINIA REGIONAL - CONSTRUCTION DETAIL

FIRE HYDRANT
ASSEMBLY

W-17

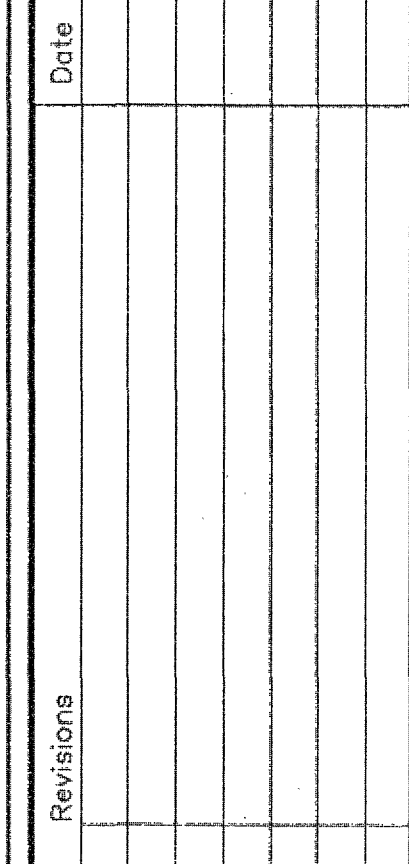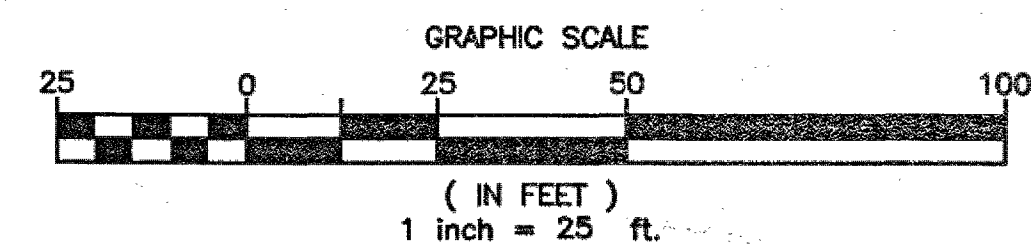

late:

Case D

Drawn By: RPK

Drawn By: RPK

Checked By: BCC
Date: 3/4/13

Checked By: BCC
Date: 3/4/13

Mattern & Craig
ATTORNEYS AT LAW

ROUTE 605 (OLD MOUNTAIN ROAD) BRIDGE REPLACEMENT

UTILITY RELOCATIONS

CITY OF ROANOKE, VIRGINIA.

Vertical Scale:
N/A

Horizontal Scale:
1" = 25'

Commission Number:
3154A

Sheet No.:

C-13