
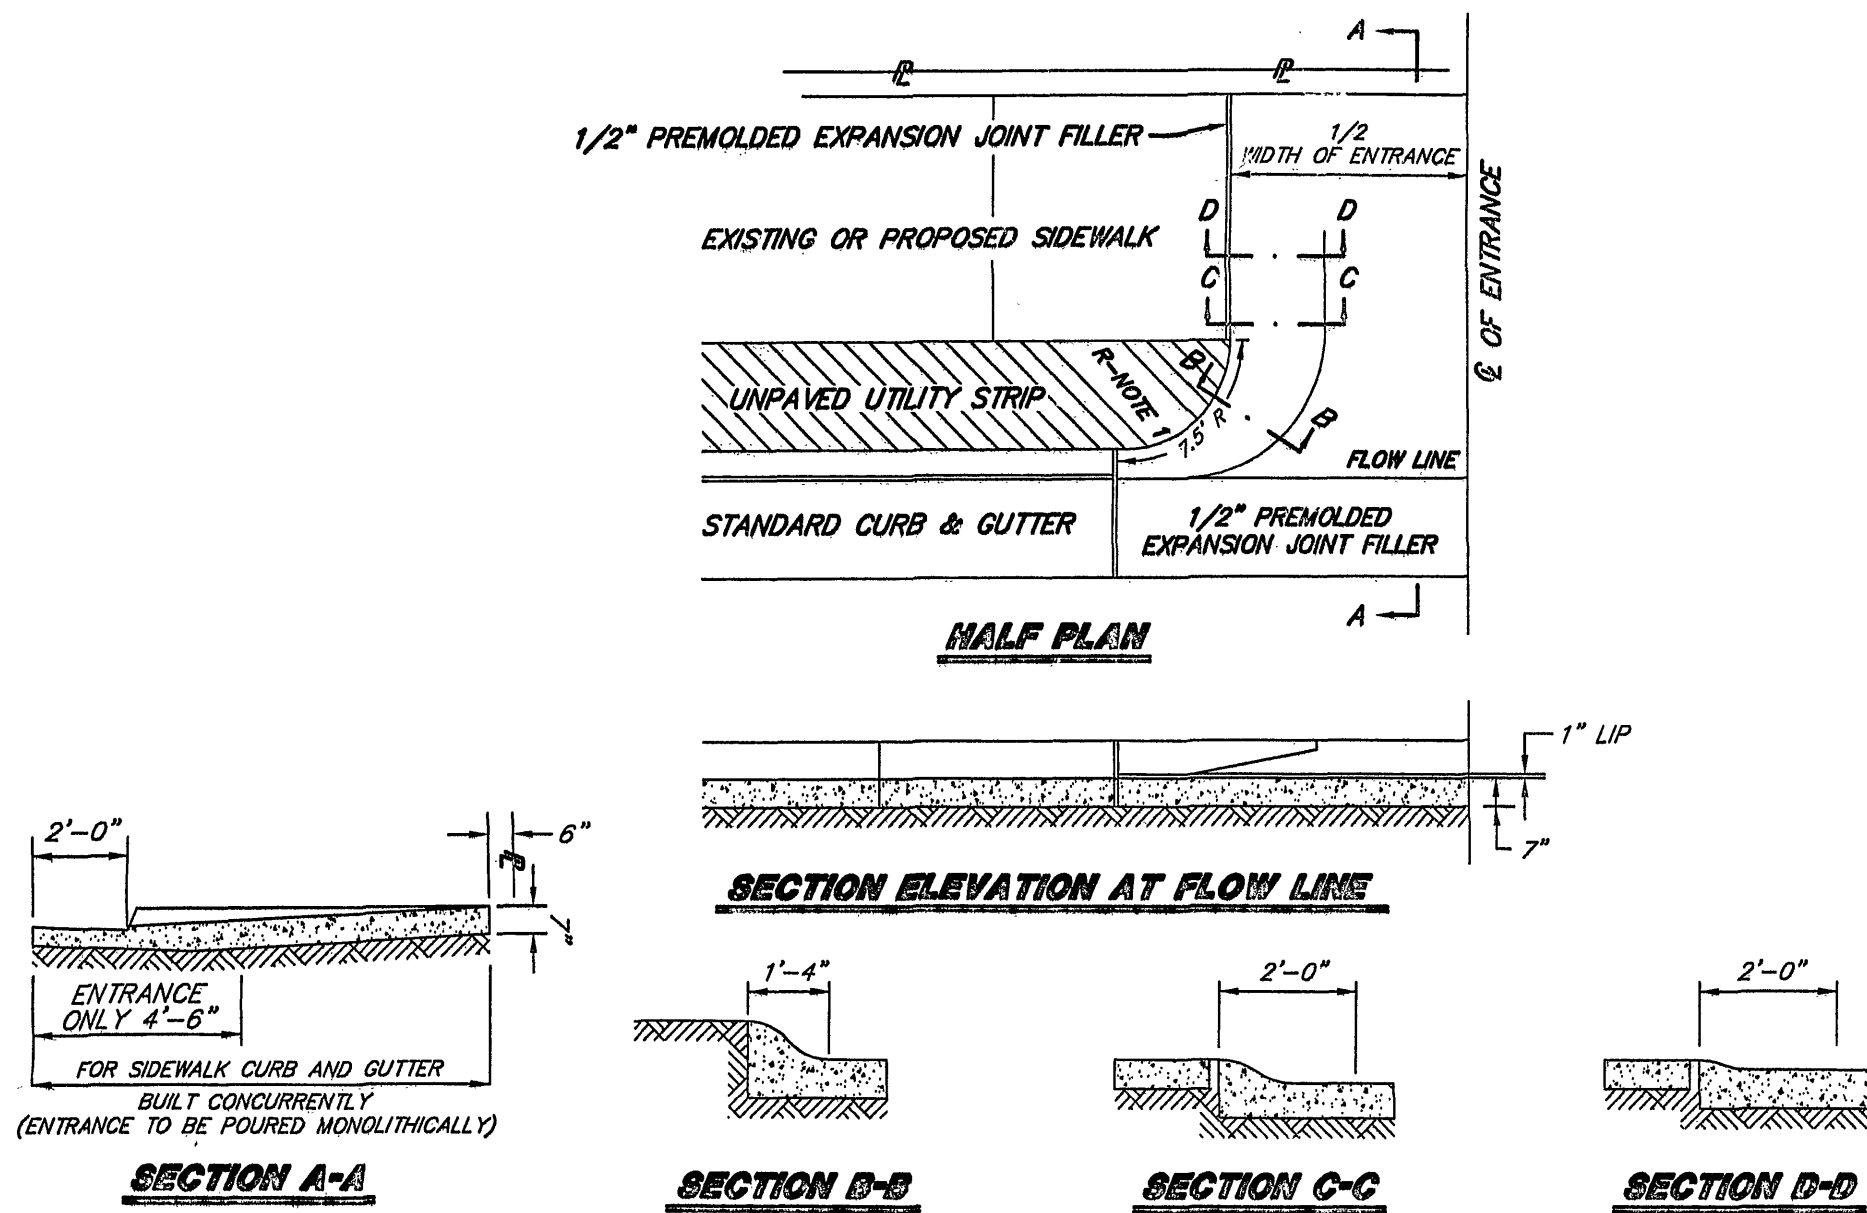


w:\drawings\2008\0819\eng\0819comp.dwg 0819comp-03-n003.plt

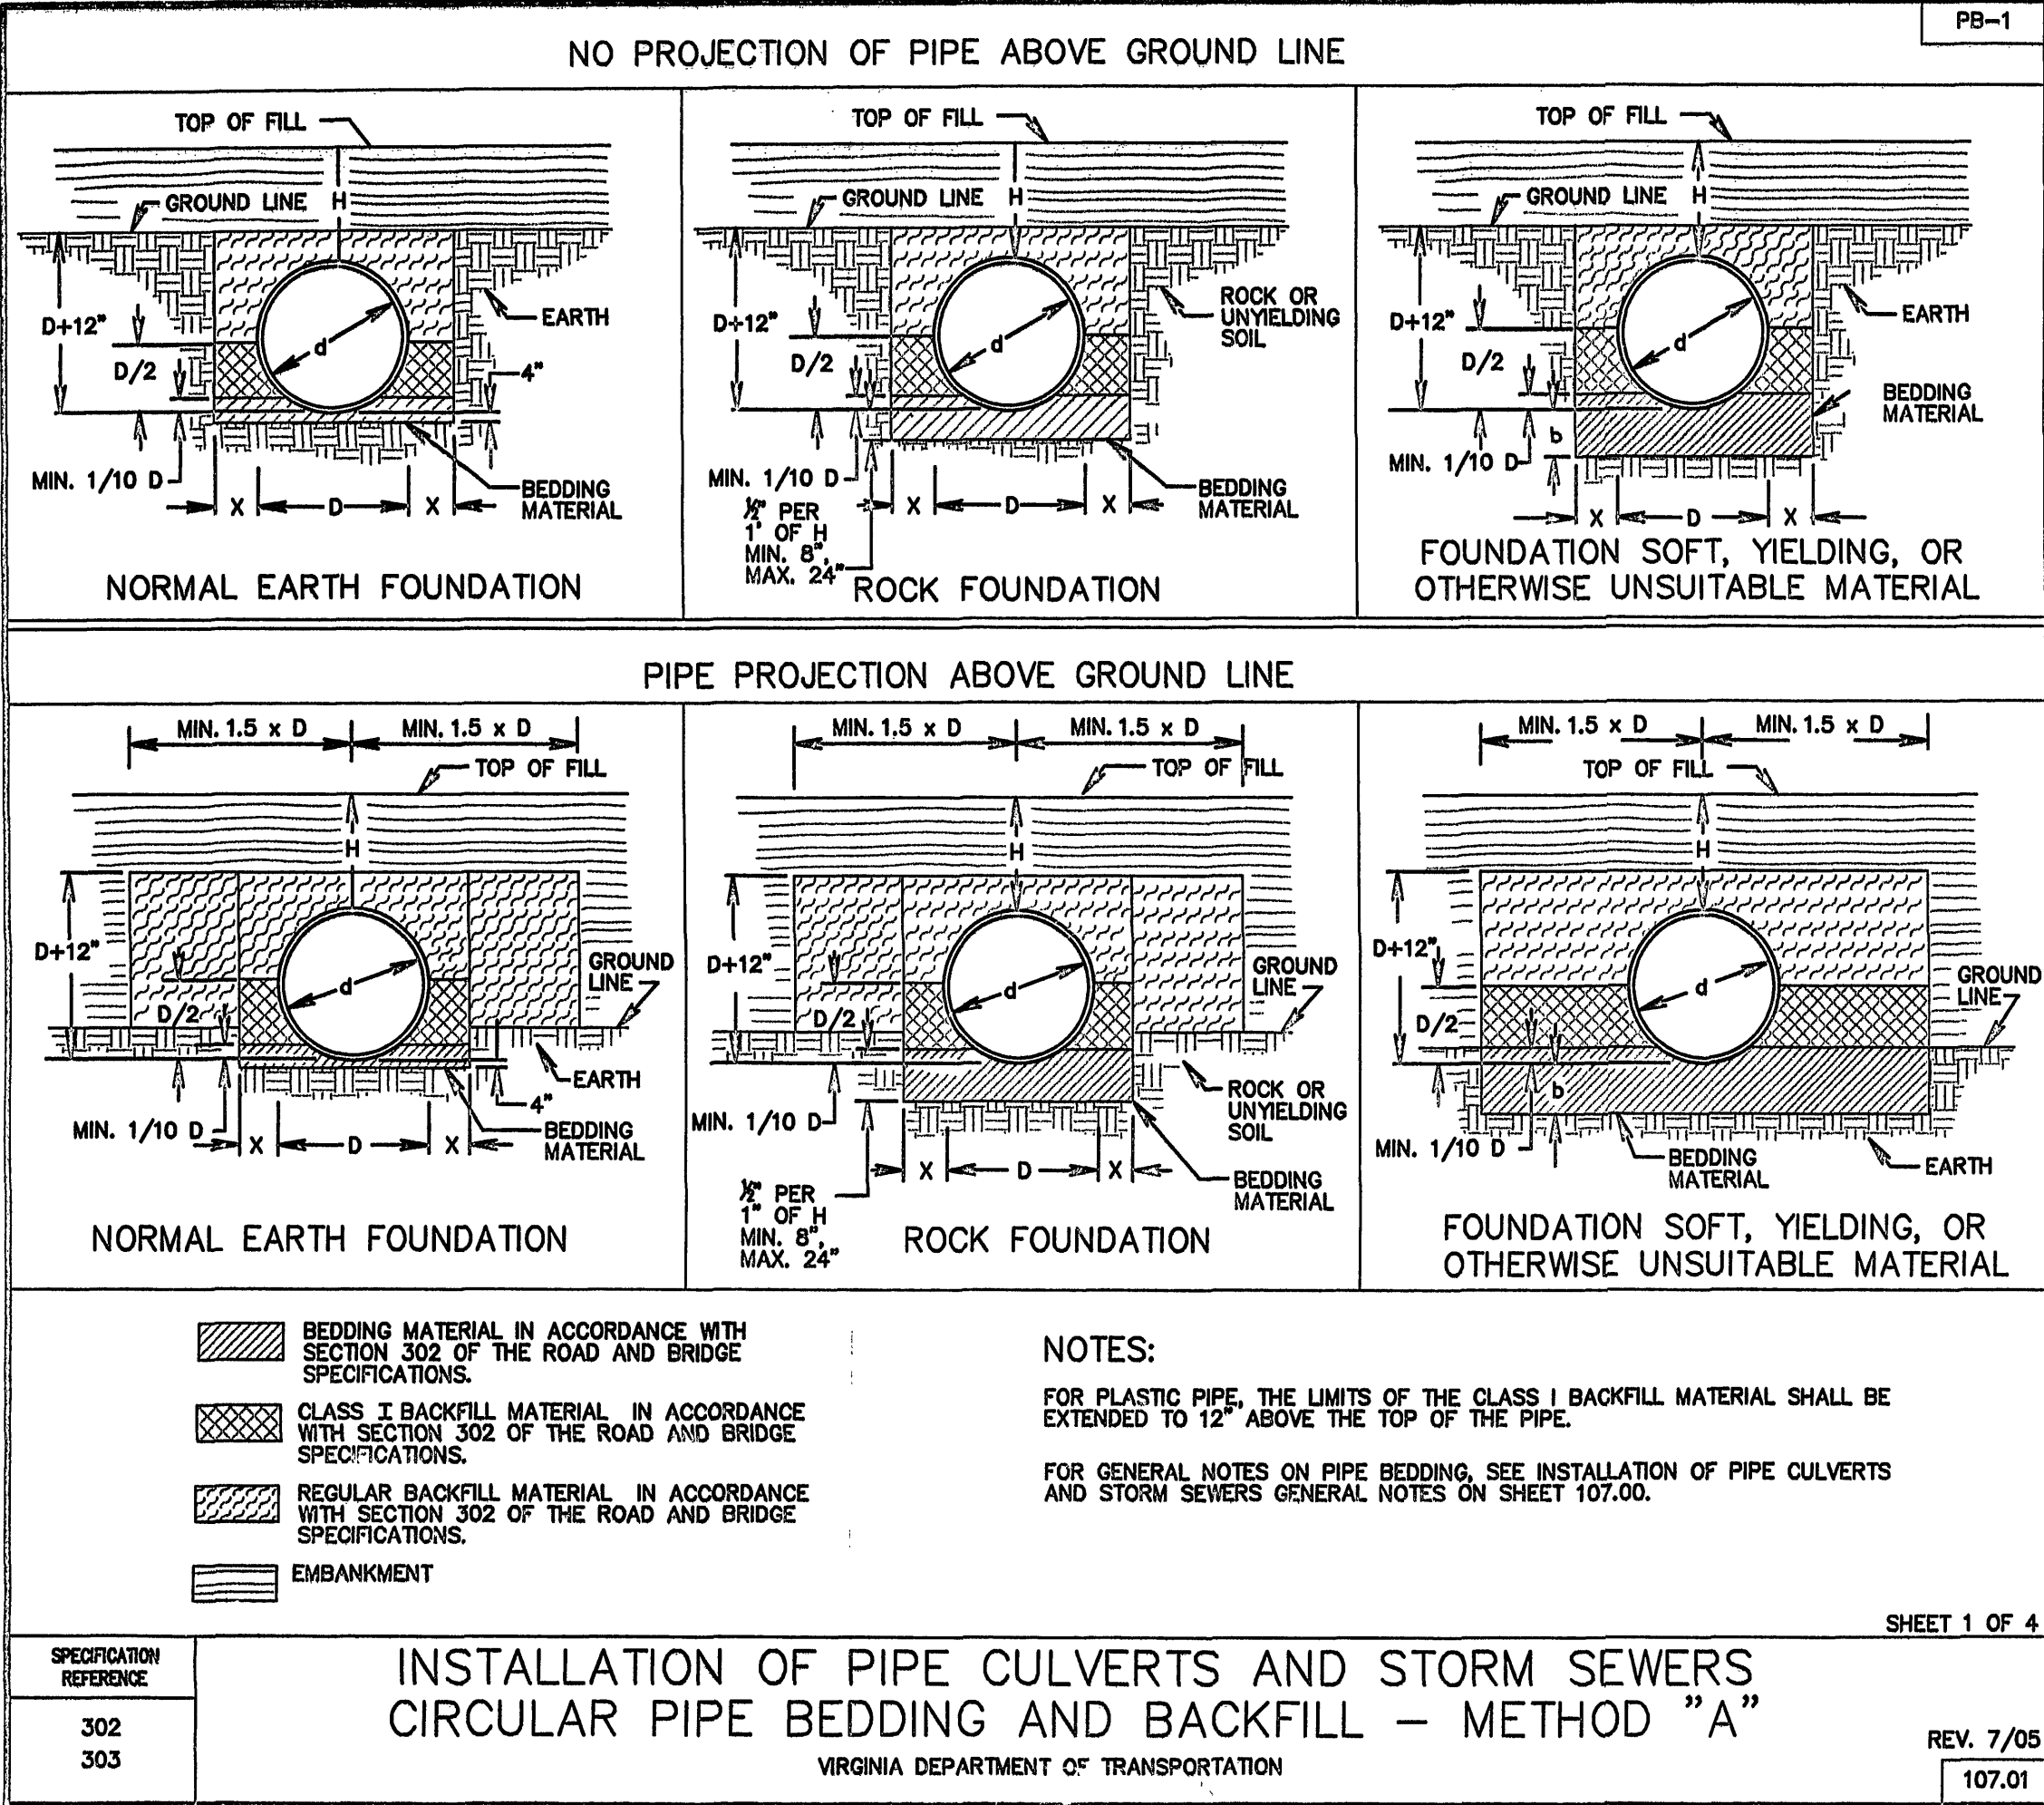

GENERAL NOTES:

- Standard commercial "Entrance" shall have a minimum curb radius (R) of 7 1/2 feet.
- 1A. Minimum Entrance width to be 12 feet.
- Where curb & gutter already exists both curb & gutter shall be removed. If proposed entrance falls within five (5) feet of an existing joint removal & reconstruction shall be to that joint. Any concrete removed at other than an existing joint shall be cut with a mechanical saw specifically manufactured for that purpose; this also shall apply to street pavement.
- Where sidewalk exists or is to be constructed across driveways the thickness thereof must correspond with the thickness of the entrance.
- Whenever "Entrances" exceeds twenty-four (24) feet in width a 1/2" premolded expansion joint filler shall be installed through the center perpendicular to flow line.
- Finish "Entrances" shall have a "course broom finish" running parallel to flow line.
- Curing shall be accomplished by the use of a liquid membrane seal containing white pigment applied at the rate of one (1) gallon per 150 square feet.
- All "Entrance Ways" shall be constructed according to City of Roanoke specifications and to line and grades established by the City Engineering Department.
- Entrances exceeding 30 feet in width shall be approved by the City Manager.

CITY OF ROANOKE COMMERCIAL
"ENTRANCE" STANDARD



LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

DOUGLAS E. BURTON
Lic. No. 035740
12-18-09
PROFESSIONAL ENGINEER

NOTES AND
DETAILS

INTERSECTION REALIGNMENT AT
OLD ROCKY MOUNT ROAD
AND
WELCOME VALLEY ROAD
PREPARED FOR
ROCKYDALE QUARRIES CORP.
SITUATED IN NEIGHBORHOOD NUMBERS 310 & 381
THE CITY OF ROANOKE, VIRGINIA

REVISIONS

NO.	DATE	DESCRIPTION
1		
2		
3		
4		
5		

DATE: December 18, 2009

SCALE: AS SHOWN

COMMISSION NO: 08-191

SHEET 3 OF 15