


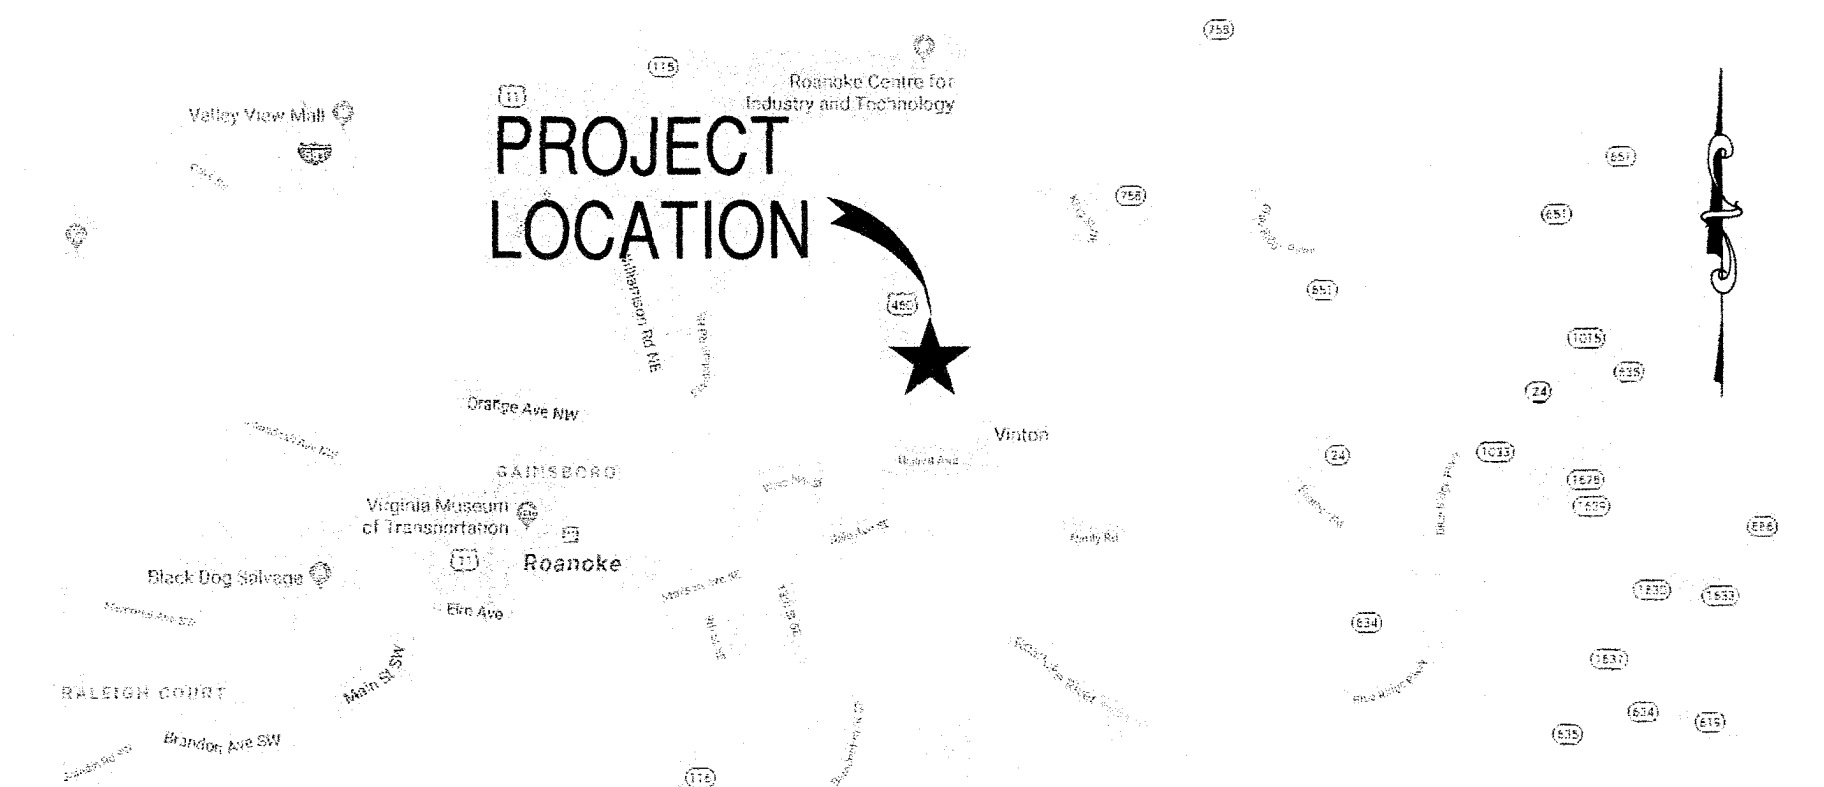


Bruce Peters
1-22-2020

Materials

Valves American Flow Control
6" valves - direction to open c.c.w / Gate
turns to close 20
12" valves - direction to open c.c.w / Gate
turns to close 38

Pipe			
12"	Ductile class	350	U.S. Pipe
16"	Ductile class	350	U.S. Pipe
8"	Ductile class	350	U.S. Pipe
Vault	C.S.I		

- Frame Covers - Capitol Foundry
- Hydrants - American Darling
- Fittings - Ductile Sigma
- Water services - HDPE
- Ford Silfers

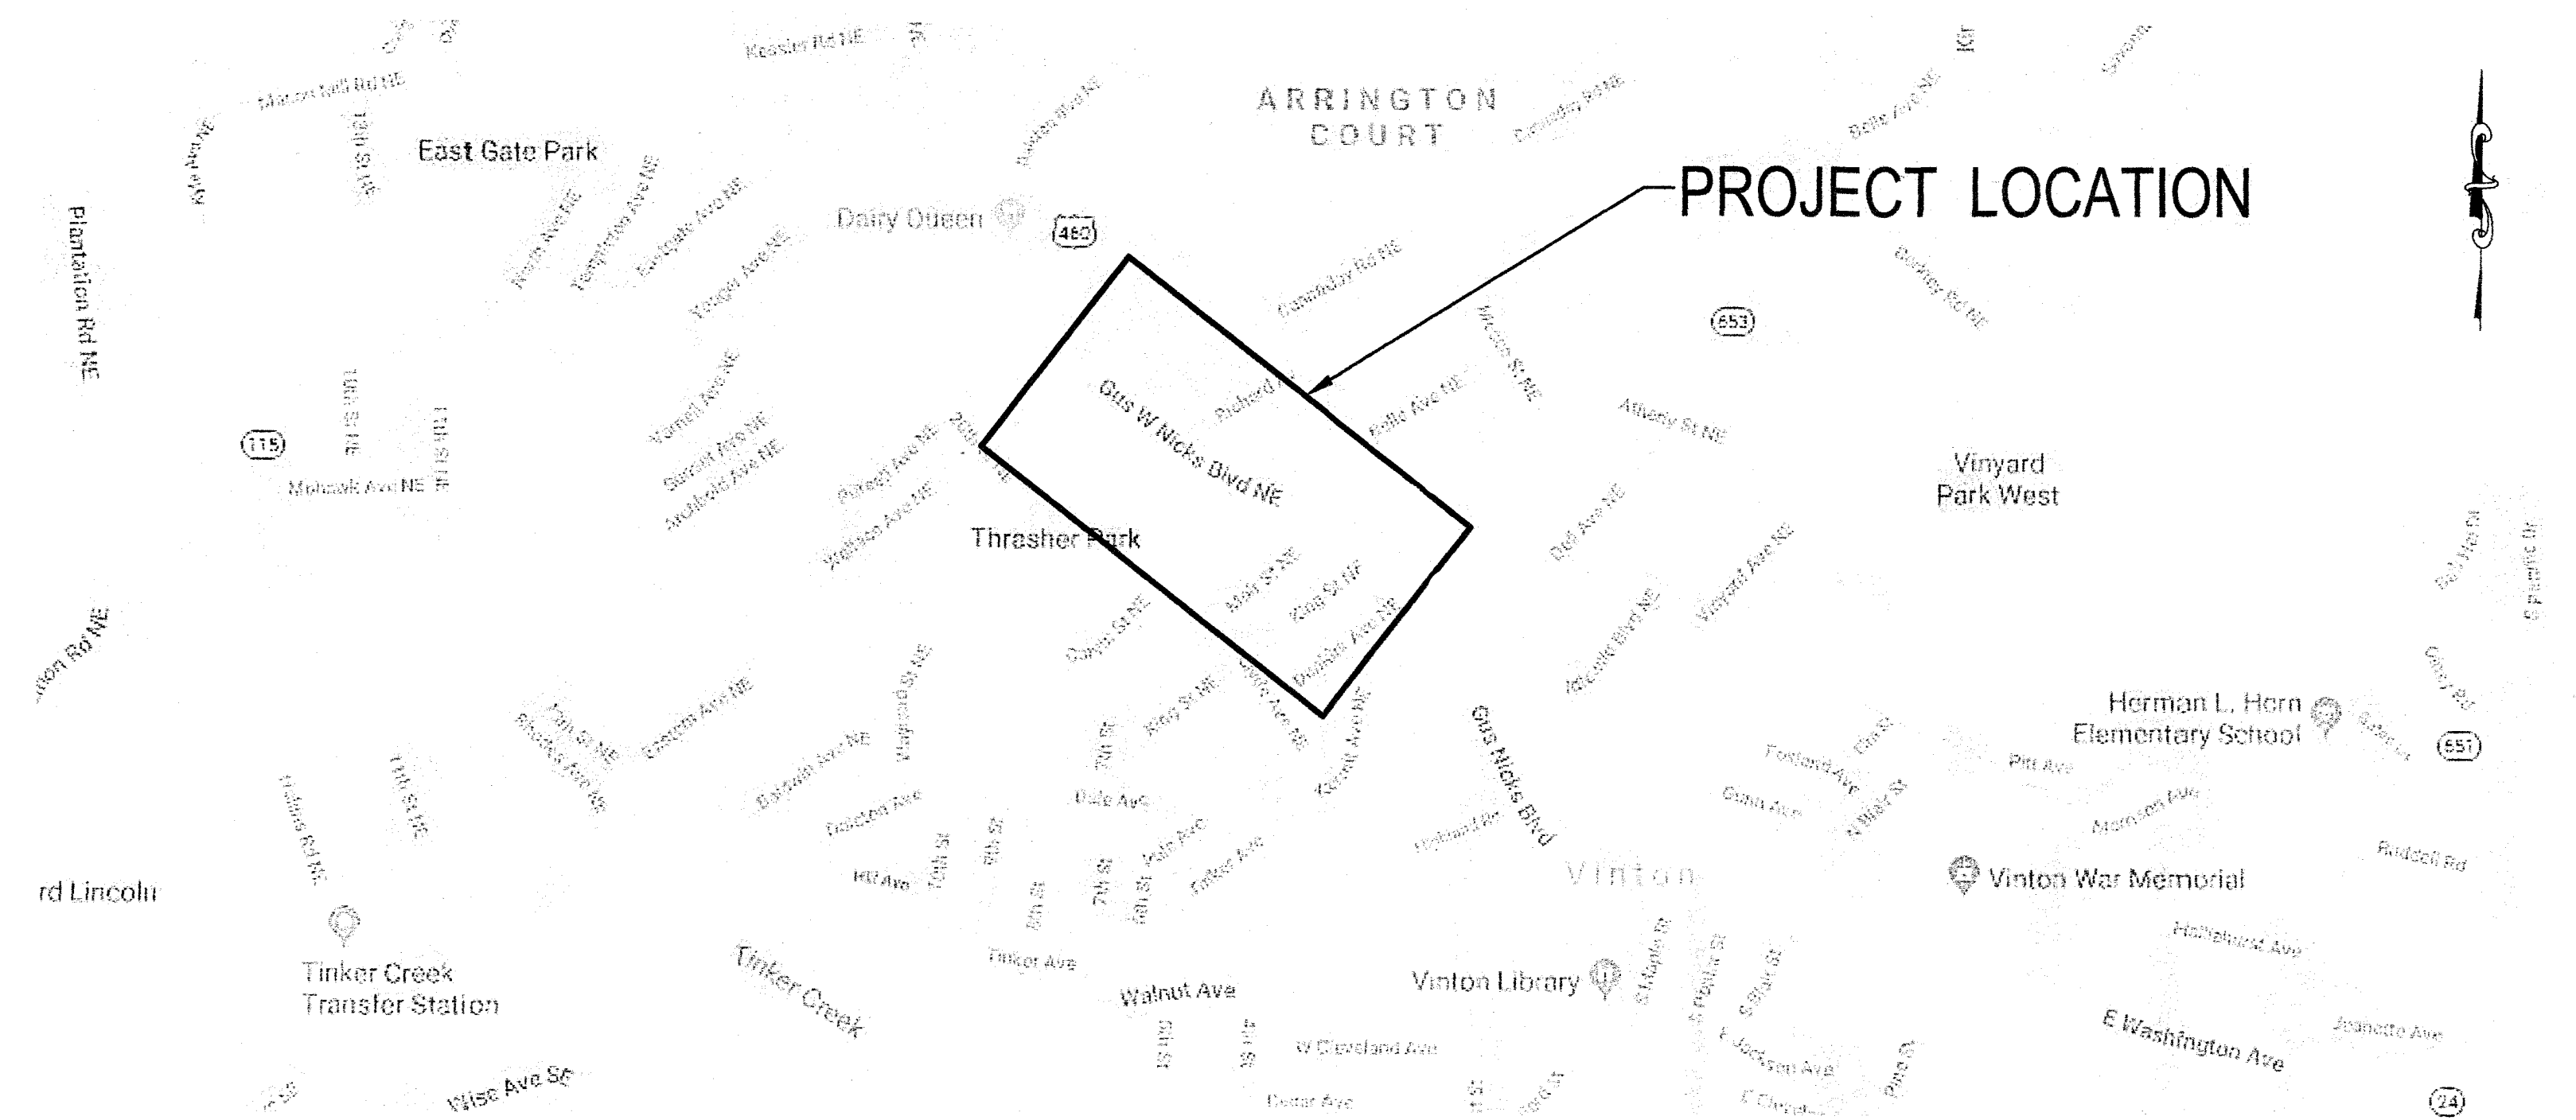

MAY 2019

COMMONWEALTH OF VIRGINIA
Paula J. Moore
PAULA J. MOORE
 Lic. No. **035621**
5/22/19
 PROFESSIONAL ENGINEER



Whitman, Requardt & Associates, LLP
1700 Kraft Dr, Suite 1200, Blacksburg, VA 24060

WESTERN VIRGINIA WATER AUTHORITY
601 South Jefferson Street, Suite 300
Roanoke, Virginia 24011

DES:	PJM
DRAWN:	JES
CHECK:	GWF
DATE:	5/22/19

SCALE:	N/A
HORIZ:	N/A
VERT:	N/A

OLD VINTON MILL ROAD
WATER MAIN REPLACEMENT

APPROVED FOR CONSTRUCTION

REV	DATE	DESCRIPTION
	DRAWING	SHEET
	—	1