


Water Pressure Test at 200psi Distances for ARV
4/30/07 passed From Sewer Manhole #7 - 40'
Type "B" water services From Fire Hydrant - 152' 6"

LEGEND


- C.O. CLEANOUT
 SM SAMPLING MANHOLE
 FH FIRE HYDRANT ASSEMBLY
 WM WATER METER
 SSM SANITARY SEWER MANHOLE
 WGV WATERLINE GATE VALVE
 TBOV TEMPORARY BLOW-OFF VALVE
 8" W (NEW 8" WATERLINE)
 8" SAN. SWR NEW 8" SANITARY SEWER
 UT UNDERGROUND TELEPHONE

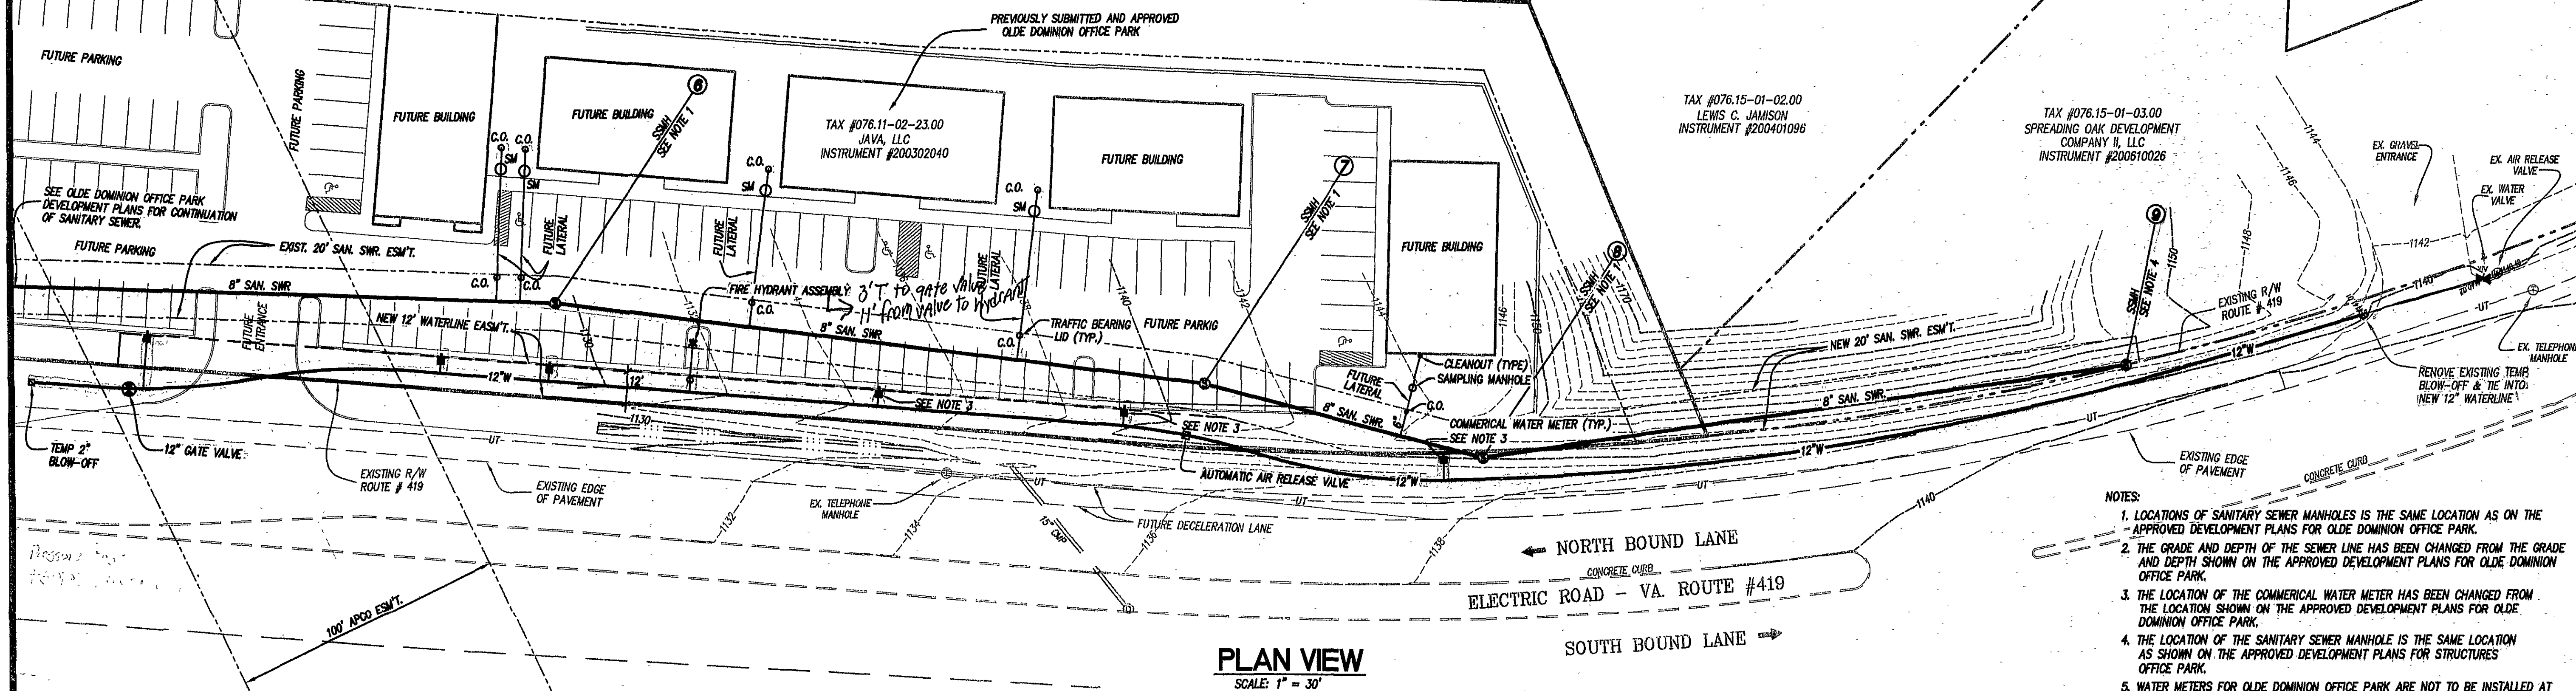

- NOTES:
1. LOCATIONS OF SANITARY SEWER MANHOLES IS THE SAME LOCATION AS ON THE APPROVED DEVELOPMENT PLANS FOR OLDE DOMINION OFFICE PARK.
 2. THE GRADE AND DEPTH OF THE SEWER LINE HAS BEEN CHANGED FROM THE GRADE AND DEPTH SHOWN ON THE APPROVED DEVELOPMENT PLANS FOR OLDE DOMINION OFFICE PARK.
 3. THE LOCATION OF THE COMMERCIAL WATER METER HAS BEEN CHANGED FROM THE LOCATION SHOWN ON THE APPROVED DEVELOPMENT PLANS FOR OLDE DOMINION OFFICE PARK.
 4. THE LOCATION OF THE SANITARY SEWER MANHOLE IS THE SAME LOCATION AS SHOWN ON THE APPROVED DEVELOPMENT PLANS FOR STRUCTURES OFFICE PARK.
 5. WATER METERS FOR OLDE DOMINION OFFICE PARK ARE NOT TO BE INSTALLED AT THIS TIME. STUB SHALL BE MADE UP TO METER.
 6. SANITARY SEWER LATERALS TO BE CONSTRUCTED TO CLEAN OUT ONLY. PROVIDE 13' L.F. STUB.

SANITARY SEWER PROFILE

SCALE: HORIZ. 1" = 30'
VERT. 1" = 10'

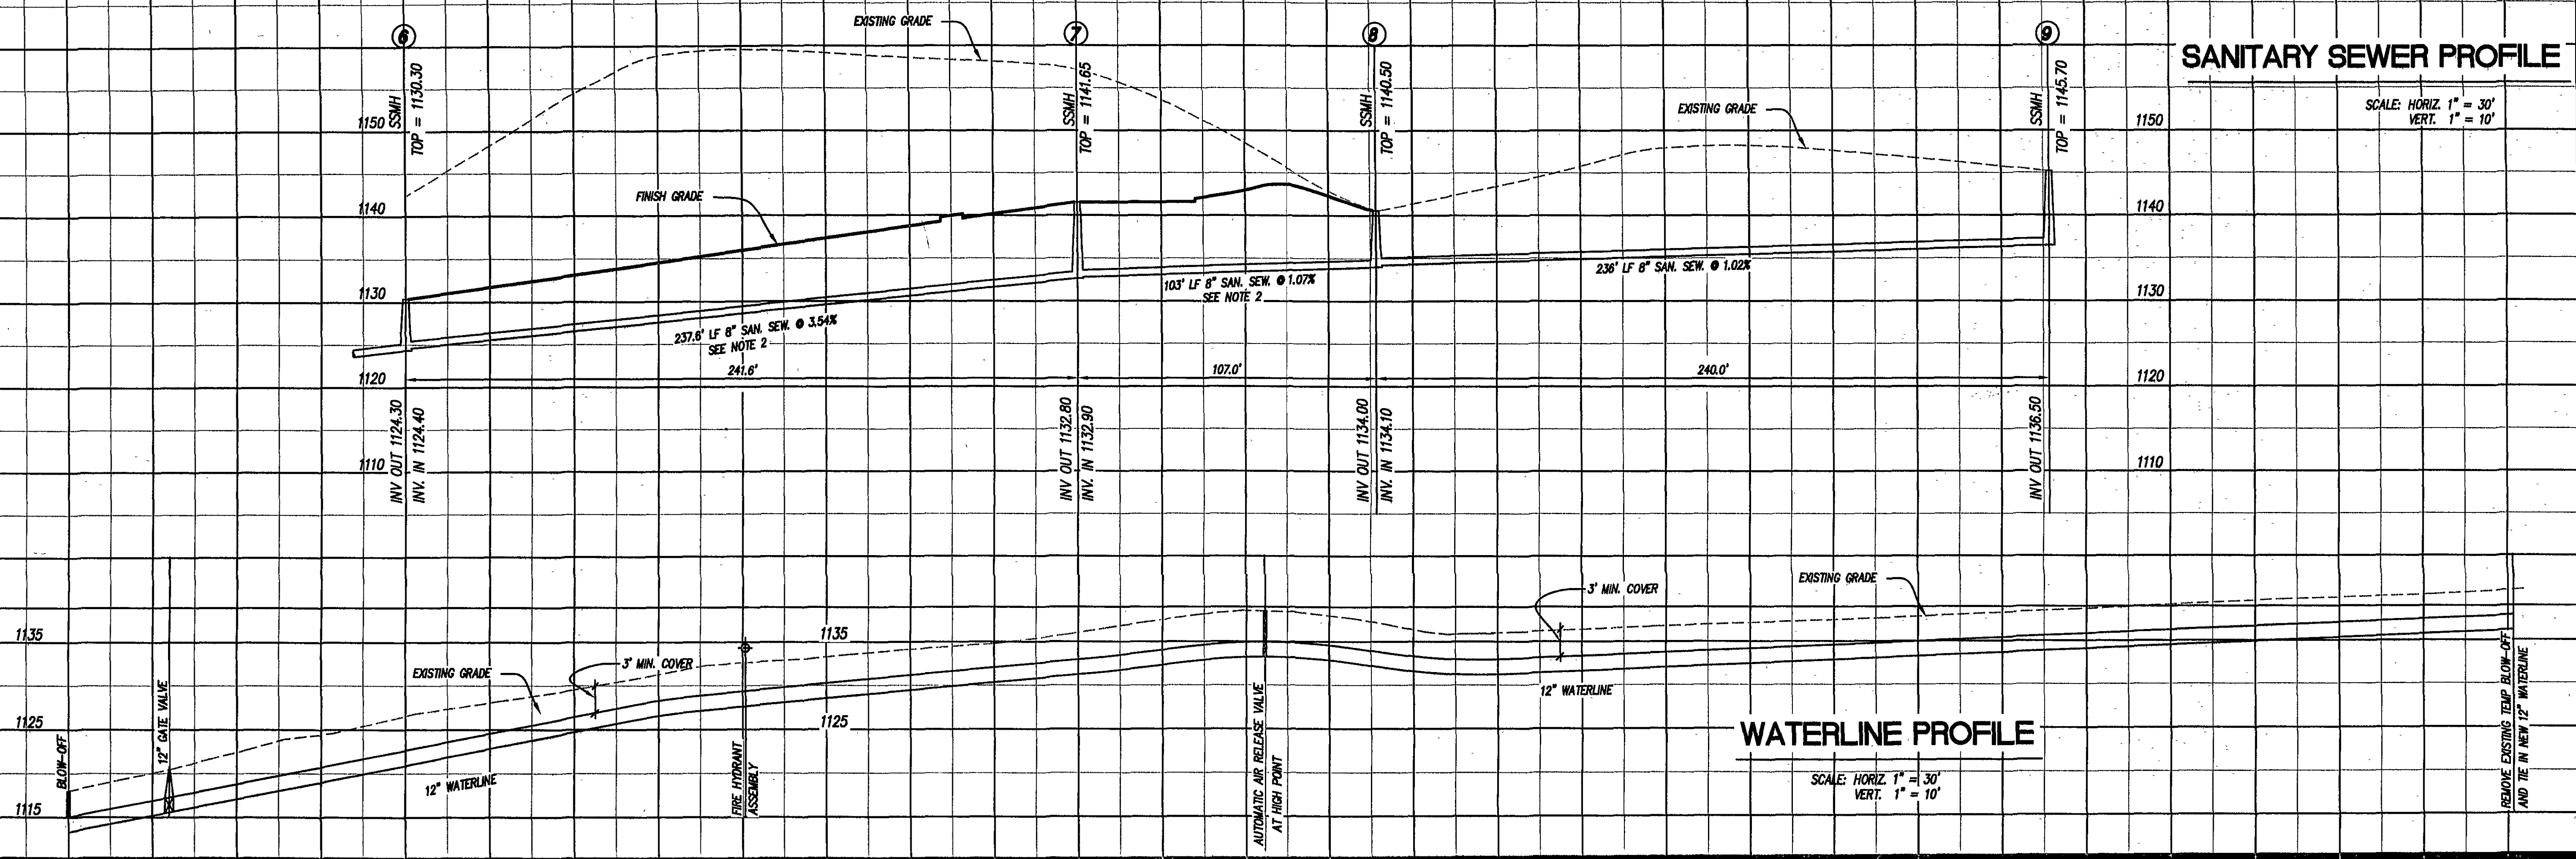

WATERLINE PROFILE

SCALE: HORIZ. 1" = 30'
VERT. 1" = 10'

LUMSDEN ASSOCIATES, P.C.
 ENGINEERS-SURVEYORS-PLANNERS
 ROANOKE, VIRGINIA
 PHONE: (800) 774-4411
 FAX: (540) 343-1415
 EMAIL: MAIL@LUMSDENPC.COM

12-11-06
 B. LEE
 HENDERSON JR.
 No. 17591
 PROFESSIONAL ENGINEER

PLAN & PROFILES
 SANITARY SEWER & WATERLINE MODIFICATION
 BETWEEN
 OLDE DOMINION OFFICE PARK
 AND
 STRUCTURES OFFICE PARK
 WINDSOR HILLS MAGISTERIAL DISTRICT
 COUNTY OF ROANOKE, VIRGINIA

NO.	DATE	DESCRIPTION
1		
2		
3		
4		
5		

DATE: December 11, 2006
 SCALE: AS SHOWN
 COMMISSION NO: 06-283
 SHEET 3 OF 6