


PLAN NOTES - PHASE A1 DEMOLITION: ○


- EXISTING UNDERGROUND PRIMARY ELECTRICAL FROM POLE SHALL REMAIN. PROTECT DURING CONSTRUCTION.
- EXISTING UNDERGROUND TELEPHONE SERVICE SHALL REMAIN.
- EXISTING FEED FROM PANEL-MP IN PARSONS TO GYMNASIUM SHALL REMAIN. FEEDERS ARE UNDER BOTTOM OF PIPE TRENCH.
- EXISTING FEEDER FROM PANEL-MP IN PARSONS TO PANEL-10PC IN PERSINGER (2 SETS 4800MCM) TO BE DISCONNECTED. REMOVE CONDUCTORS. REMOVE CONDUIT WHERE NOT IN OR UNDER PARSONS. ABANDON WHERE IN OR UNDER PARSONS. CONDUIT IN PARSONS WILL BE REMOVED DURING DEMOLITION.
- EXISTING UNDERGROUND FEED FROM PARSONS TO CLARA BLACK SHALL REMAIN UNTIL PHASE IIA DEMOLITION AND SHALL BE PROTECTED DURING CONSTRUCTION.
- EXISTING UNDERGROUND FEED FROM PANEL-10PC IN PERSINGER TO ADMINISTRATION. DISCONNECT FEEDER. CONDUIT WILL BE REMOVED WITH DEMOLITION OF BUILDINGS.
- EXISTING TELEPHONE AND SIGNAL CABLES TO BE REMOVED BY OTHERS. CONDUIT TO BE REMOVED WITH DEMOLITION OF BUILDING.
- REMOVE POLE LIGHTS. BASES AND WIRING TO BE REMOVED DURING DEMOLITION OF PERSINGER.
- REMOVE EXISTING DISCONNECT SWITCH FOR CU-1 (3 POLE, 100 AMP). PROVIDE JUNCTION BOX AND EXTEND EXISTING CIRCUIT (3 #6 AND #8 GROUND) TO NEW CU-1 LOCATION IN 1 1/4" PVC CONDUIT. REMOUNT DISCONNECT SWITCH AND CONNECT RELOCATED CU-1.
- PROVIDE A 3 POLE 50 AMP, 480 VOLT CIRCUIT FROM NEAREST AVAILABLE SOURCE IN CLARA BLACK. CONTRACTOR SHALL DETERMINE SOURCE BEFORE SUBMITTING BID.
- PROVIDE FUSE SIZE REQUIRED BY BOILER AND CONNECT IN ACCORDANCE WITH MANUFACTURERS DIRECTIONS.

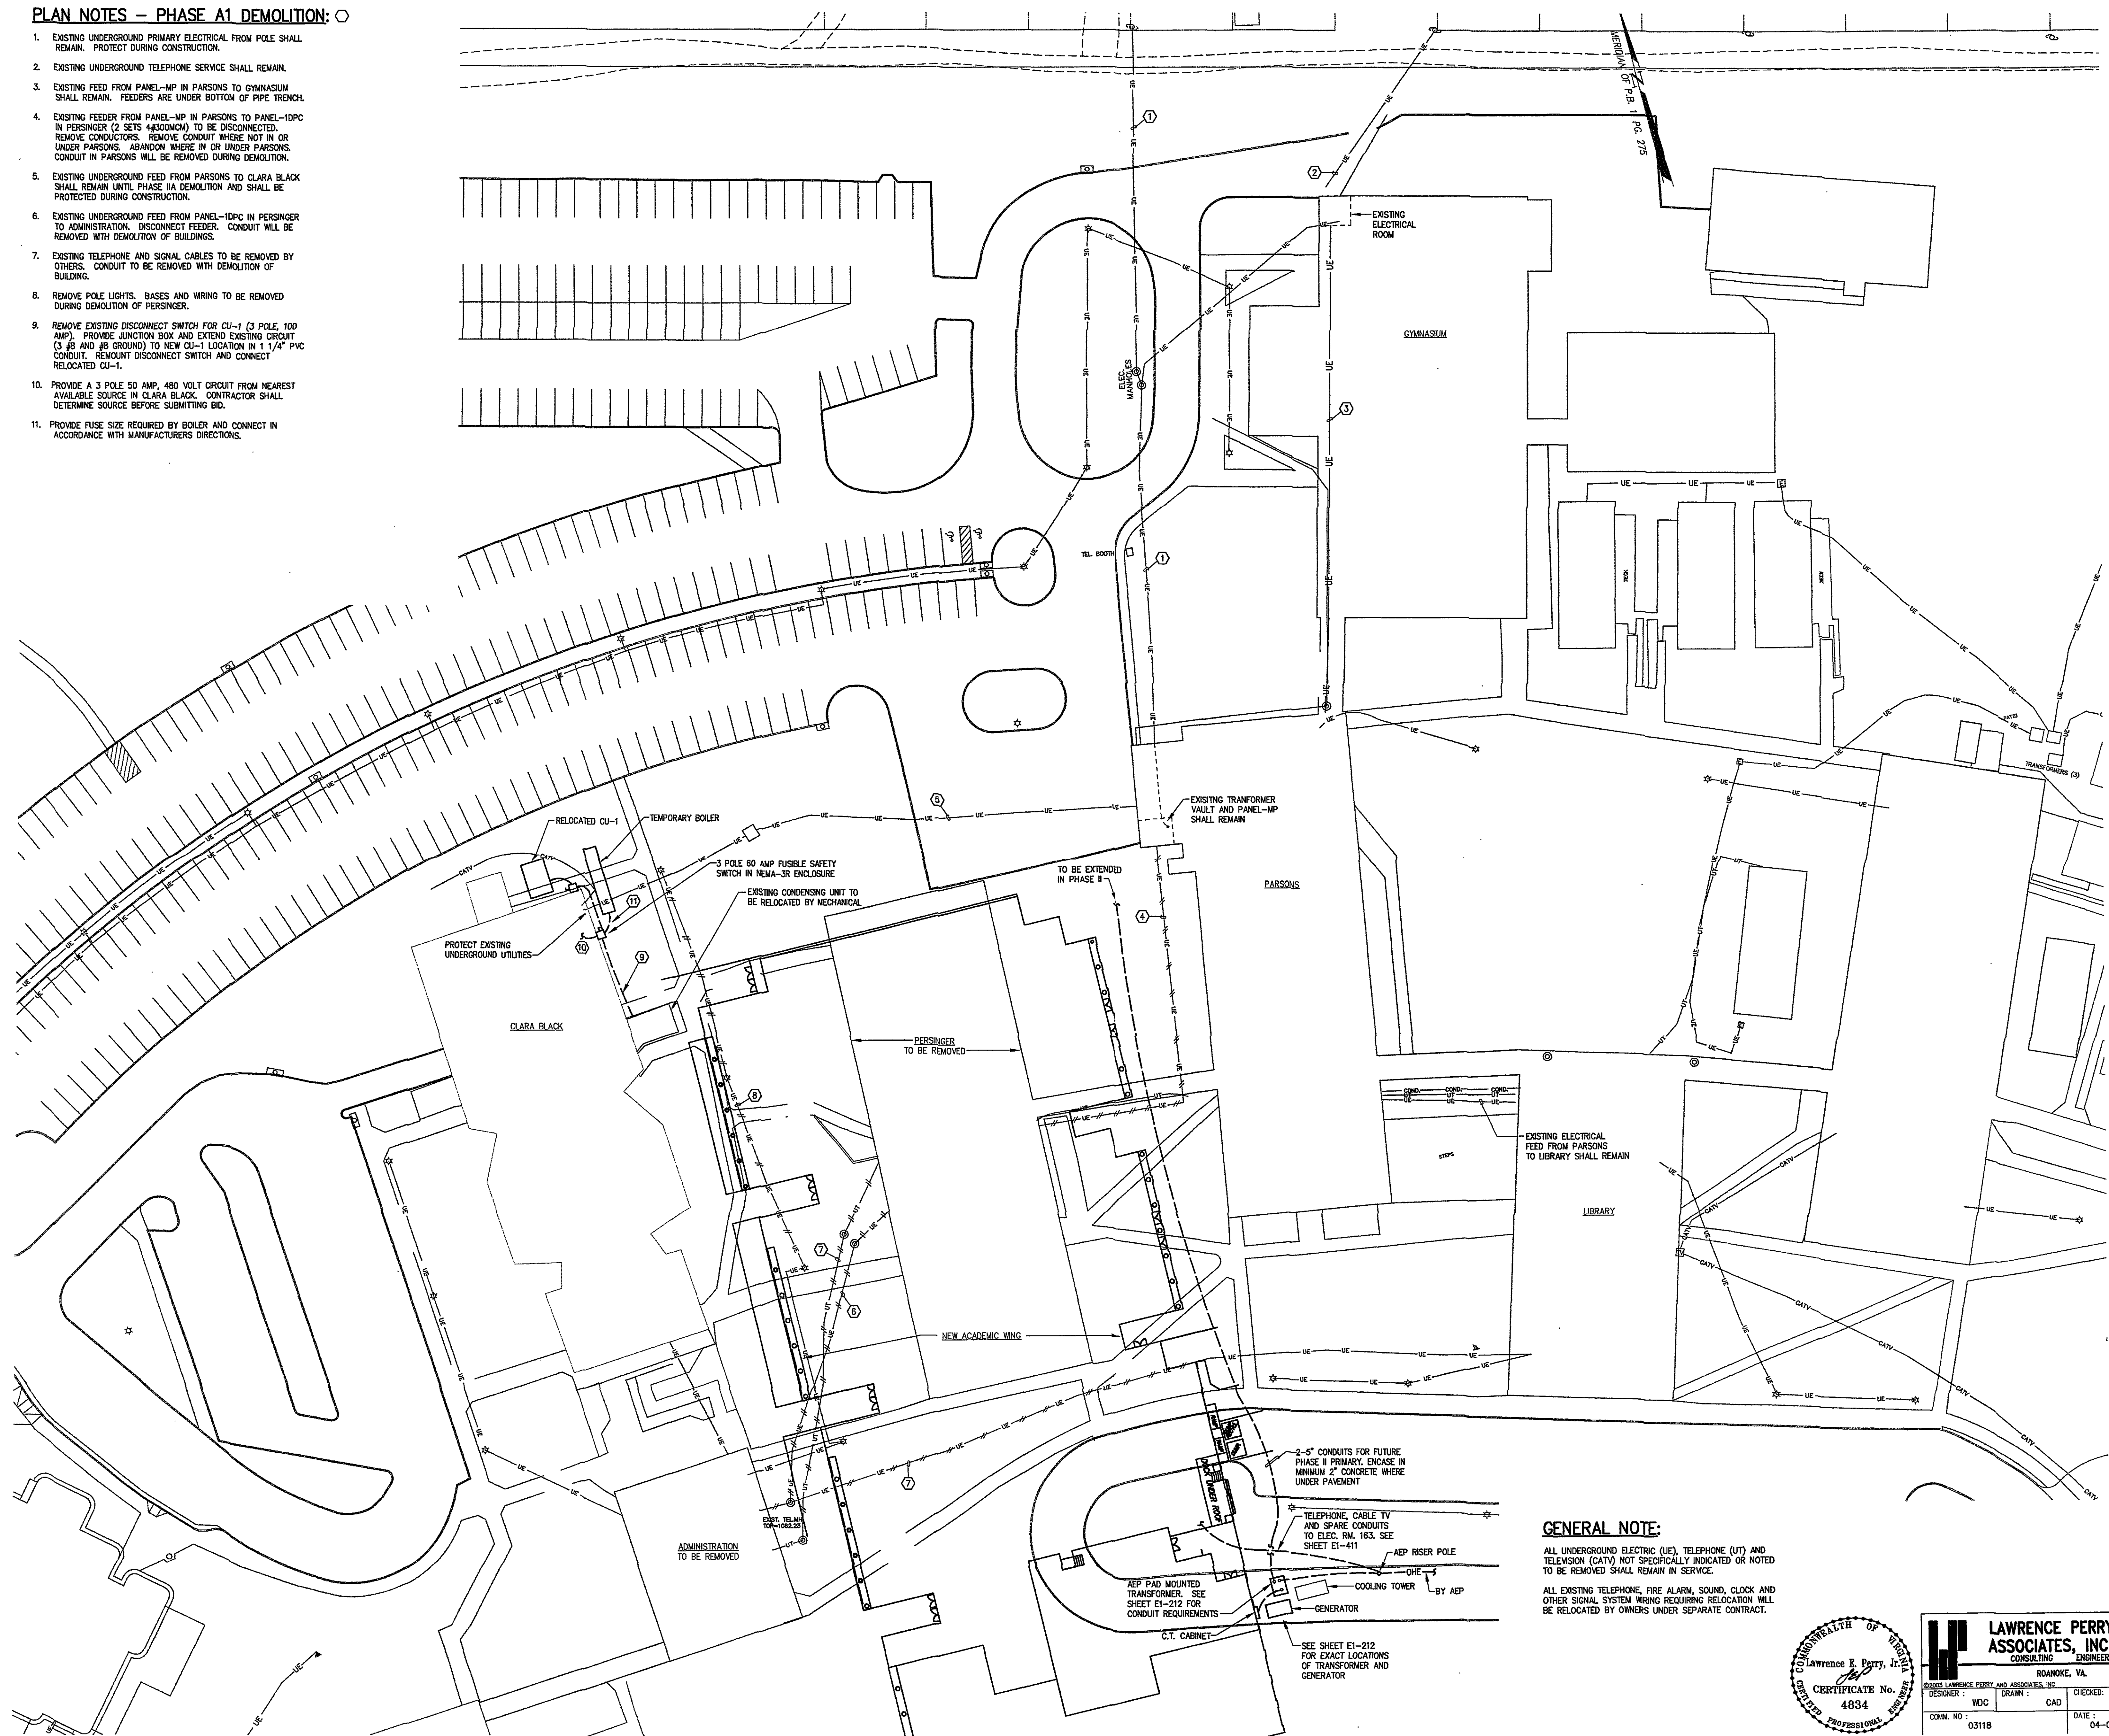

GENERAL NOTE:

ALL UNDERGROUND ELECTRIC (UE), TELEPHONE (UT) AND TELEVISION (CATV) NOT SPECIFICALLY INDICATED OR NOTED TO BE REMOVED SHALL REMAIN IN SERVICE.

ALL EXISTING TELEPHONE, FIRE ALARM, SOUND, CLOCK AND OTHER SIGNAL SYSTEM WIRING REQUIRING RELOCATION WILL BE RELOCATED BY OWNERS UNDER SEPARATE CONTRACT.

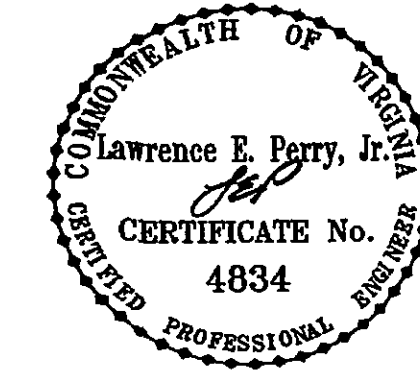

LAWRENCE PERRY & ASSOCIATES, INC. CONSULTING ENGINEERS	
DESIGNER: WDC	CHECKED: WDC
DRAWN: CAD	DATE: 04-02-04
COPIES: 03118	

PERKINS & WILL

Architecture • Interiors • Planning
404.873-2300 fax:404.892.5823
1382 Peachtree Street Atlanta Georgia 30309
Boston • Charlotte/RTP • Chicago • Dallas
Los Angeles • Miami • Minneapolis • New York

Rife + Wood
ARCHITECTS
1326 Grandin Road Roanoke, Virginia 24015
(540) 344-6015 fax: (540) 344-5982

in association with:

Caldwell White - Civil Engineers
4203 Madison Avenue
Roanoke, Virginia 24017
540-366-3400 (p) 540-366-8702 (f)


The Fitch Studio
1740 20th Street, NW
Washington, DC 20009
202-588-0148 (p) 202-588-0149 (f)

Kinsey Shane & Associates - Architects
and Structural Engineers
201 West Main Street
Salem, Virginia 24153
540-389-8655 (p) 540-389-9130 (f)

Lawrence Perry & Associates, Inc.
Mechanical & Electrical Engineers
304 West Church Avenue
Roanoke, Virginia 24011
540-342-1816 (p) 540-344-3410 (f)

Faassen & Associates - Food Service
8526 Sunflower Drive
Charlotte, North Carolina
204-536-9234 (f)

vanBlaricom & Frantz - Interior Designers
112 West Kirk Avenue
Roanoke, Virginia 24015
540-344-4098 (p) 540-344-4295 (f)

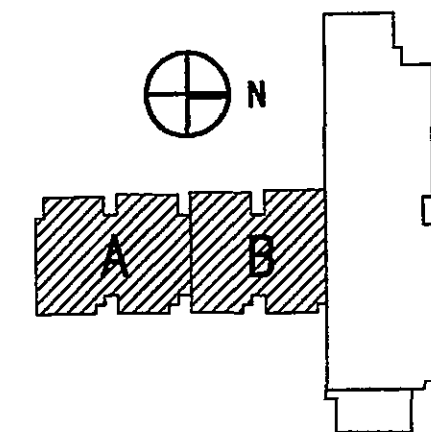

**PATRICK HENRY
HIGH SCHOOL**

PHASE I
School Site Project No. 124-39A
Literary Loan No. 11187

ISSUED FOR CONSTRUCTION		04/02/04
NUMBER	ISSUE	DATE

Revisions

Copyright © 2004 PERKINS & WILL

Sheet Information

Date: 04/02/04
Job Number: 800200.000
Scale: 1"=30'
Drawn: CAD
Checked: WDC
Approved: LPA
Title

**ELECTRICAL SITE
PLAN - UTILITIES**

Sheet

E1-101

WVWV 10/27/04