


PEPSI COLA PLANT

INDUSTRIAL DRIVE

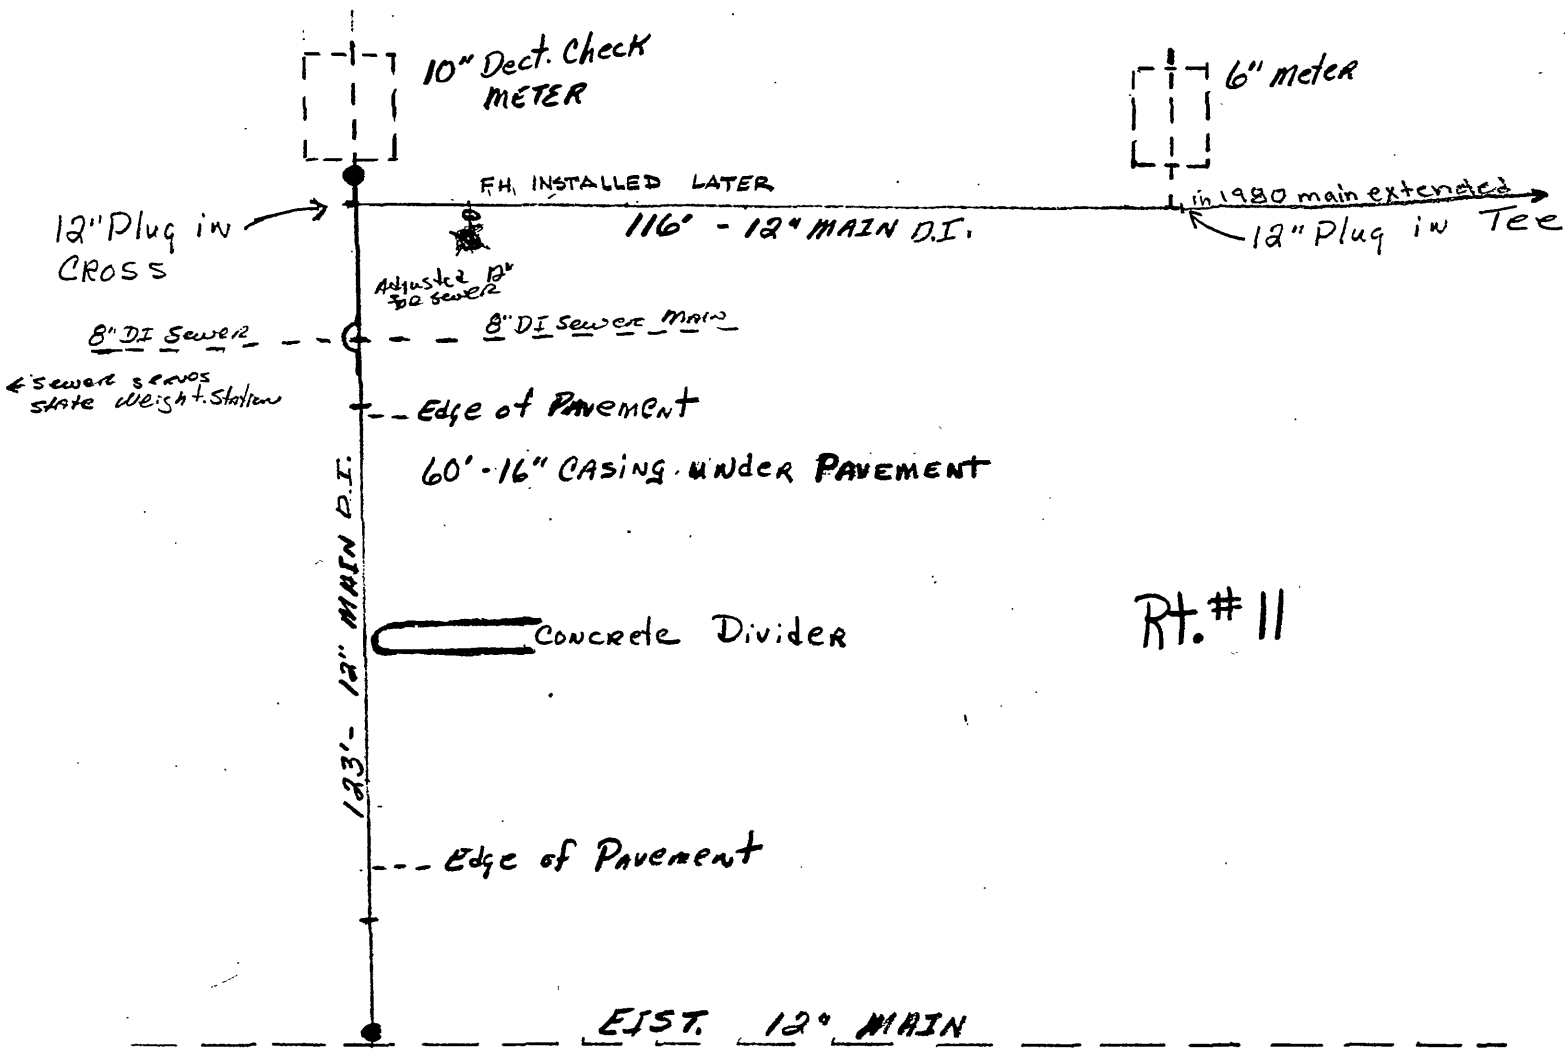

Rt. # 11

Work order project

DATE STARTED 8-15-79				
DATE COMP. 9-11-79				
FEET MAIN	SIZE	VALVE	VAULT	BOX
239'	12"	2	2	
F. H. CO:AP. <u> </u>				
F. H. STUB ONLY <u> </u>				
SERV. INS. BY:				
MAIN INS. BY: <u>ULS Ed Trent</u>				
NO. <u> </u> SERV. INS. <u> </u>				
CITY OR CO. <u>County</u>				
DEPT. INSP. <u>ULE Ed Trent</u>				

WATER CONSTRUCTION MAPS	
	COMPLETED
100' Map #20 County	✓
600' Map #	✓
Valve Sheet	✓
Original Map	✓
Copy in Year Folder	✓
Index Card File	✓
Pipe Record Book	✓
Main Extension List	✓
As - Built Folder	✓

WATER DEPT. # 79-22
10-25-90 this map drawn