


SANITARY SEWER STRUCTURE SCHEDULE:

- (A) S.S. MANHOLE
INSIDE DROP M.H.
6" DIAMETER
TOP=1246.4
INV. IN=1239.4 (FROM J)
INV. IN=1239.4 (FROM M)
INV. IN=1233.2 (FROM H)
INV. OUT=1233.1
- (B) S.S. MANHOLE
TOP=1236.0
INV. IN=1231.1
INV. OUT=1231.0
- (C) S.S. MANHOLE
TOP=1235.5
INV. IN=1230.6
INV. OUT=1230.5
- (D) S.S. MANHOLE
TOP=1231.3
INV. IN=1224.6
INV. OUT=1224.5
- (E) S.S. MANHOLE
TOP=1227.9
INV. IN=1223.1
INV. OUT=1223.0
- (F) S.S. CLEANOUT
TOP=1239.8
INV.=1235.0
- (G) S.S. CLEANOUT
TOP=1240.5
INV.=1234.2
- (H) S.S. CLEANOUT (TRAFFIC-BEARING)
TOP=1245.9
INV.=1233.4
- (I) S.S. CLEANOUT
TOP=1248.2
INV.=1244.0
- (J) S.S. CLEANOUT (TRAFFIC-BEARING)
TOP=1246.7
INV.=1242.7
- (K) S.S. CLEANOUT
TOP=1248.9
INV.=1244.5
- (L) S.S. CLEANOUT (TRAFFIC-BEARING)
TOP=1247.2
INV.=1242.7
- (M) S.S. CLEANOUT (TRAFFIC-BEARING)
TOP=1246.7
INV.=1241.5
- (N) S.S. CLEANOUT
TOP=1245.0
INV.=1236.0
- (O) S.S. CLEANOUT
TOP=1248.0
INV.=1244.0

NOTES:
1. ALL SANITARY SEWER PIPE SHALL BE SDR-35 PVC PIPE UNLESS OTHERWISE SPECIFIED.
2. 6" S.S. LATERALS SHALL BE CONSTRUCTED AT MINIMUM 1.04% SLOPE PER THE BUILDING CODE.

SANITARY SEWER PIPE SCHEDULE:


FROM	INV	TO	INV	
F	1235.0	G	1234.2	53'-6" SDR-35 PVC @ 1.51%
G	1234.2	H	1233.4	51'-6" SDR-21 PVC @ 1.57%
H	1233.4	A	1233.2	11'-6" SDR-21 PVC @ 1.82%
I	1244.0	J	1241.2	63'-6" SDR-35 PVC @ 4.44%
J	1241.2	A	1239.4	12'-6" SDR-35 PVC @ 15.0%
K	1244.5	L	1242.7	78'-6" SDR-35 PVC @ 2.31%
L	1242.7	M	1240.9	79'-6" SDR-35 PVC @ 2.28%
M	1240.9	A	1239.4	10'-6" SDR-35 PVC @ 15.0%
N	1244.0	N	1236.0	18'-6" SDR-21 PVC @ 44.4%
O	1236.0	A-B	1232.2	10'-6" SDR-21 PVC @ 38.0%
A	1233.1	B	1231.1	149'-8" SDR-21 PVC @ 1.34%
B	1231.0	C	1230.5	47'-8" SDR-35 PVC @ 1.06%
C	1230.4	D	1224.6	133'-8" SDR-35 PVC @ 4.36%
D	1224.5	E	1223.1	137'-8" SDR-35 PVC @ 1.02%
E	1223.0	ex.	1222.7	25'-8" SDR-35 PVC @ 1.20%

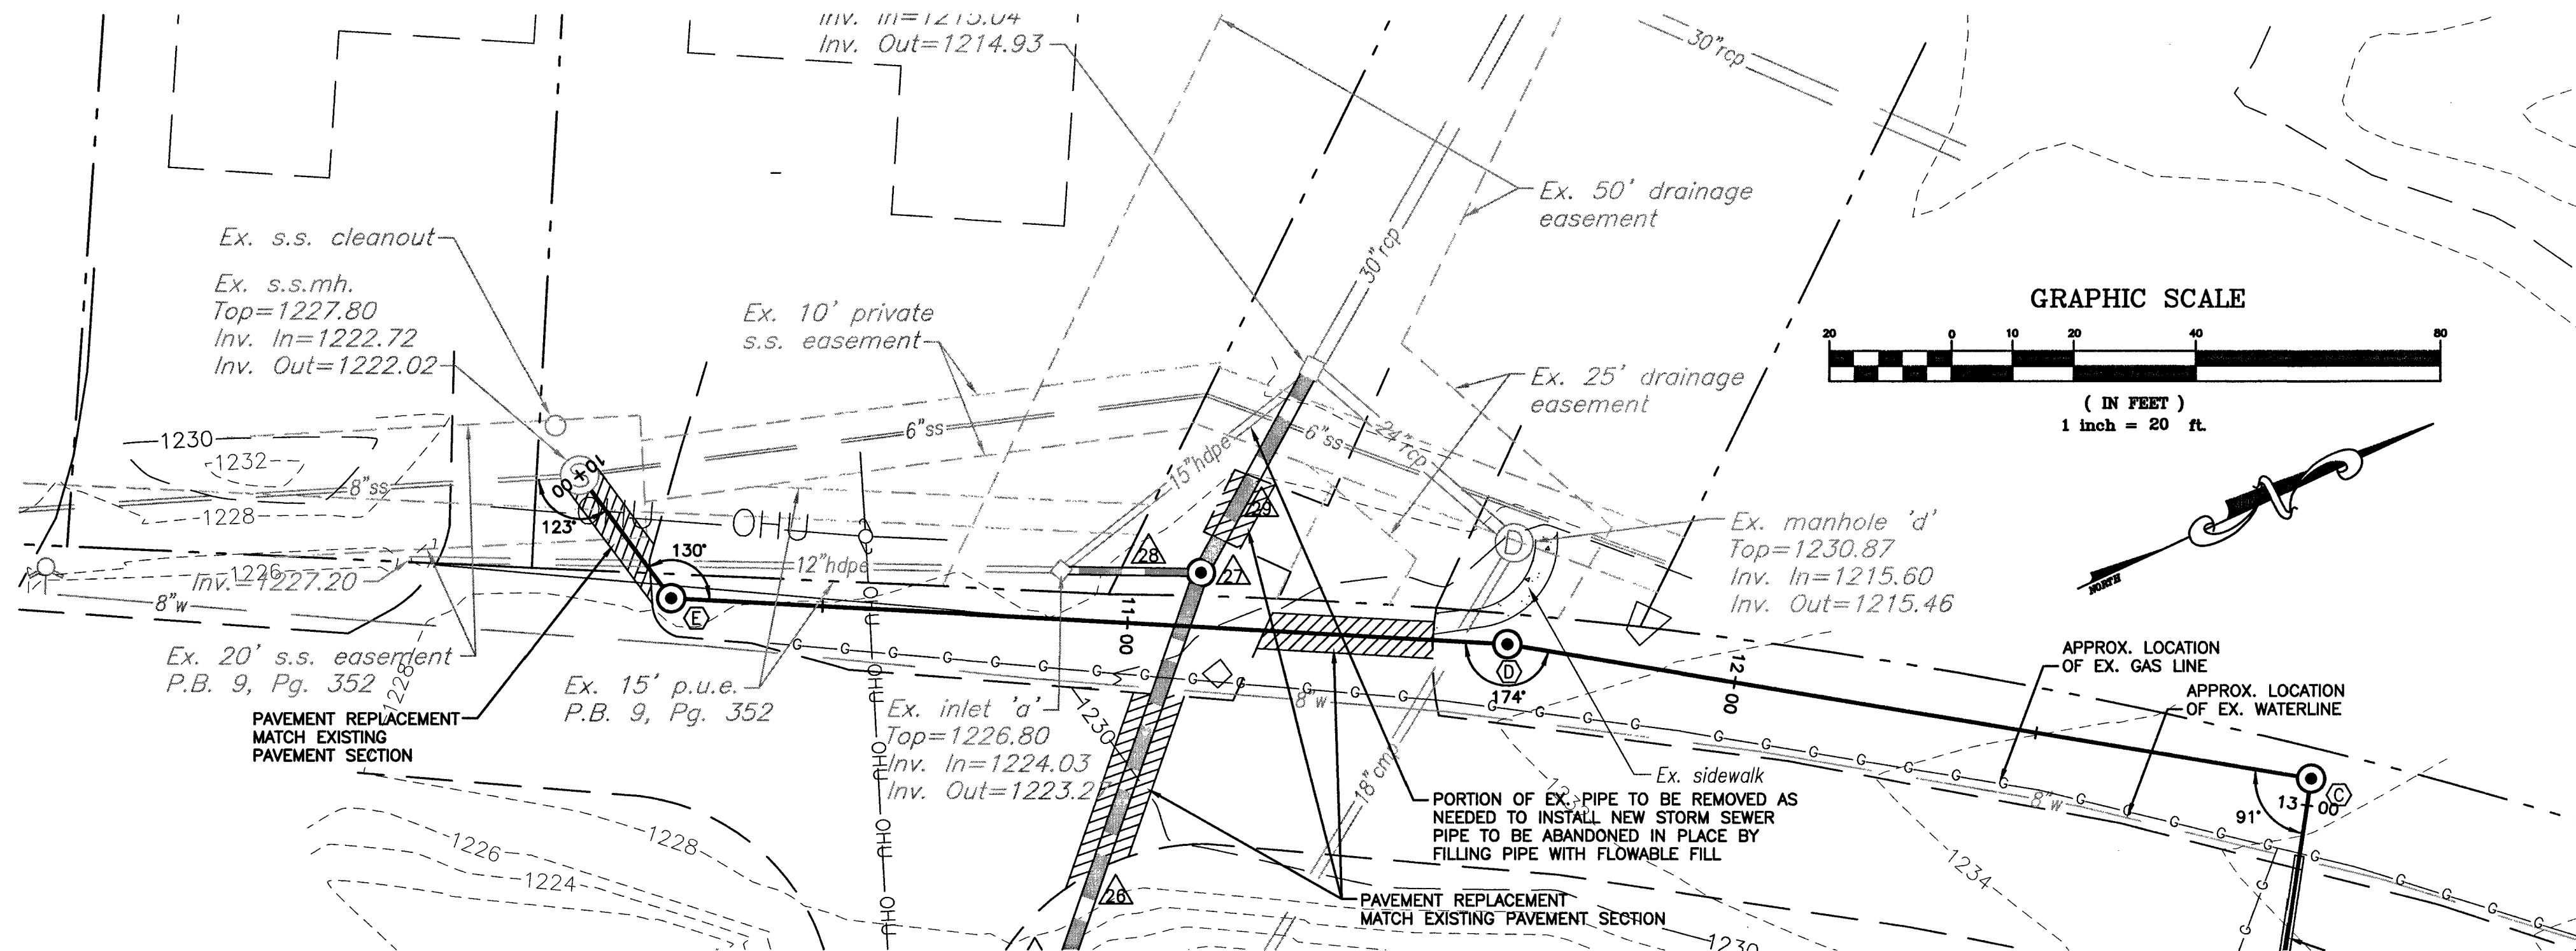


S.S. EXTENSION PLAN VIEW

SCALE: 1"=20'

S.S. PROFILE

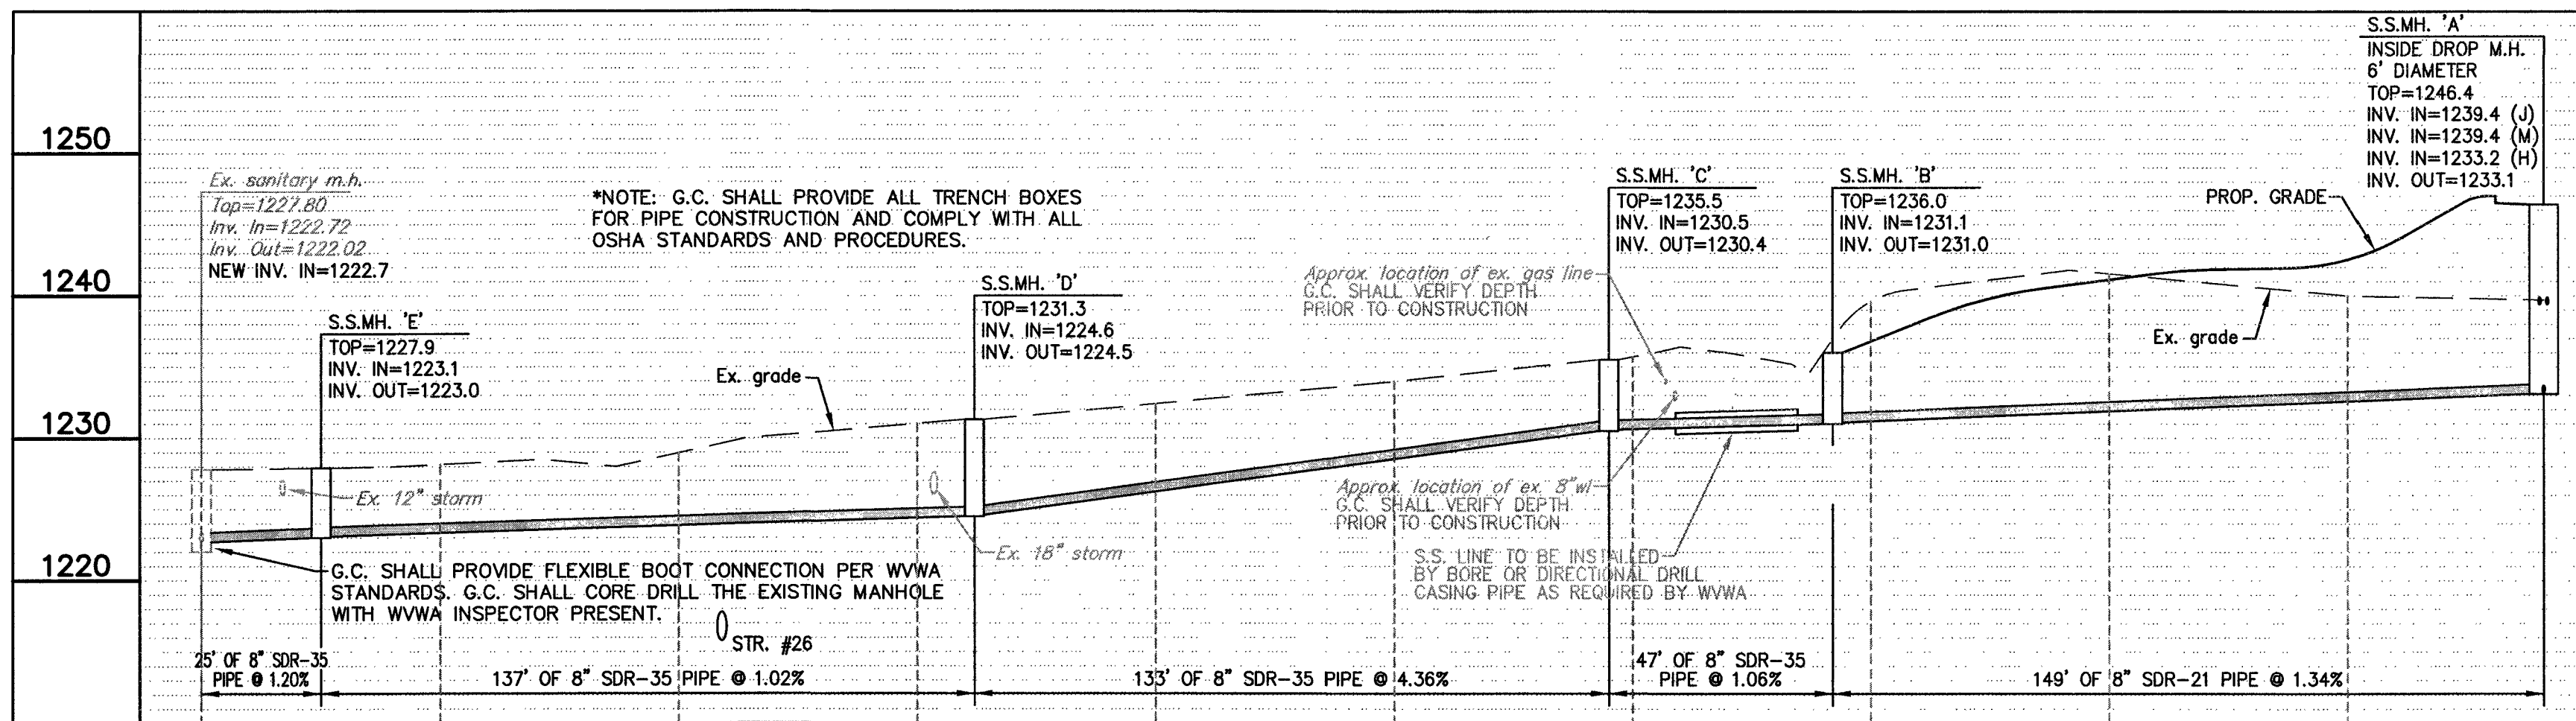

W.L. PROFILE

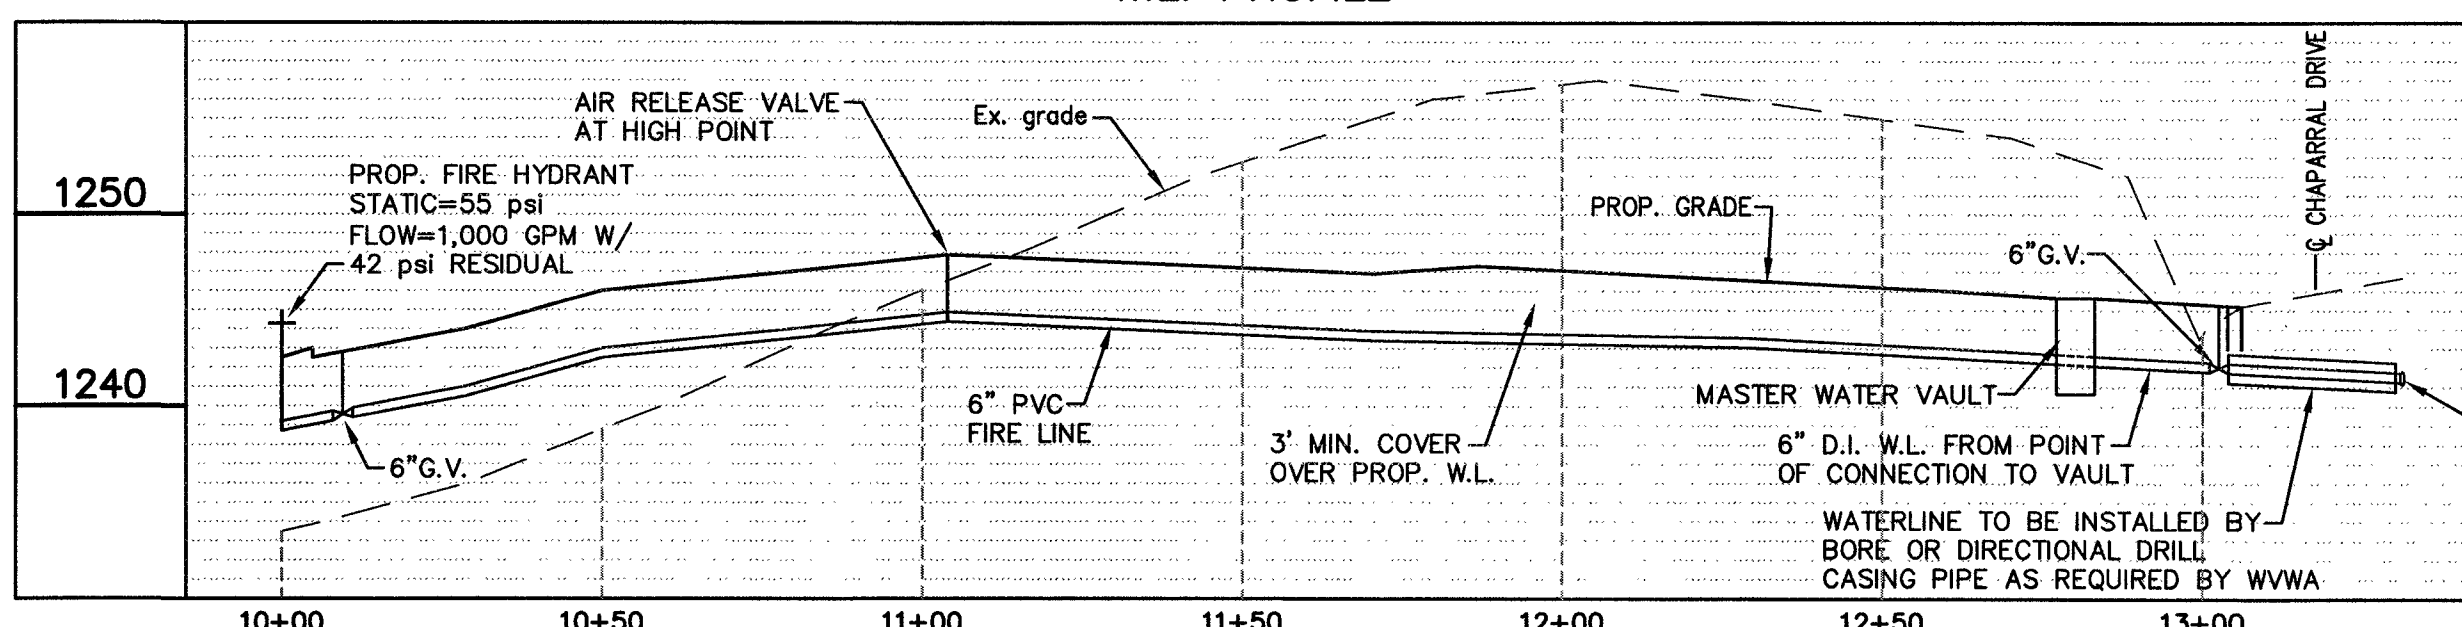

PROFILE SCALES
HORZ. SCALE: 1"=30'
VERT. SCALE: 1"=10'